


High Wind–Resistant Construction



HIGH WIND-RESISTANT CONSTRUCTION APPLICATION GUIDE



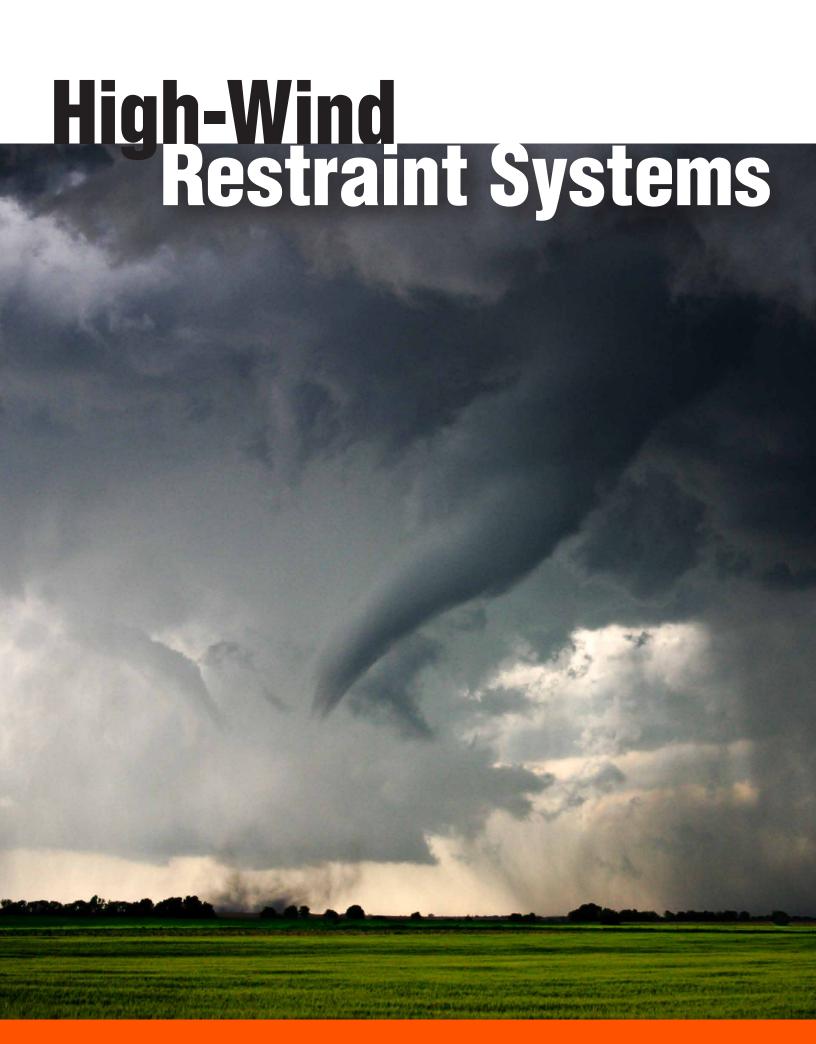



Respecting Conditions, Building for Strength

Time and again, we see the havoc that high winds can wreak upon structures in the form of tornadoes or hurricanes. Some forces can be too great for human engineering to counter. Fortunately, however, there are precautions we can take to limit the damage caused by high-wind events.

Through nearly 60 years of field experience and countless hours of research, Simpson Strong-Tie has developed the industry's most comprehensive line of wood construction connectors and fasteners specifically designed to resist uplift and lateral forces caused by high winds. Our state-of-the-art manufacturing facilities and processes help ensure that Simpson Strong-Tie connectors and fasteners are consistently the most reliable in the industry.

This guide is designed to help you easily locate the specific connector you need for building in high-wind areas. Whether you search by product or application, Simpson Strong-Tie has the right connector to help you build safe, strong structures. To learn more, visit **strongtie.com** or call (800) 999-5099.







Subject Index



Warranty and Terms and Conditions of Sale6	Post/Column to Beam
Important Information/General Notes	Beam to Corner Post/Column40
Corrosion Information9–12	Post/Column to Foundation
Using This Guide13	Roof Boundary Connection
The Forces You Face – Uplift and Lateral Load Path 14–15	Lateral Load
Truss/Rafter to Wood Double Top Plates	Holdowns45
Girder/Truss to Wood Wall Framing	Strong-Wall® Shearwalls
I-Joists to Wall Framing	Strong-Rod™ Uplift Restraint System47
I-Joists to Masonry/Concrete	Gable End to Wall Framing
Embedded Truss/Rafter to Masonry/Concrete	Valley Truss to Roof Framing49
Post-Installed Truss/Rafter to Masonry/Concrete21	Drag Strut Connection
Girder/Truss to Masonry/Concrete	Hanger Uplift Considerations50
Truss/Rafter Hip to Wall	Load Path Installation Considerations 51–53
Truss/Rafter Hip to End Wall	Fastener Types54
Truss/Rafter to Single Top Plate	Strong-Drive® SDS HEAVY-DUTY CONNECTOR Screw 55
Hollow Column	Strong-Drive® SD CONNECTOR Screw
Truss/Rafter Directly to Stud	Sole Plate and Ledger Connections
Top Plates to Stud	Roof to Wall
Stud to Band Joist	Stud to Plate (Wide Face)
Stud to Stud	Stud to Plate (Narrow Face)
Floor to Masonry/Concrete	Floor to Floor
Stud to Sill Plate32	Subfloor Attachment
Sill Plate to Foundation	Titen® Concrete and Masonry Screws 65–66
Header to Wall Framing34	Titen HD® Heavy-Duty Screw Anchors67
Stemwall/Crawlspace	High-Strength Anchoring Adhesives
Beam to CMU or Concrete Pier	Resources and Links
Wall to Pile/Girder38	

For an individual product index, please see page 70.

Company Profile




For nearly 60 years, Simpson Strong-Tie has focused on creating structural products that help people build safer and stronger homes and buildings. A leader in structural systems research and technology, Simpson Strong-Tie is one of the largest suppliers of structural building products in the world. The Simpson Strong-Tie commitment to product development, engineering, testing and training is evident in the consistent quality and delivery of its products and services.

For more information, visit the company's website at www.strongtie.com.

The Simpson Strong-Tie Company Inc. "No Equal" pledge includes:

- Quality products value-engineered for the lowest installed cost at the highest-rated performance levels
- Most thoroughly tested and evaluated products in the industry
- · Strategically located manufacturing and warehouse facilities
- National code agency listings
- Largest number of patented connectors in the industry
- Global locations with an international sales team
- In-house R&D and tool and die professionals
- In-house product testing and quality control engineers
- Support of industry groups including ACI, AISC, AISI, AITC, ASCE, ASTM, AWC, AWPA, CFSEI, CSI, ICFA, NBMDA, NFBA, NLBMDA, SDI, SETMA, SFA, SFIA, SREA, STAFDA, TPI, WDSC, WIJMA, WTCA and local engineering groups.

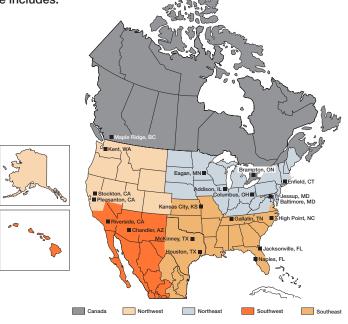

The Simpson Strong-Tie **Quality Policy**

We help people build safer structures economically. We do this by designing, engineering and manufacturing "No Equal" structural connectors and other related products that meet or exceed our customers' needs and expectations. Everyone is responsible for product quality and is committed to ensuring the effectiveness of the Quality Management System.

Karen Colonias Chief Executive Officer

Getting Fast **Technical Support**

When you call for engineering technical support, we can help you quickly if you have the following information at hand. This will help us to serve you promptly and efficiently.

- Which Simpson Strong-Tie® catalog are you using? (See the front cover for the catalog number.)
- Which Simpson Strong-Tie product are you using?
- What is your load requirement?
- What are the carried member's width and height?
- What are the supporting member's width and height?
- · What are the carried and supporting members' material and application?

(800) 999-5099 • www.strongtie.com

Important Information



Limited Warranty

Simpson Strong-Tie Company Inc. warrants products to be free from defects in material or manufacturing. Simpson Strong-Tie Company Inc. products are further warranted for adequacy of design when used in accordance with design limits in this application guide and when properly specified, installed and maintained. This warranty does not apply to uses not in compliance with specific applications and installations set forth in this application guide, or to non-catalog or modified products, or to deterioration due to environmental conditions.

Simpson Strong-Tie® connectors are designed to enable structures to resist the movement, stress and loading that results from impact events such as earthquakes and high-velocity winds. Other Simpson Strong-Tie products are designed to the load capacities and uses listed in this application guide. Properly installed Simpson Strong-Tie products will perform in accordance with the specifications set forth in the applicable Simpson Strong-Tie catalog. Additional performance limitations for specific products may be listed on the applicable catalog pages.

Due to the particular characteristics of potential impact events, the specific design and location of the structure, the building materials used, the quality of construction, and the condition of the soils involved, damage may nonetheless result to a structure and its contents even if the loads resulting from the impact event do not exceed Simpson Strong-Tie catalog specifications and Simpson Strong-Tie connectors are properly installed in accordance with applicable building codes.

All warranty obligations of Simpson Strong-Tie Company Inc. shall be limited, at the discretion of Simpson Strong-Tie Company Inc., to repair or replacement of the defective part. These remedies shall constitute Simpson Strong-Tie Company Inc.'s sole obligation and sole remedy of purchaser under this warranty. In no event will Simpson Strong-Tie Company Inc. be responsible for incidental, consequential, or special loss or damage, however caused.

This warranty is expressly in lieu of all other warranties, expressed or implied, including warranties of merchantability or fitness for a particular purpose, all such other warranties being hereby expressly excluded. This warranty may change periodically - consult our website www.strongtie.com for current information.

Terms and Conditions of Sale

Product Use

Products in this guide are designed and manufactured for the specific purposes shown and should not be used with other connectors not approved by a qualified Designer. Modifications to products or changes in installations should only be made by a qualified Designer. The performance of such modified products or altered installations is the sole responsibility of the Designer.

Indemnity

Customers or Designers modifying products or installations, or designing non-catalog products for fabrication by Simpson Strong-Tie Company Inc., shall, regardless of specific instructions to the user, indemnify, defend and hold harmless Simpson Strong-Tie Company Inc. for any and all claimed loss or damage occasioned in whole or in part by non-catalog or modified products.

Non-Catalog and Modified Products

Consult Simpson Strong-Tie Company Inc. for applications for which there is no catalog product, or for connectors for use in hostile environments, with excessive wood shrinkage, or with abnormal loading or erection requirements.

Non-catalog products must be designed by the customer and will be fabricated by Simpson Strong-Tie in accordance with customer specifications.

Simpson Strong-Tie cannot and does not make any representations regarding the suitability of use or load-carrying capacities of non-catalog products. Simpson Strong-Tie provides no warranty, express or implied, on non-catalog products. F.O.B. Shipping Point unless otherwise specified.

We Are ISO 9001-2008 Registered

Simpson Strong-Tie is an ISO 9001-2008 registered company. ISO 9001-2008 is an internationally recognized quality assurance system that lets our domestic and international customers know they can count on the consistent quality of Simpson Strong-Tie® products and services.



Important Information



Warning

Simpson Strong-Tie Company Inc. structural connectors, anchors, and other products are designed and tested to provide specified design loads. To obtain optimal performance from Simpson Strong-Tie Company Inc. products and achieve maximal allowable design load, the products must be properly installed and used in accordance with the installation instructions and design limits provided by Simpson Strong-Tie Company Inc. To ensure proper installation and use, Designers and installers must carefully read the following General Notes, General Instructions for the Installer, and General Instructions for the Designer, as well as consult the applicable catalog pages for specific product installation instructions

Proper product installation requires careful attention to all notes and instructions, including these basic rules:

- 1. Be familiar with the application and correct use of the connector.
- 2. Follow all installation instructions provided in the applicable catalog, website, Installer's Pocket Guide or any other Simpson Strong-Tie publications.
- 3. Install all required fasteners per installation instructions provided by Simpson Strong-Tie Company Inc.: (a) use proper fastener type; (b) use proper fastener quantity; (c) fill all fastener holes; (d) do not overdrive or underdrive nails, including when using gun nailers; and (e) ensure screws are completely driven.
- 4. Stainless-steel connector loads may be reduced when installed with smooth-shank, stainless-steel nails. Simpson Strong-Tie recommends using ring-shank, stainless-steel nails with stainless-steel connectors.
- 5. Only bend products that are specifically designed to be bent. For those products that require bending, do not bend more than once.
- 6. Cut joists to the correct length, do not "short-cut." The gap between the end of the joist and the header material should be no greater than 1/4" unless otherwise noted.

In addition to following the basic rules provided above as well as all notes, warnings and instructions provided in the catalog, installers, Designers, engineers and consumers should consult the Simpson Strong-Tie Company Inc. website at www.strongtie.com to obtain additional design and installation information, including:

• Instructional builder/contractor training kits containing an instructional video, an instructor guide and a student guide in both English and Spanish;

- Installer's Pocket Guide, which is designed specifically for installers and uses detailed graphics and minimal text in both English and Spanish to explain visually how to install many key products;
- Information on workshops Simpson Strong-Tie conducts at various training centers throughout the country;
- · Product-specific installation videos;
- · Specialty catalogs;
- Code reports Simpson Strong-Tie® Code Report Finder software;
- · Technical fliers and bulletins;
- Master format specifications:
- · Material safety data sheets;
- Corrosion information;
- Connector selection guides for engineered wood products (by manufacturer);
- Simpson Strong-Tie® Connector Selector™ software;
- Simpson Strong-Tie® AutoCAD® menu;
- Simpson Strong-Tie[®] CFS Designer[™] software;
- Simpson Strong-Tie® Anchor Designer software
- Simpson Strong-Tie[®] Strong-Wall[®] Selector software;
- Simpson Strong-Tie® Strong Frame® Selector;
- Simpson Strong-Tie® Fastener Finder; and
- · Answers to frequently asked questions and technical topics.

Failure to follow fully all of the notes and instructions provided by Simpson Strong-Tie Company Inc. may result in improper installation of products. Improperly installed products may not perform to the specifications set forth in this catalog and may reduce a structure's ability to resist the movement, stress, and loading that occurs from gravity loads as well as impact events such as earthquakes and high-velocity winds.

Simpson Strong-Tie Company Inc. does not guarantee the performance or safety of products that are modified, improperly installed or not used in accordance with the design and load limits set forth in this application guide.

Important Information



General Notes

- 1. Refer to the current Simpson Strong-Tie® Wood Construction Connectors catalog for connector load values, installation, fastener schedules and other important information including Terms and Conditions of Sale and Building Code Evaluation listings.
- 2. Throughout the guide there are installation drawings showing the load transfer from one element in the structure to another. Additional connections may be required to safely transfer the loads through the structure. It is the Designer's responsibility to specify and detail all necessary connections to ensure that a continuous load path is provided as required by the building code.
- U.N.O. allowable connector loads are provided with a 160% load duration increase (for wind) on the calculated capacity of the nails. No further load duration increase is allowed by the building code.
- 4. Unless otherwise noted, the allowable loads published in this guide are limited to the lowest of the following: average recorded test load at 1/8" deflection; lowest ultimate recorded test load of 3 test specimens divided by 3 (or the average of 6 specimens divided by 3); or the calculated value based on steel, wood bearing, and/or fastener capacity.
- 5. When multiple connectors are used, they must be installed so fastener locations do not overlap.
- When a connector is loaded simultaneously in more than one direction, the allowable load must be evaluated as shown here.

For all connectors use the following equation: Design Uplift/Allowable Uplift + Design Lateral Parallel to Plate / Allowable Lateral Parallel to Plate + Design Lateral Perpendicular to Plate / Allowable Lateral Perpendicular to Plate < 1.0

The three terms in the unity equation are due to the possible directions that exist to generate force on a connector. The number of terms that must be considered for simultaneous loading is at the sole discretion of the Designers and is dependent on their method of calculating wind forces and the utilization of the connector within the structural system.

As an alternative, certain roof-to-wall connectors (embedded truss anchors, pages 18-20, seismic and hurricane ties and twist straps, page 16 - excluding HGA10KT) can be evaluated using the following: the design load in each direction shall not exceed the published allowable load in that direction multiplied by 0.75.

- 7. All references to bolts or machine bolts (MBs) are for structuralquality through bolts (not lag screws or carriage bolts) equal to or better than ASTM Standard A307, Grade A.
- 8. Unless otherwise noted, all nails are common nails (refer to page 54).
- 9. Refer to the Connector-Anchor Selector at www.strongtie.com for anchorage to concrete design.
- 10. Illustrations showing hurricane ties installed on the outside of the wall are for clarity and assume a minimum overhang of 31/2". Installation on the inside of the wall is acceptable (see General Note 12 below). For uplift continuous load path, connections in the same area (e.g., truss-to-plate connector and plate-to-stud connector) must be on same side of the wall.
- 11. When using wood structural panel sheathing for wind uplift continuous load path, refer to Simpson Strong-Tie technical bulletins T-WLSHEATH and T-HTIECONPATH for further information.
- 12. When installing hurricane ties on the inside of the wall, special care must be taken to prevent condensation on the inside of the completed structure in cold climates.
- 13. Unless otherwise noted, loads are in pounds; dimensions are in inches.
- 14. Truss plates shown may not be manufactured by Simpson Strong-Tie.
- 15. Built-up lumber (multiple members) must be fastened together to act as one unit to resist the applied load (excluding the connector fasteners). This must be determined by the Designer/ Engineer of Record.
- 16. When connecting DF/SP members to SPF lumber, use SPF allowable loads.
- 17. Concrete anchorage solutions provided in this catalog are based on applications in uncracked concrete resisting wind and low seismic loads (any structure in Seismic Design Categories A and B and detached one- and two-family dwellings in Seismic Design Category C).
- 18. Some hurricane ties can be used for bearing enhancement, see T-HTIEBEARING.
- 19. Twist straps do not have to be wrapped over the truss to achieve the load.



Simpson Strong-Tie General Recommendations

Simpson Strong-Tie has evaluated the AWPA Use Categories (AWPA U1-13) and the ICC-ES, AC257 Exposure Conditions and developed from that evaluation a set of Corrosion Resistance Recommendations. These recommendations address the coating systems and materials used by Simpson Strong-Tie for connector and fastener products.

Dry-service (or damp-service) environments lead to wood moisture contents less than or equal to 19%. The corrosion potential, even in chemically treated wood, is reduced in these conditions. These conditions are typical of AWPA UC1 and UC2 for wood treatment and AC257 Exposure Condition 1. See the Corrosion Resistance Classification Table for the Simpson Strong-Tie assessment of corrosion needs in these conditions. The AC257 Exposure Condition 2 reflects the presence of air-borne salt in a dry-service environment and corrosion hazard to exposed metal surfaces; it does not include effects of treatment chemicals.

Outdoor environments are generally more corrosive to steel either because the moisture exposure is elevated (greater than 19%) and/or the treatment chemical retention level is higher than for interior service. The AWPA classifies exterior above-ground treatments as Use Categories UC3 (A and B) depending on moisture run-off; and for ground-contact levels of protection, it has Use Categories UC4 (A-C). ICC-ES considers the exterior exposure to be limited by the type of chemicals and retention level of the chemicals in the qualification testing and whether the exposure includes salt exposure. In general, AC257 Exposure Condition 3 includes AWPA Use Categories UC1 (interior dry) to UC4A (exterior ground contact, general use).

Types 316/305/304 stainless steel, copper, silicon bronze and hot-dip galvanized (Class-C) are the most effective protection against corrosion risk, where Type 316 is the best choice for salt marine and chloridecontaining environments regardless of treatment chemicals or wood

species. Using a barrier membrane can provide additional corrosion protection; see technical bulletin T-PTBARRIER. If you choose to use hot-dip galvanized (Class-D), mechanically galvanized (C3, N2000, or Class 55), double-barrier or Quik Guard® coated fasteners on outdoor projects (e.g., a deck), you should periodically inspect the fasteners or have a professional inspection performed, and regular maintenance is a good practice. See the Corrosion Resistance Classifications Table for the Simpson Strong-Tie assessment of the corrosion resistance associated with materials and coatings and an appropriate level of corrosion resistance for various environments.

Due to the many variables involved, Simpson Strong-Tie cannot provide estimates of service life of connectors and fasteners. We suggest that all users and specifiers obtain recommendations on corrosion from the treated wood supplier or for the type of wood used. As long as Simpson Strong-Tie recommendations are followed, Simpson Strong-Tie stands behind its product performance and our standard warranty applies (page 6).

Simpson Strong-Tie does not recommend painting stainless steel fasteners or hardware. The reason behind this recommendation is that sometimes painting can facilitate corrosion. Stainless steel is "stainless" because it forms a protective chromium oxide film on the surface by passive oxidation with air. The paint film on the stainless steel surface may be imperfect or it can be injured during service, and in either case the metal may be exposed. Microscopic-sized film imperfections and scratches facilitate collection of dirt and water that can be stagnant and degrade or block the passive formation of the protective chromium oxide film. When this happens, crevice corrosion can initiate. Crevice corrosion eventually becomes visible as a brown stain or as red rust. This is the reason that painting usually does not improve the corrosion resistance of stainless steel.

Guidelines for Selecting Corrosion-Resistant Connectors and Fasteners

Evaluate the Application

Consider the importance of the connection.

Evaluate the Exposure

Consider these moisture and treatment chemical exposure conditions:

- Dry Service: Generally INTERIOR applications and includes wall and ceiling cavities, raised floor applications in enclosed buildings that have been designed to prevent condensation and exposure to other sources of moisture. Prolonged exposure during construction should also be considered, as this may constitute a Wet Service or Elevated Service Condition.
- Wet Service: Generally EXTERIOR construction in conditions other than Elevated Service. These include Exterior Protected and Exposed and General Use Ground Contact as described by the AWPA UC4A.
- Elevated Service: Includes fumes, fertilizers, soil, some preservative-treated wood (AWPA UC4B and UC4C), industrial zones, acid rain and other corrosive elements.

- Uncertain: Unknown exposure, materials or treatment chemicals.
- Ocean/Water Front: Marine environments that include airborne chlorides and some splash. Environments with de-icing salts are included.
- Treatment Chemicals: See AWPA Use Category Designations. The preservative-treated wood supplier should provide all of the pertinent information about the wood being used. The information should include Use Category Designation, wood species group, wood treatment chemical and chemical retention. See appropriate evaluation reports for corrosion effects of treatment chemicals and fastener corrosion resistance recommendations.

Use the Simpson Strong-Tie® Corrosion Classification Table

If the treatment chemical information is incomplete, Simpson Strong-Tie recommends the use of a 300-series stainless-steel product. Also, if the treatment chemical is not shown in the Corrosion Classification Table, then Simpson Strong-Tie has not evaluated it and cannot make any recommendations other than the use of coatings and materials in the Severe category. Manufacturers may independently provide test results of other product information; Simpson Strong-Tie expresses no opinion regarding such information.



Corrosion Resistance Recommendations

Low	Medium	High	Severe
	FASTE	ENERS	
Phosphate (gray, black), Clear (bright) zinc (ASTM F1941), Heavy electro-galvanized (ASTM A641-Class 1), Yellow zinc (ASTM F1941), Electrocoat (E-coat), Type-410 stainless steel	Mechanically galvanized (AS 3566.2-C3, N2000, ASTM B695-Class 55), Quik Guard® coating, Hot-dip galvanized (ASTM A153-Class D), Double-barrier coating, Type-410 stainless steel with protective top coat	Type-304 stainless steel, Type-305 stainless steel	Type-316 stainless steel, Hot-dip galvanized (ASTM A153-Class C), Silicon bronze, Copper
	CONNE	CTORS	
Simpson Strong-Tie® gray paint Powder coating Standard G90 zinc coating	ZMAX® (G185) Hot-dip galvanized (ASTM A153 - Class D)	Type-316L stainless steel	Type-316L stainless steel

Corrosion Resistance Classifications

			Mate	erial to Be Fastened					
Facilitation	Untreated	Preservative-Treated Wood							
Environment	Wood or Other Material	SBX-DOT Zinc Borate	Chemical Retention ≤ AWPA, UC4A	Chemical Retention > AWPA, UC4A	ACZA	Other or Uncertain	FRT Wood		
Dry Service	Low	Low	Low	High	High	High	Med		
Wet Service	Med	N/A	Med	High	High	High	High		
Elevated Service	High	N/A	Severe	Severe	High	Severe	N/A		
Uncertain	High	High	High	Severe	High	Severe	High		
Ocean/Water Front	Severe	N/A	Severe	Severe	Severe	Severe	N/A		

- 1. These are general guidelines that may not consider all application criteria. Refer to product specific information for additional guidance.
- 2. Type-316/305/304 stainless-steel products are recommended where preservative-treated wood used in ground contact has a chemical retention level greater than those for AWPA UC4A; CA-C, 0.15 pcf; CA-B, 0.21 pcf; micronized CA-C, 0.14 pcf; micronized CA-B, 0.15 pcf; ACQ-Type D (or C),
- 3. Testing by Simpson Strong-Tie following ICC-ES AC257 showed that mechanical galvanization (ASTM B695, Class 55), Quik Guard coating, and Double Barrier coating will provide corrosion resistance equivalent to hot-dip galvanization (ASTM A153, Class D) in contact with chemically treated wood in dry-service and wet-service exposures (AWPA UC1-UC4A, ICC-ES AC257 Exposure Conditions 1 and 3) and will perform adequately subject to regular maintenance and periodic inspection.
- 4. Mechanical galvanizations C3 and N2000 should not be used in conditions that would be more corrosive than AWPA UC3A (exterior, above ground, rapid water run off).
- 5. If uncertain about Use Category, treatment chemical, or environment, use Types 316/305/304 stainless steel, silicon bronze or copper.
- 6. Some treated wood may have excess surface chemicals making it potentially more corrosive than wood with lower retentions. If this condition is suspected, use Type-316/305/304 stainless steel, silicon bronze, or copper fasteners.
- 7. Type-316 stainless-steel, silicon bronze, and copper fasteners are the best recommendation for ocean-salt air and other chloride-containing environments.

 Hot-dip galvanized fasteners with at least ASTM A153, Class C protection can also be an alternative for some applications in environments with ocean air and/or elevated wood moisture content.

Interior Dry



Exterior



Severe





Understanding the Corrosion Issue

Many environments and materials can cause corrosion, including ocean salt air, fire retardants, fumes, fertilizers, preservative-treated wood, de-icing salts, dissimilar metals and more. Metal connectors, fasteners and anchors could corrode and lose load-carrying capacity when installed in corrosive environments or when installed in contact with corrosive materials.

The many variables present in a building environment make it impossible to accurately predict if, or when, corrosion will begin or reach a critical level. This relative uncertainty makes it crucial that specifiers and users are knowledgeable of the potential risks and select a product suitable for the intended use. It is also prudent that regular maintenance and periodic inspections are performed, especially for outdoor applications.

It is common to see some corrosion in outdoor applications. Even stainless steel can corrode. The presence of some corrosion does not mean that load capacity has been affected or that failure is imminent. If significant corrosion is apparent or suspected, then the framing members, fasteners and connectors should be inspected by a qualified engineer or qualified inspector. Replacement of affected components may be appropriate.

Some wood-preservative chemicals and fire-retardant chemicals and retentions pose increased corrosion potential and are more corrosive to steel connectors and fasteners than others. Testing by Simpson Strong-Tie has shown that ACQ-Type D is more corrosive than Copper Azole Type C, Micronized Copper Azole and CCA-C. At the same time, others have shown that the inorganic boron treatment chemicals, specifically SBX-DOT, are less corrosive than CCA-C.

Due to the many different chemical treatment formulations, chemical retention levels, moisture conditions and regional formulation variants, selection of fasteners has become a complex task. We have attempted to provide basic knowledge on the subject here, but it is important to fully educate yourself by reviewing our technical bulletins on the topic (www.strongtie.com/info) and also by reviewing information, literature and evaluation reports published by others.

Treatment Use Categories and Exposure Conditions

The American Wood Protection Association (AWPA) identifies 12 Use Category designations (UC) for wood treatment chemicals that are based on protection of the wood material; the Use Categories are based on service conditions and environments and agents of deterioration. At the same time, the building codes require specific corrosion resistance for connectors and fasteners that are in contact with chemically treated wood, and the corrosion resistance is independent of the service environments and treatments that are the basis of the AWPA Use Categories. From the building code perspective, fastener corrosion resistance is provided by hot-dip galvanization applied following ASTM A153, Class D, or by a corrosion-resistant base metal, such as stainless steel, silicon bronze or copper, regardless of exposure. Connectors in contact with preservative-treated wood require a minimum of ASTM A653, Type G185 zinc-coated galvanized steel, or equivalent.

Some exceptions are provided in the International Code Council's (ICC) International Residential Code (IRC) for mechanical galvanization applied to screws. The International Building Code (IBC) has exceptions for plain carbon steel fasteners, nuts and washers in SBX/DOT and zinc borate preservative-treated wood in interior, dry environments.

The International Code Council - Evaluation Service (ICC-ES) implemented AC257 as a method to evaluate alternative corrosion resistance mechanisms for fasteners used in wood construction where hot-dip galvanization (ASTM A153, Class D) is used as the benchmark performance. Under AC257, fastener corrosion resistance is qualified for one or more of four exposure conditions with no salt exposure: (1) treated wood in dry service; (2) clean wood in a salt air dry-service environment; (3) treated wood in a wet-service condition with no salt exposure; and (4) general use with no limitations.



Coatings Available

Not all products are available in all finishes. Contact Simpson Strong-Tie for product availability, ordering information and lead times.

Finish/Material	Description	Level of Corrosion Resistance
Gray Paint	Water-based paint intended to protect the product while it is warehoused and in transit to the jobsite.	Low
Powder Coating	Baked-on paint finish that is more durable than our standard paint and produces a better-looking finished product.	Low
Standard G90 Zinc Coating	Zinc galvanized coating containing 0.90 oz. of zinc per square foot of surface area (total both sides).	Low
Electrocoating (E-Coat™)	Electrocoating utilizes electrical current to deposit the coating material on the fastener. After application, the coating is cured in an oven. Electrocoating provides a minimum amount of corrosion protection and is recommended for dry, non-corrosive applications only.	Low
G185	Galvanized (G185) 1.85 oz. of zinc per square foot of surface area (hot-dip galvanized per ASTM A653 total both sides). These products require hot-dip galvanized fasteners (fasteners which meet the specifications of ASTM A153).	Medium
H <mark>OTPIPD (G</mark> GALVANIZED®	Products are hot-dip galvanized after fabrication (14 ga. and thicker). The coating weight increases with material thickness. The minimum average coating weight is 2.0 oz./ft.² (per ASTM A123 total both sides). These products require hot-dip galvanized fasteners (fasteners which meet the specifications of ASTM A153). Anchor bolts are hot-dip galvanized per ASTM F2329.	Medium
Type-410 Stainless Steel with Protective Top Coat	Carbon martensitic grade of stainless steel which is inherently magnetic, with an added protective top coat. This material can be used in mild atmospheres and many mild chemical environments.	Medium
Mechanically Galvanized Coating, Class 55	Simpson Strong-Tie® Strong-Drive® SD Connector screws are manufactured with a mechanically applied zinc coating in accordance with ASTM B695, Class 55 with a supplemental overcoat. These fasteners are compatible with painted and zinc-coated (G90 and ZMAX) connectors.	Medium
Double-Barrier Coating	Simpson Strong-Tie Strong-Drive SDS Heavy-Duty Connector screws are manufactured with two different finishes that together provide a level of corrosion protection that equals that provided by the previous HDG coating.	Medium
STAINLESS STEEL®	Connectors are manufactured from Type-316L stainless steel and provide greater durability against corrosion. Stainless-steel nails are required with stainless-steel products, and are available from Simpson Strong-Tie.	High/Severe
HOTPIPD (G GALVANIZED* ASTM A153, Class C	Simpson Strong-Tie Strong-Drive Timber-Hex screws are hot-dip galvanized in accordance with ASTM A153, Class C. Hot-dip galvanized fasteners have a minimum average of 1.25 oz./ft.² of zinc coating. Hot-dip galvanized fasteners are compliant with the 2006 and 2012 International Residential Code (R319.3) and the 2006 International Building Code.	High/Severe

See Corrosion Information for more specific performance and application information on these finishes.

Using This Guide




The High Wind-Resistant Construction Application Guide was created to assist Designers with selecting the most appropriate connectors for challenging, high-wind regions. This guide uses technical data from the Wood Construction Connectors catalog to offer design solutions as well as installation details that create a load path resistant to increased uplift and lateral forces common to high-wind regions.

These solutions and details are organized by framing condition rather than by metal connector group, and products are listed in order of increasing capacity. Unique to this guide are condition-specific installation details; details showing multiple metal connectors in a single connection; and connectors used in nontraditional applications to satisfy challenging design conditions.

This edition of the High Wind-Resistant Construction Application Guide includes navigational features to help reference individual illustrations. These detail illustrations are in numerical order to help you more quickly locate the optimal connection for your application scenario.

Using the Tables

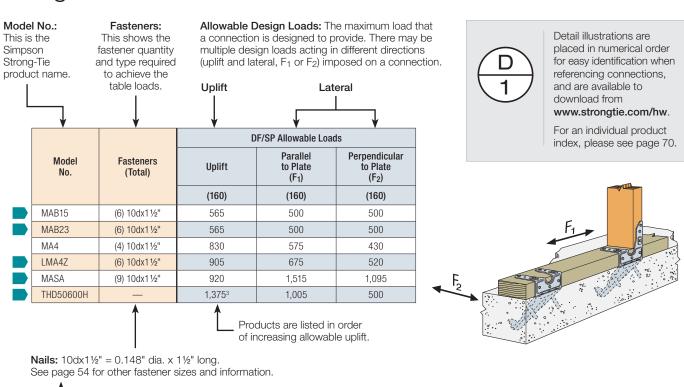

Icon Legend



Extra Corrosion Protection

set forth in this guide.

All installations should be designed only in accordance with the allowable load values



These icons identify products that are available with additional corrosion protection (ZMAX®, hot-dip galvanized, stainless steel or doublebarrier coating). Other products may also be available with additional protection; contact Simpson Strong-Tie for options. The end of the product name will indicate what type of extra corrosion protection is provided (Z = ZMAX, HDG = hot-dip galvanized, SS = stainless steel). See pages 9-12 for information on corrosion, and visit our website www.strongtie.com/info for more technical information on this topic.

Strong-Drive® SD Connector Screw Compatible


This icon identifies products approved for installation with the Simpson Strong-Tie® Strong-Drive® SD Connector screw. Products installed with SD Connector screws may achieve higher load capacity. See page 56 or visit www.strongtie.com/sd for more information.

The Forces You Face

Uplift Load Path

Uplift refers to the forces which can lift a structure. The forces are generated when high winds blow over the top of the structure, creating suction that can lift the roof. These uplift forces must be transferred down to the foundation to prevent damage. Several connections are required to create a continuous load path.

Although homes are built from the bottom up, they are designed from the top down. Product and load selection for the roof, for example, will affect the products and loads for the rest of the house. The tables in this application guide also begin at the top of the structure and continue to the foundation. A series of connectors in this guide must be used to complete the uplift and lateral load paths.

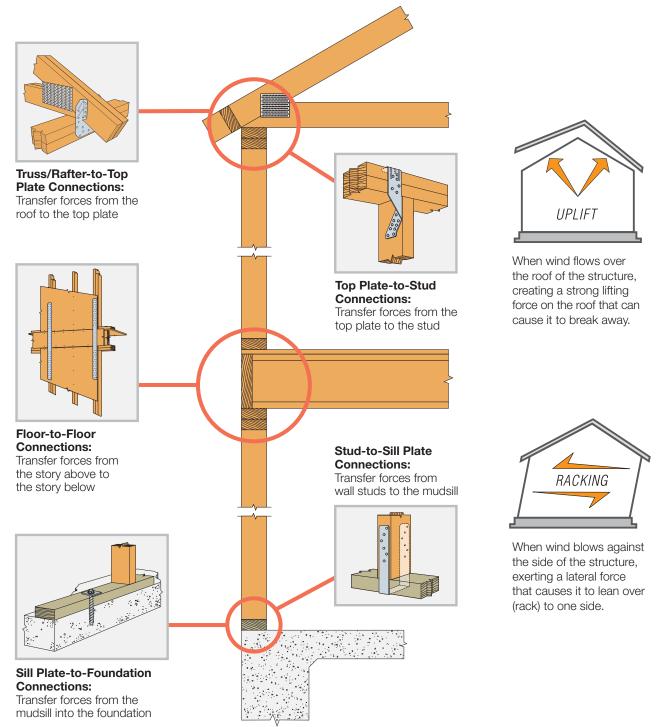




Lateral Load Path

Wind not only affects a structure with uplift forces, it also imposes shear forces that can make a structure rack, slide, or overturn. Additional steps must be taken to resist these loads and ensure that the structure will remain strong. This is done by adding bracing, connectors and shearwalls.

Large openings along wall lines (such as windows and doors) create structural challenges in resisting these lateral loads. This is especially true at garage fronts. Such openings often do not leave a large enough wall section to provide sufficient strength. These applications will require the use of prefabricated panels to meet the load requirements.

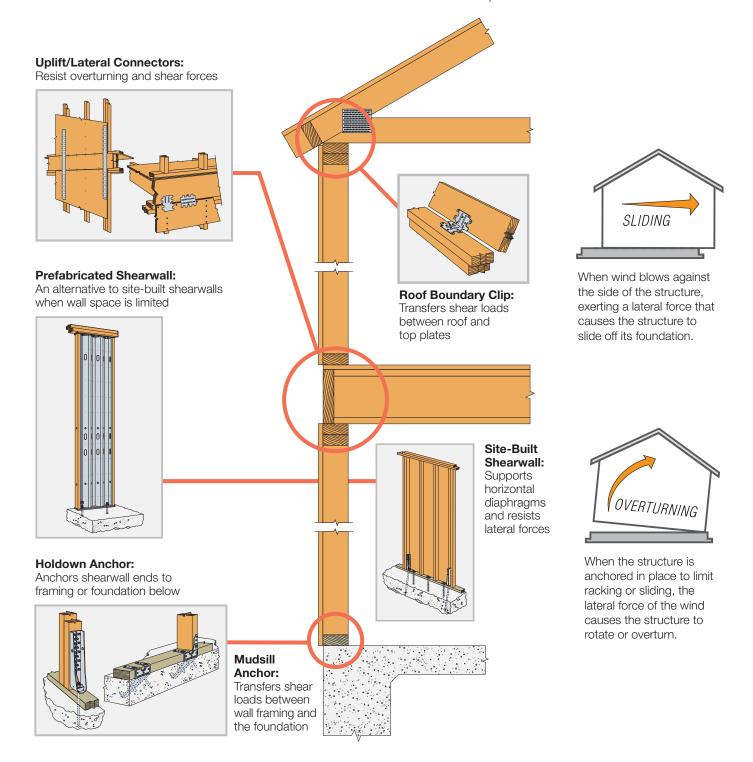


Truss/Rafter to Wood Double Top Plates



			Fasteners	s (Total)	DF/SI	Allowable	Loads	SPF Allowable Loads			
	Model No.	Qty. Rea.10	То	То	Uplift	Parallel to	Perp. to	Uplift	Parallel to	Perp. to	
	NU.	ney.	Truss/Rafter	Plates	(160)	Plate (F ₁) (160)	Plate (F ₂) (160)	(160)	Plate (F ₁) (160)	Plate (F ₂) (160)	
	H2.5T	1	(5) 8dx1 ½"	(5) 8dx1 ½"	425	135	145	425	135	145	
SS	H2.5ASS ¹¹	1	(5) SS8d	(5) SS8d	440	75	70	380	75	70	
SS	H5	1	(4) 8dx11/2"	(4) 8dx1 1/2"	455	115	200	265	100	170	
SS	H5	1	(4) 8d	(4) 8d	465	115	200	265	100	170	
	H2.5T	1	(5) 8d	(5) 8d	545	135	145	545	135	145	
	H2.5A	1	(5) 8dx1 1/2"	(5) 8dx1 1/2"	575	110	110	495	110	110	
	H1	1	(6) 8dx1 1/2"	(4) 8d	585	485	165	400	415	140	
	H2.5A	1	(5) 8d	(5) 8d	600	110	110	535	110	110	
	SDWC15600 ¹²	1	_	_	615	130	225	485	115	190	
	HGA10KT	1	(4) 1/4"x1 1/2" SDS	(4) 1/4"x3" SDS	695	1165	940	500	840	675	
	LTS12	1	(6) 10dx11/2"	(6) 10dx1 ½"	720	75	125	620	75	125	
	TSP ⁹	1	(9) 10dx11/2"	(6) 10dx11/2"	740	310	190	635	265	160	
SS	H8	1	(5) 10dx11/2"	(5) 10dx11/2"	745	75	_	565	75	_	
	H10-2	1	(6) 10d	(6) 10d	760	455	395	655	390	340	
	H11Z	1	(6) 16dx21/2"	(6) 16dx 21/2"	830	525	760	715	450	655	
	H2.5T	2	(10) 8dx11/2"	(10) 8dx1 ½"	850	270	290	850	270	290	
	H10A sloped	1	(9) 10dx11/2"	(9) 10dx1 ½"	855	590	285	760	505	285	
	TSP ⁹	1	(9) 10dx11/2"	(6) 10d	890	310	190	765	265	160	
	SDWC15600 ¹²	2	_	_	905	130	225	850	115	190	
SS	H5	2	(8) 8dx11/2"	(8) 8dx11/2"	910	230	400	530	200	340	
SS	H5	2	(8) 8d	(8) 8d	930	230	400	530	200	340	
	H10ASS ¹¹	1	(9) SSN10	(9) SSN10	970	565	170	835	485	170	
SS	MTS12	1	(7) 10dx11/2"	(7) 10dx11/2"	1,000	75 ⁵	125⁵	860	75 ⁵	125 ⁵	
	H10AR	1	(9) 10dx11/2"	(9) 10dx1 ½"	1,050	490	285	905	420	285	
	H2.5T	2	(10) 8d	(10) 8d	1,090	270	290	1,090	270	290	
	H2.5A	2	(10) 8dx11/2"	(10) 8dx11/2"	1,150	220	220	990	220	220	
	H1	2	(12) 8dx11/2"	(8) 8d	1,170	970	330	800	830	280	
	H2.5A	2	(10) 8d	(10) 8d	1,200	220	220	1,070	220	220	
	H10A-2	1	(9) 10dx3"	(9) 10dx3"	1,245	815	260	1,070	700	225	
	H10A	1	(9) 10dx11/2"	(9) 10dx1 ½"	1,140	590	285	1,015	505	285	
SS	LTS12	2	(12) 10dx11/2"	(12) 10dx1 1/2"	1,440	150 ⁵	250⁵	1,240	150	250	
	HTS20	1	(12) 10dx11/2"	(12) 10dx1 1/2"	1,450	75⁵	125 ⁵	1,245	75 ⁵	125 ⁵	
	H14	1	(12) 8dx11/2"	(13) 8d	1,465²	515	265	1,050	480	245	
	H16S	1	(2) 10dx1½"	(10) 10dx11/2"	1,470	_	_	1,265	_		
	H16	1	(2) 10dx11/2"	(10) 10dx11/2"	1,470	_	_	1,265	_	_	
SS	MTS12	2	(14) 10dx 11/2"	(14) 10dx11/2"	1,815	150 ⁵	250⁵	1,560	1505	250⁵	

- 1. For connections to single top plates, see page 25.
- 2. Douglas Fir allowable uplift loads for H14 = 1,350 lb. (160) and H10A = 1,140 lb. (160).
- 3. H16/H16-2 factory sloped to 5:12, but 3:12-7:12 roof slope
- 4. Hurricane ties are shown installed on the outside of the wall for clarity and assume a minimum overhang of 31/2". Installation on the inside of the wall is acceptable. For uplift Continuous Load Path, connections in the same area (i.e., truss to plate connector and plate to stud connector) must be on same side of the wall
- 5. When installing MTS and HTS connectors, the following installation instructions are required for the lateral loads to apply: the first 7 nail holes after the bend area must be filled with 10dx11/2" nails. This applies to straps on either side of bend area. All additional fasteners may be installed in any remaining strap holes. Twist straps do not have to be wrapped over the truss to achieve the load.
- 6. Refer to page 51 for installation details of two connectors on a single truss.
- 7. Allowable loads in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross-grain bending of the truss or rafter members.
- 8. For simultaneous loads in more than one direction, the connector must be evaluated as described in Note 6, page 8 under General Notes.
- 9. If installed on outside of wall, TSP must be installed to either a min. 2x6 top chord/rafter, or 2x4 at 9:12 pitch.
- 10. Installations using multiple connectors are limited to specific table references.
- installation angles, spacing requirements and other installation information.

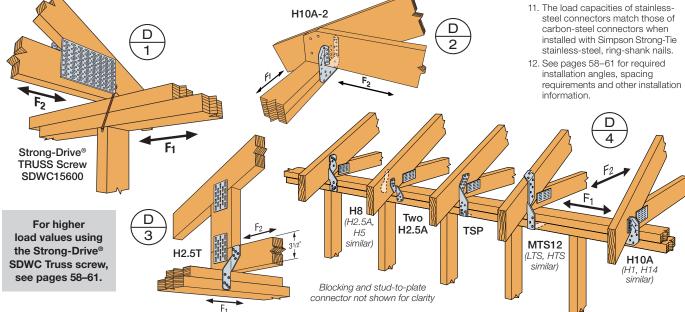

Girder/Truss to Wood Wall Framing




			No. of	Fast	eners	Allowab	le Loads
	Model No.	Qty. Req.	Plies	T 0: 1 /T	T.W. 11.5	DF/SP Uplift	SPF Uplift
			(Min.)	To Girder/Truss	To Wall Framing	(160)	(160)
	H16-2 ⁶	1	2	(2) 10dx11/2"	(10) 10dx1½"	1,470	1,265
	H16-2S ⁶	1	2	(2) 10dx11/2"	(10) 10dx1½"	1,470	1,265
	LTT20B ^{2,3,9}	1	2	(10) 10d	(1) 1/2", 5%" or 3/4" ATR	1,500	1,290
3	H2.5A	4	2	(20) 8dx11/2"	(20) 8dx11/2"	1,705	1,465
3	DTT2Z ^{2,3,11}	1	1	(8) 1/4x11/2" SDS	(1) ½" ATR	1,825	1,800
	LGT2	1	2	(16) 16d Sinkers	(14) 16d Sinkers	2,050	1,785
Γ.	THA222-21	1	2	(6) 16dx21/2"	(14) 16d	2,300	2,300
	HTT4	1	2	(12) 16dx21/2"	(1) %" ATR	2,695	2,315
	HDU2-SDS2.5 ^{2,3}	1	2	(6) 1/4"x21/2" SDS	(1) %" ATR	3,075	2,215
	HTT4 ^{2,3} 1		18	(18) 10dx11/2"	(1) %" ATR	3,610	3,105
	LGT3-SDS2.5 1		3	(12) 1/4"x3" SDS	(26) 16d Sinkers	3,685	2,655
	MGT ^{2,3} 1		2	(22) 10d	(1) 5%" ATR	3,965	3,330
	LGT4-SDS3	1	4	(16) 1/4"x3" SDS	(30) 16d Sinkers	4,060	2,925
	HTT4 ^{2,3}	1	18, 2	(18) #10x1½" SD	(1) 5%" ATR	4,455	3,830
	HTT5	1	2	(20) 16dx21/2"	(1) %" ATR	4,545	3,910
	HDU4-SDS2.5 ^{2,3}	1	2	(10) 1/4"x21/2" SDS	(1) 5%" ATR	4,565	3,285
	THA222-21	2	2	(12) 16dx21/2"	(28) 16d	4,600	4,600
,	VGT ^{2,3}	1	2	(16) 1/4"x3" SDS	(1) %" ATR	4,940	3,555
	HTT5 ^{2,3}	1	2	(26) 16dx21/2"	(1) %" ATR	5,090	4,375
	CS16	3	3	(33) 10d	(33) 10d	5,115	5,115
	HTT5KT ^{2,3}	1	2	(26) #10x21/2" SD	(1) %" ATR	5,445	5,360
	HDU5-SDS2.5 ^{2,3}	1	2	(14) 1/4"x21/2" SDS	(1) %" ATR	5,645	4,065
	HDU2-SDS2.5 ^{2,3}	2	2	(12) 1/4"x21/2" SDS	(1) %" ATR	6,150	4,430
,	VGT ^{2,3}	2	2	(32) 1/4"x3" SDS	(2) %" ATR	7,185	5,175
	HTT5 ^{2,3}	2	2	(52) 10dx1½"	(1) %" ATR	8,700	7,480
,	VGT ^{2,3}	2	3	(32) 1/4"x3" SDS	(2) %" ATR	8,890	6,400
	HGT-4 ^{2,3} 1		4	(16) 10d	(2) %" ATR	9,250	9,250
	HGT-3 ^{2,3}	1	3	(16) 10d	(2) %" ATR	10,530	9,035
	HGT-2 ^{2,3}	1	2	(16) 10d	(2) %" ATR	10,980	6,485

- Parallel to Plate-THA222-2 is 350 lbs. Perpendicular to Plate-THA222-2 is 280 lb
- 2. Rod must connect directly to foundation or to adequately sized connectors to framing below as determined by the Designer.
- 3. ATR-All-Thread Rod.
- 4. For multiple holdowns, verify the allowable tension capacity of the wood member.
- 5. Where noted, 10dx11/2" nails may be substituted for same load.
- 6. H16-2/H16-2S factory sloped to 5:12, but 3:12-7:12 roof slope is acceptable.
- LGT4-Uplift for DF/SP girder and SPF studs is 3.860 lbs.
- 8. HTT4-Tabulated loads are based on a min. nominal 2x6 framing member.
- 9. A standard cut washer is required under anchor nut for LTT20B when using 1/2" or %" anchor bolts. No additional washer is required when using a ¾" anchor bolt.
- 10. LGT2 F₁: 700 lbs.; F₂: 170 lbs. LGT3 F₁: 795 lbs.; F₂: 410 lbs. LGT4 F₁: 2,000 lbs.; F₂: 675 lbs. MGT – F₁: 775 lbs.; F₂: 525 lbs. VGT – F₁: 1,185 lbs.; F₂: 590 lbs. LGT2 and LGT4 require 4- and 7-16d sinkers, respectively, in optional nail holes.
- 11. For stainless steel, order DTT2SS.

5

12. Installations using multiple connectors are limited to specific table references.

> H2.5A (4 places)

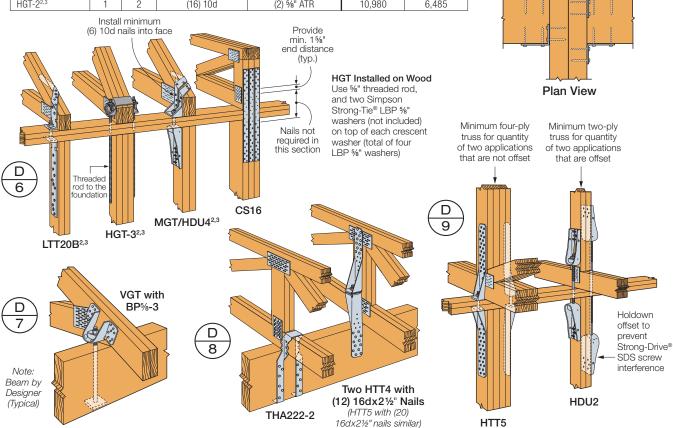


I-Joists to Wall Framing




		Fasteners			DF/SP Allowable Loa	ads	SPF Allowable Loads			
	Model	То	То	Uplift	Latera	Lateral (160)		Latera	I (160)	
	No.	Rafters	Plates	(160)	Parallel to Plate (F ₁)	Perpendicular to Plate (F ₂)	(160)	Parallel to Plate (F ₁)	Perpendicular to Plate (F ₂)	
SS	Н8	(5) 10dx1½"	(5) 10dx1½"	745	75	_	565	75	_	
SS	MTS201	(7) 10dx11/2"	(7) 10dx1½"	1,000	75	125	860	75	125	
	MTS30 ¹	(7) 10dx11/2"	(7) 10dx1½"	1,000	75	125	860	75	125	
	HTS20	(12) 10dx11/2"	(12) 10dx11/2"	1,450	75	125	1,245	75	125	
	HTS30 ¹	(12) 10dx11/2"	(12) 10dx11/2"	1,450	75	125	1,245	75	125	


- 1. Additional fastener holes are provided on these products. Not all holes are required to be filled to achieve listed loads.
- 2. Consult I-joist manufacturer for blocking details and uplift limits on joist end application.
- 3. Connectors may be reversed as long as the required fasteners are installed on either side of the connection.
- 4. Web stiffener required on both sides to achieve published uplift loads.
- 5. When installing MTS and HTS connectors, the following installation instructions are required for the lateral loads to apply. The first 7 nail holes after the bend area must be filled with 10dx11½" nails. This
- applies to straps on either side of bend area. All additional fasteners may be installed in any remaining strap holes.
- 6. Allowable loads in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter
- 7. For simultaneous loads in more than one direction, the connector must be evaluated as described in Note 6, page 8 under General Notes.
- 8. MTS and HTS may be ordered with a reversed bend configuration; add (-REV) suffix to model number(s).




MTS Installation As an I-Joist to Top Plate Tie




Typical H8 Installation . (I-Joist to Top Plate)





MTS30 to Studwall Installation




MTS30 to Studwall Installation

I-Joists to Masonry/Concrete




	Fa	steners	DF/SP Allowable Loads				
Model			Uplift	Lateral			
No.	To I-Joist	To Grouted CMU or Bond Beam	(160)	Parallel to Plate (F ₁)	Perpendicular to Plate (F ₂)		
MTSM16	(7) 10dx1½"	(4) 1/4"x21/4" Titen5	875	1204	904		
MTSM20	(7) 10dx1½"	(4) 1/4"x21/4" Titen5	875	120 ⁴	904		
HTSM16	(8) 10dx1½"	(4) 1/4"x21/4" Titen5	1,175	120 ⁴	904		
HTSM20	(10) 10dx11/2"	(4) 1/4"x21/4" Titen5	1,175	1204	904		
META20	(7) 10dx1½"	Embed 4"	1,450	340	725		
HETA20	(9) 10dx1½"	Embed 4"	1,810	340	725		
HETA40	(9) 10dx11/2"	Embed 4"	1,810	340	725		

- - 1. Additional fastener holes are provided on these products. Not all holes are required to be filled to achieve listed loads.
 - 2. Consult I-joist manufacturer for blocking details and uplift limits on joist end application.
 - 3. Web stiffener required on both side to achieve published
 - 4. When installing MTSM and HTSM connectors, the following installation instructions are required for lateral loads to apply:
 - a) The first 4 holes for Titen® screws after the bend area must be filled on the concrete/masonry end of the connection.
- b) The first 7 nail holes after the bend area must be filled with 10dx11/2" nails on the wood end of the connection. Any additional required nails may be placed in any open hole on the wood end of the strap.
- 5. Use 1/4"x13/4" Titen® screws for concrete application.
- 6. Allowable loads in the F_1 direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members.
- 7. For simultaneous loads in more than one direction, the connector must be evaluated as described in Note 6, page 8 under General Notes.

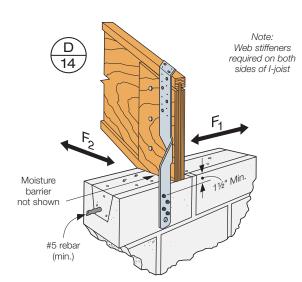

MTSM20 Fastened Directly to CMU, Bond Beam or Concrete Tie Beam

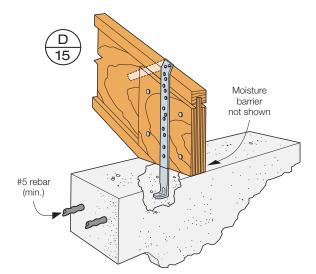

META/HETA Installation into CMU, Bond Beam or Concrete Tie Beam

Embedded Truss/Rafter to Masonry/Concrete



Straps may be

installed straight or

wrapped over truss

Straps may be installed

straight or wrapped over to achieve listed loads

META20/


TSS

				SP Uplift On	e-Ply Truss ⁴	SP Uplift Two- or	Three-Ply Truss	SP Late	ral Load
	Model No.	Qty. Req.	Application	Fasteners to Truss/Rafter (Total)	(160)	Fasteners to Truss/Rafter (Total)	(160)	Parallel to Plate (F ₁)	Perpendicular to Plate (F ₂)
	HETAL12 ⁷	1	Block/Concrete	(10) 10dx1½"	1,040	(10) 16d	1,235	415	1,100
(META20 Only)	META12, META16, META18,META20, META22,META24, META40	1	Block/Concrete	(8) 10dx1½"	1,450	(6) 16d	1,450	340	795
	HETA12	1	Block/Concrete	(7) 10dx1½"	1,455	(7) 16d	1,730	340	795
(HETA20 Only)	HETA16, HETA20, HETA24, HETA40	1	Block/Concrete	(9) 10dx1½"	1,810	(8) 16d	1,810	340	795
(HETAL20 Only)	HETAL16 ⁷ HETAL20 ⁷	1	Block/Concrete	(14) 10dx1½"	1,810	(13) 16d	1,810	415	1,100
	HHETA16, HHETA20, HHETA24, HHETA40	1	Block/Concrete	(10) 10dx1½"	2,235	(9) 16d	2,235	340 ⁹	795
	META12, META16, META18, META20,	2 ¹²	Block	(10) 10dx1½" ¹²	1,985	(14) 16d ¹³	1,900	1.350	1.160
(META20 Only)	META22,META24, META40		Concrete	(10) 10dx1½" ¹²	1,985	(14) 16d ¹³	2,575	1,550	1,100
SS	HETA12, HETA16, HETA20, HETA24,	2 ¹²	Block	(10) 10dx1½" ¹²	2,035	(12) 16d ¹³	2,500	1,350	1,520
(HETA20 Only)	HETA40	2	Concrete	(10) 10dx1½" ¹²	2,035	(12) 16d ¹³	2,700	1,550	1,020
	HHETA12, HHETA16,	012	Block	(10) 10dx1½" ¹²	2,035	(12) 16d ¹³	2,500	1.050	1.500
	HHETA20, HHETA40	212	Concrete	(10) 10dx1½" ¹²	2,035	(14) 16d ¹³	3,350	1,350	1,520
	DETAL 20 ¹⁰	1	Block	(18) 10dx1½"	2,480	_	_	2,000	1,370
	DETALZU"	1	Concrete	(18) 10dx1½"	2,480	_	_	2,000	1,505

- 1. For SPF trusses multiply table loads by 0.78 for uplift and F2 directions (use F1 values as shown).
- 2. Unless noted otherwise, embedment is into either grout filled block (f'm = 1,500 psi) or concrete (minimum f'_C is 2,000 psi for single strap installations and 2,500 psi for double strap installations).
- 3. Minimum edge distance for HETA/META is 11/2" for concrete and 2" for masonry.
- 4. Single-ply trusses may use either 10dx11/2" or 16d nails with allowable loads as noted in table. Two- or three-ply trusses shall use 16d nails.
- 5. For simultaneous loads in more than one direction, the connector must be evaluated as described in Note 6, page 8 under General Notes.
- 6. Allowable loads in the F_1 direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members.
- The HETAL requires 5 nails to be installed into the truss seat.
- 8 Parallel-to-wall load towards face of HETAL is 1.975 lb.
- 9. The HHETA allowable F₁ load can be increased to 435 lb. if the strap is wrapped over the truss and a minimum of 12 nails are installed.
- 10. The DETAL20 requires 6 nails installed in the truss seat and 6 nails in each strap.
- 11. Double META, HETA, and HHETA are spaced at 1%" for single-ply and 31/8" for two-ply and staggered as shown. Install with spoons facing outward.
- 12. Where noted, for double anchors install half of the required number of fasteners in each strap.
- 13. Two HHETA anchors may be installed in a concrete tie beam on a two- or three-ply truss with 2 fewer nails for an allowable uplift load of 3,050 lb.
- 14. Double embedded anchor lateral loads apply only to two- or three-ply applications with anchors spaced a minimum of 3" apart. For single-ply applications use lateral loads from the Single Embedded Anchor Installation.
- 15. It is acceptable to use a reduced number of fasteners provided that there is a reduction in uplift load capacity. Lateral loads do not apply when fewer than 7 fasteners are used with the HETA and HHETA anchors or when fewer than (6) 16d or (7) 10dx11/2" fasteners are used with the META anchor. HETAL lateral loads do not apply when fewer than 5 fasteners are installed in strap – 5 fasteners required in the truss seat. DETAL lateral loads do not apply when fewer than 5 fasteners are installed in each strap - 6 fasteners required in the truss seat. Calculate the connector uplift value for a reduced number of fasteners as follows:

Allowable Load = No. of Nails Used x Table Load No. of Nails in Table

Example: META20 in SP with (6) 10dx11/2" nails total (160) $\frac{6 \text{ Nails (Used)}}{7 \text{ Nails (Table)}} \times 1,450 \text{ lbs.} = 1,240 \text{ lb.}$ Allowable Load =



#5 rebar

16

#5 rebar

Blocking not

shown for clarity

HETA20


Post-Installed Truss/Rafter to Masonry/Concrete



			Uplift One-	Ply Truss	Uplift Two-l	Ply Truss	Lateral	Load
Model	Qty.	Fasteners	Fasteners to	DF/SP Uplift	Fasteners to	DF/SP Uplift	Parallel	Perpendicular
No.	Req.	to Masonry	Truss/Rafter (Total)	(160)	Truss/Rafter (Total)	(160)	to Plate (F ₁)	to Plate (F ₂)
HM9KT	1	(5) 1/4"x21/4" Titen4	(4) 1/4"x11/2" SDS	595	N/A	N/A	425	200
HGAM10KTA	1	(4) 1/4"x21/4" Titen4	(4) 1/4"x11/2" SDS	850	N/A	N/A	1,005	1,105
MTSM16, MTSM20	1	(4) 1/4"x21/4" Titen4	(7) 10dx1½"	860	(7) 10d	860	200 ⁶	90 ⁶
H10S	1	(2) %"x4" Titen HD	(8) 8dx11/2"	1,065	N/A	N/A	_	_
HTSM16, HTSM20	1	(4) 1/4"x21/4" Titen4	(8) 10dx11/2"	1,175	(8) 10d	1,175	200 ⁶	90 ^e
LTT20B ²	1	(1) ½", 5%", ¾" ATR ¹¹	(10) 10dx11/2"	1,355	(10) 16d	1,500	_	_
H16 ⁵	1	(6) 1/4"x21/4" Titen4	(2) 10dx11/2"	1,470	N/A	N/A	_	_
H16-2 ⁵	1	(6) 1/4"x21/4" Titen4	N/A	N/A	(2) 10dx11/2"	1,470	_	_
MTSM16, MTSM20	2	(8) 1/4"x21/4" Titen4	(14) 10dx11/2"	1,650 ¹²	(14) 10d	1,65012	235 ⁶	205 ⁶
HTSM16, HTSM20	2	(8) 1/4"x21/4" Titen4	(16) 10dx11/2"	1,90012	(16) 10d	1,90012	235 ⁶	205 ⁶
DTT2Z ^{13,14}	1	(1) ½" ATR	(8) 1/4"x11/2" SDS	1,825	(8) 1/4"x11/2" SDS	2,145	_	_
LGT2 ³	1	(7) 1/4"x21/4" Titen4	(16) 16d Sinkers ³	2,150	(16) 16d Sinkers	2,150	700	170
FGTR ^{7,8,9,10}	1	(2) 1/2"x5" Titen HD	(18) 1/4"x3" SDS ³	5,000	(18) 1/4"x3" SDS	5,000	_	_



- 1. For SPF trusses multiply table uplift and F2 loads by 0.86 for nailed applications and 0.72 for Simpson Strong-Tie® Strong-Drive® SDS Heavy-Duty Connector screws for uplift and F2 directions (use F1 values as shown). Higher loads may be possible (contact Simpson Strong-Tie).
- 2. Add a standard cut washer to seat of LTT20B when 1/2" or 5/8" diameter anchor bolt is used.
- 3. Product may be used for a single-ply truss provided the truss is blocked to receive 3" Simpson Strong-Tie Strong-Drive SDS Heavy-Duty Connector screws or 16d sinkers and blocking is attached to the truss to act as a
- 4. For concrete applications, use 1/4"x13/4" Titen® screws.
- 5. H16/H16-2 factory sloped to 5:12, but 3:12-7:12 roof slope is acceptable.
- 6. When installing MTSM and HTSM connectors, the following installation instructions are required for lateral loads to apply:
 - a) The first 4 holes for Titen screws after the bend area must be filled on the concrete/masonry end of the connection.
 - b) The first 7 nail holes after the bend area must be filled with 10dx11/2" nails on the wood end of the connection. Any additional required nails may be placed in any open hole on the wood end of the strap.
- 7. To achieve the published loads, the FGTR must be attached to a grouted and reinforced block wall or reinforced concrete wall designed by others to transfer the uplift loads to the foundation.
- a wall will have an allowable load of 4,685 lb. FGTR is packaged with Simpson Strong-Tie Strong-Drive SDS Heavy-Duty Connector screws and Titen HD® anchors.
- 10. FGTR can be installed on roof pitches up to 8:12 or on a bottom chord designed to transfer the loads.




TITEN® SCREW WARNING:

Industry studies show that hardened fasteners can experience performance problems in wet or corrosive environments. Accordingly, use this product in dry and noncorrosive environments only, provide moisture barrier, or use a stainless-steel fastener. Steps must be taken to prevent inadvertent sustained loads above the listed allowable loads. Overtightening and bending moments can initiate cracks detrimental to the hardened screw's performance. Use the Simpson Strong-Tie® Titen® installation tool kit (Part TTNT01); it has a bit that is designed

to reduce the potential for

overtightening the screw.

- 11. ATR-All-Thread Rod or Anchor Bolt.
- 12. MTSM/HTSM connectors shall be installed on opposite faces of masonry/ concrete to achieve loads listed for two connectors. If installed on same face of masonry/concrete, maximum uplift is 1,340 lbs.
- For stainless steel, order DTT2SS.
- 14. DTT2 is 615/6" tall. Truss heel height or rafter vertical depth must accommodate.

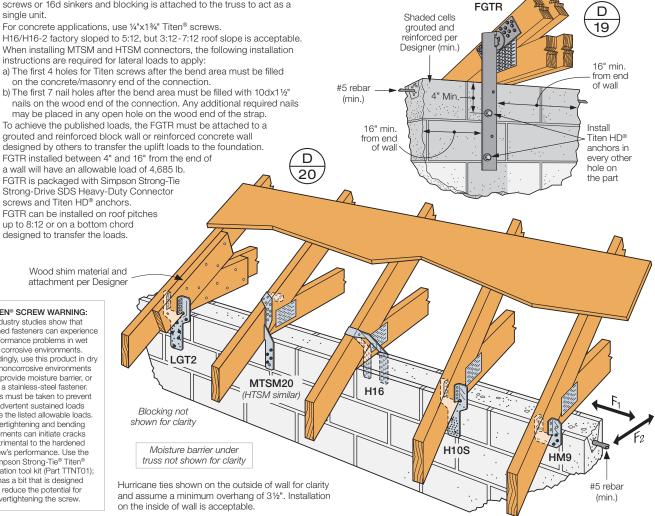

Girder/Truss to Masonry/Concrete




	Model	Qty.	No. of	Fast	eners	DF/SP Uplift	SPF Uplift
	No.	Req.3	Plies	To Girder/Truss	To Masonry/Concrete	(160)	(160)
	LTA2 Parallel to Wall Installation	1	1	(10) 10dx1½"	Embedded	1,390 ¹³	1,015
	LTA2 Perpendicular to Wall Installation	1	1	(10) 10dx1½"	Embedded	1,425 ¹³	1,015
	H16-2 ¹²	1	2	(2) 10dx11/2"	(6) 1/4"x21/4" Titen7	1,470	1,265
3	DTT2Z	1	1	(8) 1/4"x11/2" SDS	(1) 1/2" ATR	1,825	1,800
€[DTT2Z	1	2	(8) 1/4"x11/2" SDS	(1) 1/2" ATR	2,145	1,835
	LGT2	1	2	(14) 16d Sinkers	(7) 1/4"x21/4" Titen7	2,150	1,850
	THA222-2	1	2	(6) 16dx2½	(14) 3/16"x21/4" Titen7	2,150	1,850
	VGT L/R	1	2	(16) 1/4"x3" SDS	(1) %" ATR	2,230	1,605
	PA28 ⁵	1	2	(20) 16d	Embed 4"	2,765	2,765
	HDU2-SDS2.5	1	2	(6) 1/4"x21/2" SDS	(1) %" ATR	3,075	2,215
	LGT3-SDS2.5	1	3	(12) 1/4"x21/2" SDS	(4) %"x5" Titen HD	3,285	2,365
Ì	LGT4-SDS3	1	4	(16) 1/4"x21/2" SDS	(4) %"x5" Titen HD	3,285	2,365
	HTT4	1	2	(18) 10dx11/2"	(1) 5/8" ATR	3,610	3,105
_	MGT	1	2	(22) 10d	(1) 5/8" ATR	3,965	3,330
	HTT4	1	2	(18) 16dx2½"	(1) 5%" ATR	4,235	3,640
	HTT5	1	2	(26) 10dx11/2"	(1) %" ATR	4,350	3,740
	HDU4-SDS2.5	1	2	(10) 1/4"x21/2" SDS	(1) 5/8" ATR	4,565	3,285
	HTT5	1	2	(26) 10d	(1) 5/8" ATR	4,670	4,015
_	VGT ¹¹	1	2	(16) 1/4"x3" SDS	(1) %" ATR	4,940	3,555
Ì	FGTR ^{8,9,10,11}	1	2	(18) 1/4"x3" SDS	(2) 1/2"x5" Titen HD	5,000	4,300
	HTT5	1	2	(26) 16dx2½"	(1) 5%" ATR	5,090	4,375
	HPA35⁵	1	2	(27) 16d	Embed 81/4"	5,145	4,525
İ	VGT L/R ¹¹	2	2	(32) 1/4"x3" SDS	(2) %" ATR	5,545	3,990
	HDU5-SDS2.5	1	2	(14) 1/4"x21/2" SDS	(1) %" ATR	5,645	4,065
	HDU2-SDS2.5	2	2	(12) 1/4"x21/2" SDS	(2) 5/8" ATR	6,150	4,430
	VGT ¹¹	2	2	(32) 1/4"x3" SDS	(2) 5/8" ATR	7,185	5,175
D	HDQ8-SDS3	1	2	(20) 1/4"x3" SDS	(1) 7/8" ATR	8,325	7,210
	HTT5	2	2	(52) 10dx11/2"	(2) 5/8" ATR	8,700	7,480
-	VGT ¹¹	2	3	(32) 1/4"x3" SDS	(2) 5/8" ATR	8,890	6,400
	HGT-4 1 4 (16) 10d (2) ¾" ATR		9,250	9,250			
	FGTR ^{8,9,10,11} 2 2 (36) ½"x3" SDS (4) ½"x5" Titen HD		9,400	8,080			
	HGT-3	HGT-3 1 3 (16) 10d (2) 3/4" ATR		10,530	9,035		
Ì	HGT-2	HGT-2 1 2 (16) 10d (2) 3/4" ATR		10,980	6,485		
	HDU5-SDS2.5	2	2	(28) 1/4"x21/2" SDS	(2) 5/8" ATR	11,290	8,130

- 1. Holdown load values are based on a 3" thick vertical member. See the current Simpson Strong-Tie® Wood Construction Connectors catalog for load values based on different wood thicknesses. Wood member design by Specifier.
- 2. The Designer must specify anchor type, length and embedment.
- 3. The Designer must evaluate multiple installations not listed.
- 4. ATR-All-Thread Rod or Anchor Bolt.
- 5. PA28 and HPA35 must be embedded in center of a concrete tie beam (minimum width = 7%").
- Multiple HDUs and HTTs must be installed staggered on truss.
- For concrete applications use 1/4"x13/4" Titen® screws. 8. To achieve the published loads, the FGTR must be attached to a grouted and reinforced block concrete wall designed by others to transfer the uplift loads to the foundation.
- 9. FGTR is packaged with Simpson Strong-Tie® Strong-Drive® SDS Heavy-Duty Connector screws and Titen HD® anchors.
- 10. Screw holes on FGTR and VGT are configured to allow for a double installation on a two-ply truss.
- 11. To achieve the loads listed for the MGT, HGT and VGT single and double connector options, anchor into a 8" wide concrete tie-beam or grouted and reinforced CMU tie-beam can be made using Simpson Strong-Tie® SET epoxy anchoring adhesive with a minimum embedment depth of 12", a minimum end distance of 12" and centered in the 8" member. Vertical reinforcement may be required to transfer the loads per Designer.
- 12. H16-2 factory sloped to 5:12, but 3:12-7:12 roof slope is acceptable.
- 13. LTA2 uplift is 1,210 lb. for DF.

Shaded cells grouted and reinforced

14. THDRC listed for use with 8" concrete tie beam, 1¾" edge, 8" end distance, uncracked concrete with no supplementary reinforcement and 2,500 psi concrete minimum. Designer shall specify adhesive anchor for CMU bond beam.

> Two **FGTRs**

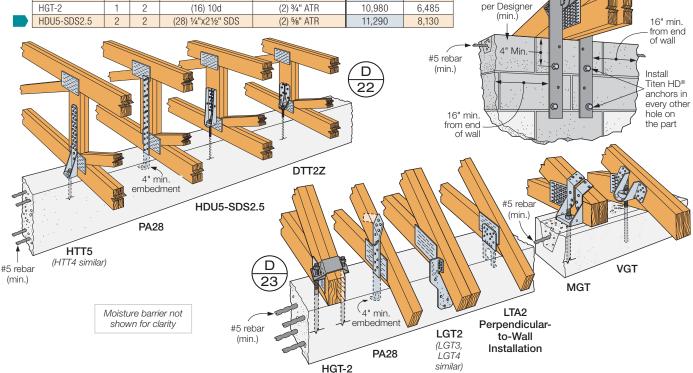


Truss/Rafter Hip to Wall



			Fast	eners	DF/SP Allov	vable Loads	SPF Allowable Loads		
	Model No.	Member Size	То	To Wall	(16	60)	(160)		
		0.20	Truss/Rafter	russ/Rafter		F ₁	Uplift	F ₁	
	TJC37 (1-85°)	2x4 min.	(6) 8dx1½"	(6) 8dx1½"	425 ⁷	_	365 ⁷	_	
	TJC57 (1-85°)	2x6 min.	(12) 8dx11/2"	(12) 8dx11/2"	830 ⁷		715 ⁷	_	
SS	HCP2 ¹	2x	(6) 10dx1½"	(6) 10dx11/2"	645	300	555	260	
SS	HCP1.81 ¹	13/4	(6) 10dx1½"	(6) 10dx11/2"	605	300	520	260	
SS	MTS12	2x	(7) 10dx1½"	(7) 10dx1½"	840	_	730	_	
	MTSM16	2x	(7) 10dx1½"	(4) 1/4"x21/4" Titen3	840	_	730	_	
SS	HCP4	4x	(8) 10d	(8) 10d	1,000	265	860	230	
SS	HTS16	2x	(8) 10dx1½"	(8) 10dx11/2"	1,105		950	_	
	HTSM16	2x	(8) 10dx11/2"	(4) 1/4"x21/4" Titen3	1,105		950	_	
	FGTRH L/R ^{5,6}	(2) 2x	(18) 1/4"x3" SDS	(2) 1/2"x5" Titen HD	3,850	_	3,850	_	

- 1. The HCP can be installed on the inside and the outside of the wall with a flat bottom chord truss and achieve twice the
- 2. MTS12, HTS16, HTSM16 and MTSM16 can be field bent once to a 45° angle.
- 3. For concrete applications for the MTSM16 and HTSM16, use 1/4"x13/4" Titen® screws.
- 4. Minimum edge distance for 1/4" Titen® screw is 11/2" and
- 5. To achieve the published loads, the FGTR must be attached to a grouted and reinforced block wall or reinforced concrete wall designed by others to transfer the uplift loads to the foundation.
- 6. FGTR is packaged with Simpson Strong-Tie® Strong-Drive® SDS Heavy-Duty Connector screws and Titen HD anchors.
- 7. For alternate TJC installation angles, fasteners and load values, see the Wood Construction Connectors catalog or visit www.strongtie.com.

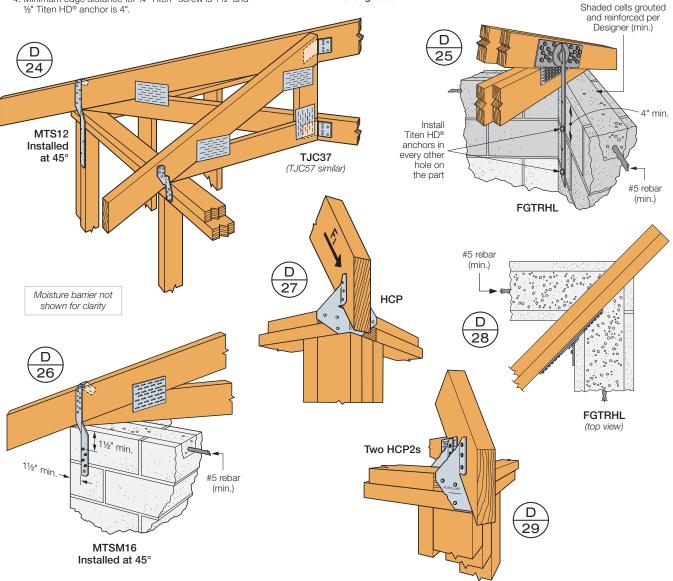


Truss/Rafter Hip to End Wall



	Member	Faste	DF/SP Allowable Loads			SPF Allowable Loads			
Model No.	Size		F ₂	Uplift	F ₁	F ₂			
	(Min.)	10 11055	10 Wali	(160)	П	Γ2	(160)	П	12
MTSM16 ^{1,3,6}	(2)2x	(7) 10d	(4) 1/4"x21/4" Titen	875	120	90	750	120	90
HTSM161,3,6	(2)2x	(8) 10d	(4) 1/4"x21/4" Titen	1,175	120	90	1,020	120	90
MSTAM24 ^{1,3}	(2) 2x	(9) 10d	(5) 1/4"x21/4" Titen	1,500	_	_	1,500	_	_
MSTAM361,3	(2)2x	(13) 10d	(8) 1/4"x21/4" Titen	1,870	_	_	1,870	_	_
MSTCM40 ^{1,3}	(2)2x	(26) 16d Sinkers	(14) 1/4"x21/4" Titen	4,220	_	_	4,220	_	_
MSTCM60 ^{1,3}	(2)2x	(26) 16d Sinkers	(14) 1/4"x21/4" Titen	4,220	_	_	4,220	_	_
FGTR ^{2,4,5}	(2)2x	(18) 1/4"x3" SDS	(2) 1/2"x5" Titen HD	4,685	_	_	4,300	_	_

- 1. Minimum edge distance for 1/4" Titen® screw is 11/2".
- 2. Minimum edge distance for 1/2" Titen HD® anchor is 4".
- 3. For concrete tie beam applications, use 1/4"x13/4" Titen screws.
- 4. To achieve the published loads, the FGTR must be attached to a grouted and reinforced block wall or reinforced concrete wall designed by others to transfer the uplift loads to the foundation.
- 5. FGTR is packaged with Simpson Strong-Tie ${\rm ^{8}}$ Strong-Drive ${\rm ^{8}}$ SDS Heavy-Duty Connector screws and Titen HD anchors.
- 6. When installing MTSM and HTSM connectors, the following installation instructions are required for lateral loads to apply:
 - a) The first 4 holes for Titen screws after the bend area must be filled on the concrete/masonry end of the connection.
 - b) The first 7 nail holes after the bend area must be filled with 10dx11/2" nails on the wood end of the connection. Any additional required nails may be placed in any open hole on the wood end of the strap.

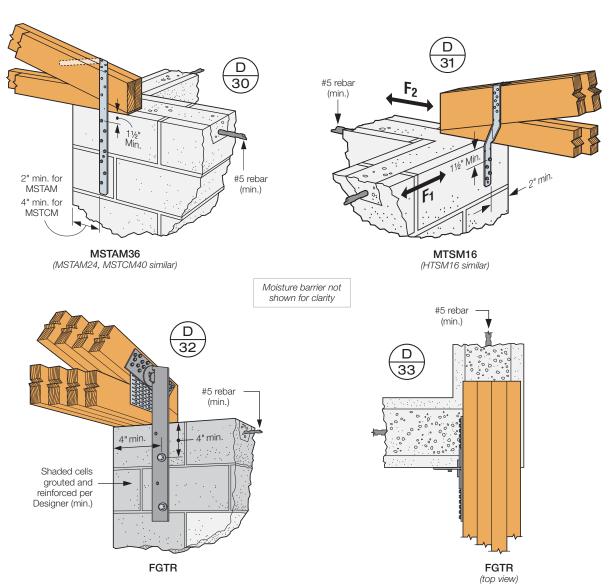


Truss/Rafter to Single Top Plate



			No.	Fast	eners	DF/S	SP Allowable Lo	oads	SPI	F Allowable Loa	ıds
	Model No.	Qty. Req.	of Plies	То	То	Uplift	Parallel to	Perp. to	Uplift	Parallel to	Perp. to
			(Min.)	Truss/Rafter	Plate	(160)	Plate (F ₁) (160)	Plate (F ₂) (160)	(160)	Plate (F ₁) (160)	Plate (F ₂) (160)
SS	H2.5ASS	1	2	(4) SS8d	(4) SS8d	285	_	_	245	_	_
SS	H4	1	2	(4) 8d	(4) 8d	360	165	160	235	140	135
	H2.5A	1	1	(4) 8dx11/2"	(4) 8dx1½"	390	_	_	335	_	_
SS	НЗ	1	2	(4) 8d	(4) 8d	455	125	160	320	105	140
	FCB43.57	1	1	(4) SD10x11/2"	(4) SD10x11/2"	655	395	670	565	395	550
	HGA10 ⁶	1	1	(4) 1/4" x 1 1/2" SDS	(4) 1/4"x11/2" SDS	605	500	720	435	360	520
SS	H4	24	2	(8) 8d	(8) 8d	720	330	320	470	280	270
	H2.5A	24	1	(8) 8dx11/2"	(8) 8dx1½"	780	1	_	630	1	_
SS	Н3	24	2	(8) 8d	(8) 8d	910	250	320	640	210	280
	META16	1	1	(7) 10dx11/2"	N/R	1,450	340	725	1,180	340	635
	META20	1	1	(7) 10dx11/2"	N/R	1,450	340	725	1,180	340	635
	H16	1	1	(2) 10dx1 ½"	(6) 1/4"x21/4" Titen1	1,470		_	1,265	1	_

- 1. H16 fastened to masonry or concrete wall below single plate. Use 1¾" Titen® screws for concrete applications.
- 2. N/R-Not required, product is embedded into concrete or CMU.
- 3. Refer to page 20 for multiple META loads.
- 4. Refer to page 51 for installation details of two connectors on a single truss.


7. Provided the structural steel is $\mbox{\%e}^{\mbox{\tiny "}}$ thick with $\mbox{F}_{\mbox{\scriptsize y}}=36$ ksi minimum, the FCB43.5 may be connected directly to steel with a minimum of (3) #12-14 self-drilling screws for full loads listed above. For uplift, that load is limited to 500 lb., but F1 and F2 loads may be full loads per table above and (4) 0.157 PDPAT powder-actuated fasteners may be installed. It is the responsibility of the Designer to select proper-length fasteners based on the installation.

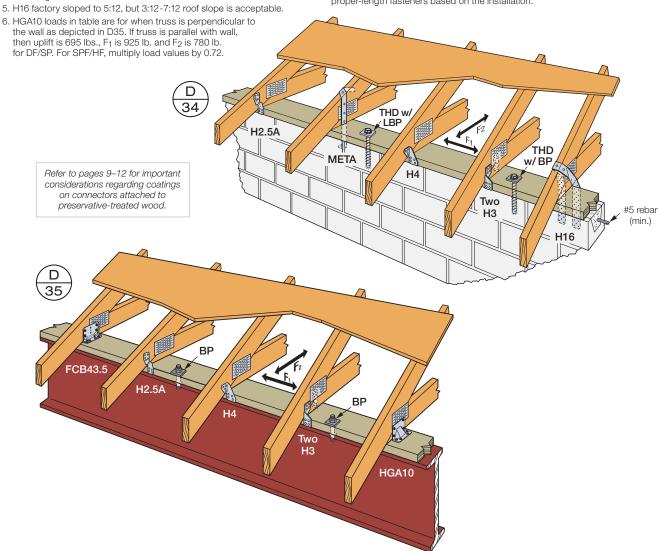

Hollow Column



Refer to technical bulletin T-COLUMN for allowable load tables and more installation information.

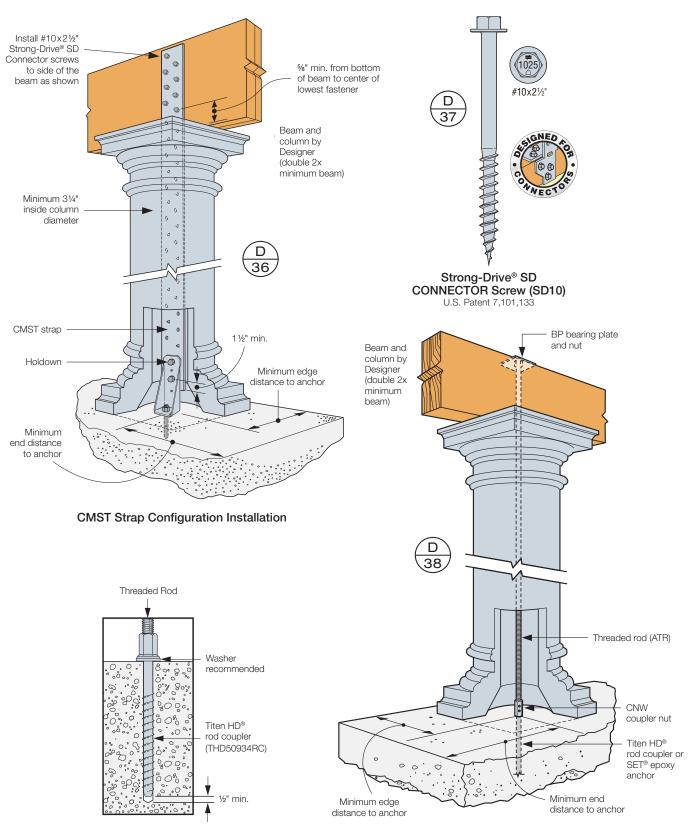


All-Thread Rod Configuration Installation


Truss/Rafter Directly to Stud



				Fasteners (Total)		DF/S	SP Allowable Lo	ads	SPF Allowable Loads		
	Model No.	Qty.	To	To	То	Uplift	Parallel to	Perp. to	Uplift	Parallel to	Perp. to
	NO.	Req.	Truss/Rafter	Stud	Plate	(160)	Plate (F ₁) (160)	Plate (F ₂) (160)	(160)	Plate (F ₁) (160)	Plate (F ₂) (160)
SS	H2ASS	1	(5) SSN8	(5) SSN8	(2) SSN8	400	130	55	345	130	55
	H2A	1	(5) 8dx1½"	(5) 8dx1 1/2"	(2) 8dx11/2"	575	130	55	495	130	55
SS	LTS12 ⁶	1	(6) 10dx1½"	(6) 10dx11/2"	_	720	75	125	620	75	125
	H7Z	1	(4) 8d	(8) 8d	(2) 8d	985	400	_	845	345	_
SS	MTS12 ⁶	1	(7) 10dx1½"	(7) 10dx11/2"	Footnote 1	1,000	300	295	860	250	250
SS	MTS20 ⁶	1	(7) 10dx1½"	(7) 10dx11/2"	Footnote 1	1,000	300	295	860	250	250
	H10S ^{2,3}	1	(8) 8dx1½"	(8) 8d	(8) 8dx11/2"	1,010	545	215	870	470	185
	H2A	2	(10) 8dx11/2"	(10) 8dx11/2"	(4) 8dx11/2"	1,150	260	110	990	260	110
SS	HTS20 ⁶	1	(12) 10dx11/2"	(12) 10dx1½"	Footnote 1	1,450	300¹	295¹	1,245	300¹	295¹
	LGT2⁵	1	(16) 16d Sinkers	(14) 16d Sinkers	Footnote 4	2,050	7004	1704	1,785	7004	1704

- 1. When installing MTS and HTS connectors, the following installation instructions are required for the lateral loads to apply. The first 7 nail holes after the bend area must be filled with 10dx11/2" nails. This applies to straps on either side of bend area. All additional fasteners may be installed in any remaining strap holes.
- 2. H10S can have the stud offset a maximum of 1" from rafter (center to center) for a reduced uplift of 890 lbs. (DF/SP) and 765 lbs. (SPF).
- 3. H10S nails to plates are optional for uplift but required for lateral loads.
- 4. $LGT2-F_1$ load = 700 lb.; F_2 load = 170 lb. with optional installation of (4) 16d sinkers optional nail holes.
- 5. LGT2—two-ply member required attached members must be designed to resist applied loads.
- 6. Twist straps do not have to be wrapped over the truss to achieve the load.
- 7. The load capacities of stainless-steel connections match those of carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, ring-shank nails.



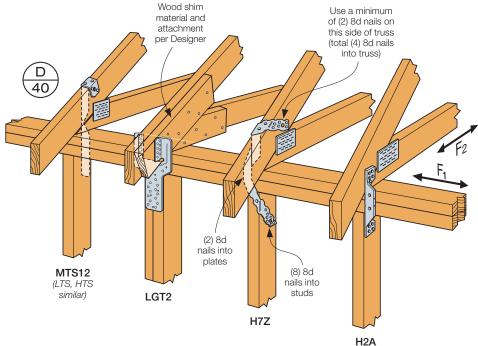


Top Plates to Stud



	Fasteners (Total)		DF/SP Allowable Loads	SPF Allowable Loads		
	Model Qty. No. Req. To Plate To Stud		Uplift	Uplift		
	110.	noq.	10 Plate	10 5100	(160)	(160)
	SSP	1	(3) 10dx1½"	(4) 10dx11/2"	350	350
SS	H2.5ASS	1	(5) SS8d	(5) SS8d	440	380
	RSP4	1	(4) 8dx11/2"	(4) 8dx11/2"	450	370
SS	H5	1	(4) 8dx11/2"	(4) 8dx11/2"	455	265
	H2.5A	1	(5) 8dx11/2"	(5) 8dx11/2"	480	480
	SDWC15600	1	Wide or narrov	v face of stud ⁸	590	510
SS	LTS12	1	(6) 10dx11/2"	(6) 10dx11/2"	720	620
SS	Н8	1	(5) 10dx11/2"	(5) 10dx11/2"	745	565
	TSP	1	(6) 10dx11/2"	(9) 10dx11/2"	755	650
	DSP	1	(6) 10dx11/2"	(8) 10dx11/2"	775	775
SS	H5 ²	2	(8) 8dx11/2"	(8) 8dx11/2"	910	530
	H2.5A ²	2	(10) 8dx11/2"	(10) 8dx11/2"	960	960
SS	MTS12	1	(7) 10dx11/2"	(7) 10dx11/2"	1,000	860
	TSP	1	(6) 10d	(9) 10dx11/2"	1,015	875
	SP2 ³	1	(6) 10d	(6) 10d	1,065	605
	SDWC15600	2	Wide face of	f stud only ⁸	1,135	980
SS	LTS12 ²	2	(12) 10dx11/2"	(12) 10dx11/2"	1,440	1,240
SS	HTS20	1	(12) 10dx11/2"	(12) 10dx11/2"	1,450	1,245
	SDWC15600	3	Wide face o	f stud only ⁸	1,700	1,470
SS	MTS12 ²	2	(14) 10dx11/2"	(14) 10dx11/2"	2,000	1,720
SS	HTS20 ²	2	(24) 10dx11/2"	(24) 10dx11/2"	2,900	2,490

1	NI/R_	.Not	required	

- 2. Where noted in table, when multiple connectors are installed on opposite sides of wall the top plate shall be loaded concentrically. See Figure D44.
- 3. For SP2, drive one stud nail at an angle through the stud into the plate. Drive two nails through the connector at an angle into the wide faces of the stud.
- 4. Use side (eccentric) load when uplift loads are applied to only one face of the top plate.
- 5. Use center (concentric) loads when uplift loads are applied at the center of the top plate, or where equal loads are applied to both sides of the top plate. Center loads may also be used for stud-tobottom-plate loads.
- 6. Maximum load for SPH in Douglas Fir is 1,360 lbs. for center loading, and 680 lb. for side loading.
- 7. SPH4 and SPH6 can be installed over nominal 1/2" sheathing with a maximum DF/SP load of 1,360 lb. for center loading. Order SPH4R or SPH6R.
- 8. See pages 58-61 for required installation angles, spacing requirements and additional installation instructions.

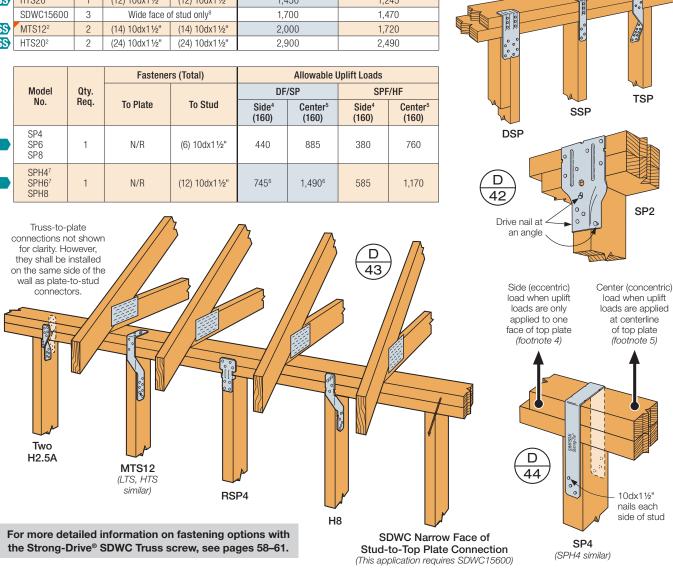


Stud to Band Joist



			Single-Ply Band	Joist (1½" Wide)			Double-Ply Ban	d Joist (3" Wide)	
	Model	DF/SP Allowab	le Uplift Loads	SPF Allowable	e Uplift Loads	DF/SP Allowab	le Uplift Loads	SPF Allowable	Uplift Loads
	No.	Fasteners (Total)	(160)	Fasteners (Total)	(160)	Fasteners (Total)	(160)	Fasteners (Total)	(160)
SS	LSTA121	(6) 10dx11/2"	555	(6) 10dx11/2"	480	(6) 10d	555	(6) 10d	480
SS	LTS16	(12) 10dx1½"	720	(12) 10dx1½"	620	(12) 10d	775	(12) 10d	665
SS	H6	(16) 8d	950	(16) 8d	820	(16) 8d	950	(16) 8d	820
SS	MTS16	(14) 10dx1½"	1,000	(14) 10dx1½"	860	(14) 10d	1,000	(14) 10d	860
	CS201	(12) 10dx1½"	1,030	(14) 10dx1½"	1,030	(12) 10d	1,030	(14) 10d	1,030
SS	LSTA18 ¹	(12) 10dx1½"	1,110	(12) 10dx1½"	955	(12) 10d	1,110	(12) 10d	955
SS	HTS20	(16) 10dx11/2"	1,150	(16) 10dx11/2"	990	(16) 10d	1,450	(16) 10d	1,245
SS	LSTA241	(14) 10dx11/2"	1,235	(16) 10dx11/2"	1,235	(14) 10d	1,235	(16) 10d	1,235
	CS18 ¹	(16) 10dx1½"	1,370	(18) 10dx1½"	1,370	(16) 10d	1,370	(18) 10d	1,370
SS	LSTA301	(16) 10dx11/2"	1,505	(16) 10dx11/2"	1,295	(16) 10d	1,505	(16) 10d	1,295
SS	CS16 ¹	(18) 10dx1½"	1,700	(20) 10dx1½"	1,630	(18) 10d	1,700	(20) 10d	1,630
	CMST141,6	(24) 10dx1½"	2,390	(24) 10dx1½"	2,065	(24) 16d	2,810	(24) 16d	2,435
	MST37 ^{1,6}	(24) 10dx1½"	2,530	(24) 10dx1½"	2,150	(24) 16d	2,950	(24) 16d	2,570
	CMST12 ^{1,6}	(24) 10dx1½"	2,630	(24) 10dx1½"	2,210	(24) 16d	3,060	(24) 16d	2,650
	MSTC28 ^{1,6}	(28) 10dx1½"	2,690	(28) 10dx1½"	2,325	(28) 16d Sinkers	2,690	(28) 16d Sinkers	2,325

- 1. Loads for stud to band joist connections are based on a minimum band joist depth of 1114".
- 2. Loads for straps based on 21/2" clear span between stud and band joist.
- 3. Multiple members must be fastened together to act as a single unit.
- 4. For straight straps, use half of the total fasteners listed on each member in the connection. Refer to the Coil Strap Calculator at www.strongtie.com/software.
- 5. Reduce loads for a single band joist less than 11/2" thick.

- 6. CMST and MST require double studs of a minimum 3" width.
- 7. Values for straps assume a minimum nail penetration of 10 nail diameters into the stud or rim joist.
- 8. Nailing over sheathing is acceptable as long as 10 nail diameters' minimum penetration into the framing is maintained. See page 54.
- 9. Where possible cross-grain tension occurs in detail D45, consider full-length adjacent connectors or EWP rim designed to resist cross-grain tension loads. Refer to D136 on page 53.

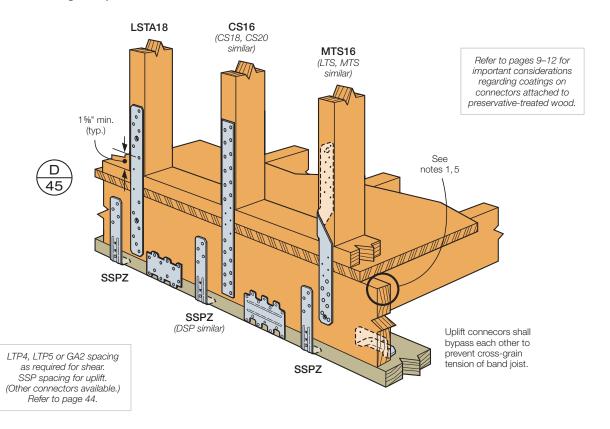

Stud to Stud




			DF/SP Allowab	le Loads	SPF Allowabl	e Loads
	Model No.	Qty. Req.	Fasteners	Uplift	Fasteners	Uplift
			(Total)	(160)	(Total)	(160)
	CS20 ²	1	(14) 8d	1,030	(16) 8d	1,030
	LSTA36 ²	1	(14) 10d	1,315	(14) 10d	1,135
SS	MSTA36 ²	1	(14) 10d	1,345	(14) 10d	1,160
	CS18 ²	1	(18) 8d	1,370	(22) 8d	1,370
SS	CS16 ²	1	(22) 8d	1,705	(26) 8d	1,705
	MSTA49 ²	1	(26) 10d	2,020	(26) 10d	2,020
SS	DTT2Z ⁶	2	(16) 1/4"x11/2" SDS	1,825	(16) 1/4"x11/2" SDS	1,800
	DTT2Z-SDS2.5 ³	2	(16) 1/4"x21/2" SDS	2,145	(16) 1/4"x21/2" SDS	2,105
	MSTC40 ²	1	(28) 16d Sinkers	2,695	(28) 16d Sinkers	2,320
	HDU2-SDS2.5 ³	2	(12) 1/4"x21/2" SDS	3,075	(12) 1/4"x21/2" SDS	2,215
	HDU4-SDS2.5 ³	2	(20) 1/4"x21/2" SDS	4,565	(20) 1/4"x21/2" SDS	3,285
	HDU5-SDS2.5 ³	2	(28) 1/4"x21/2" SDS	5,645	(28) 1/4"x21/2" SDS	4,065
	MSTC66 ²	1	(64) 16d Sinkers	5,860	(64) 16d Sinkers	5,495
	CMST14 ²	1	(56) 16d	6,490	(66) 16d	6,490
	CMST12 ²	1	(74) 16d	9,215	(84) 16d	9,215

- 1. Loads are based on an 18" clear span. Note: Where straps are used, longer straps will be required to achieve the same loads for larger clear spans, or the strap capacity will have to be reduced as described in footnote 7 below.
- 2. Nailing over 1/2" minimum wood structural panel sheathing is acceptable provided minimum 21/2" long nails are used. See page 54.
- 3. Allowable loads for DTT2Z-SDS2.5 and HDU based on (2) 2x and greater vertical wood
- 4. Cut lengths for coil strap are CS16 = 46", CS18 = 42", CS20 = 36", CMST14 = 78", CMST12 = 94".
- 5. For straight straps, use half the total fasteners listed on each member in the connection.
- 6. For stainless steel, order DTT2SS.
- 7. Calculate the straight strap value for a reduced number of nails as follows:

 $\mbox{Allowable Load} \ = \ \frac{\mbox{No. of Nails Used}}{\mbox{No. of Nails in Table}} \ \mbox{x Table Load}$

or refer to the Coil Strap Calculator at www.strongtie.com/software.

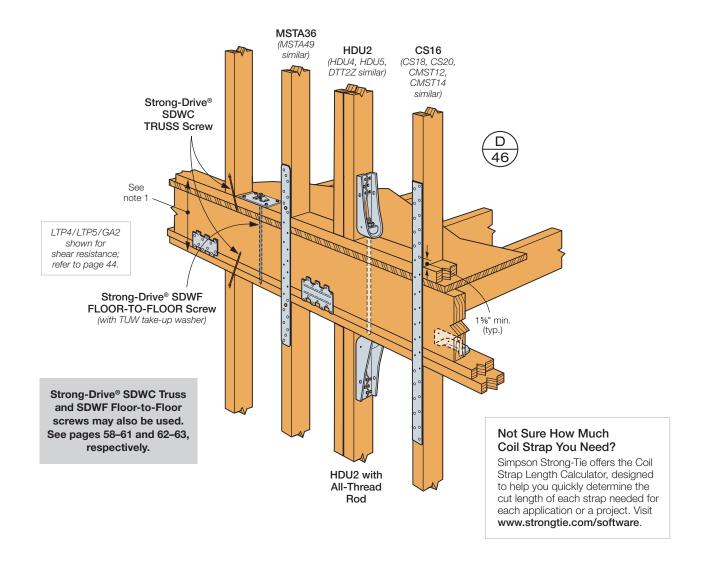

Floor to Masonry/Concrete



#5 rebar (min.)

HETA40


15% min. (typ.)

30° bend

LSTA36

DTT1Z

			Fastanava	DF/SP Allowabl	e Loads	SPF Allowable	Loads
	Model No.	Qty. Req.	Fasteners To Block/	Fasteners	Uplift	Fasteners To Wood	Uplift
	1101	11041	Concrete	To Wood Framing	(160)	Framing	(160)
	DTT1Z	1	%" ATR and THD37634RC8	(8) 10dx11/2"	910	(8) 10dx11/2"	850
	HETA16	1	Embedded	(8) 10dx11/2"	1,355	(8) 10dx11/2"	1,330
	MSTAM24	1	(5) 1/4"x21/4" Titen5	(9) 10d	1,500	(9) 10d	1,500
SS	HETA20	1	Embedded	(10) 10dx11/2"	1,810	(11) 10dx11/2"	1,810
	HETA40	1	Embedded	(10) 10dx11/2"	1,810	(11) 10dx11/2"	1,810
SS	DTT2Z	1	1½" ATR	(8) 1/4"x1 1/2" SDS	1,825	(8) 1/4"x11/2" SDS	1,800
	MSTAM36	1	(8) 1/4"x21/4" Titen ⁵	(13) 10d	1,870	(13) 10d	1,870
	THA426	1	(14) 1/4"x21/4" Titen5	(6) 16d	2,150	(6) 16d	1,850
	HETA16	2	Embedded	(16) 10dx11/2"	2,815	(16) 10dx11/2"	2,655
	HDU2-SDS2.5	1	%" ATR	(6) 1/4"x21/2" SDS	3,075	(6) 1/4"x21/2" SDS	2,215
	MSTCM40 ³	1	(14) 1/4"x21/4" Titen5	(26) 16d Sinkers	4,220	(26) 16d Sinkers	4,220
	MSTCM60 ³	1	(14) 1/4"x21/4" Titen5	(26) 16d Sinkers	4,220	(26) 16d Sinkers	4,220
	HTT5	1	%" ATR	26-10d	4,670	26-10d	4,015
	HDU5-SDS2.5	1	%" ATR	(14) 1/4"x21/2" SDS	5,645	(14) 1/4"x21/2" SDS	4,065




- 2. HETA will require a 30° bend and a 4" minimum embedment depth in a concrete tie beam only. Loads based on SP lumber only. Strap may be bent one full cycle only.
- 3. MSTCM requires attachment to a minimum 3" wide member.
- 4. When nailing a strap over ½" maximum wood structural panel sheathing, use 2½" long nail minimum.
- 5. For concrete applications use 1/4"x13/4" Titen® screws.
- 6. ATR-All-Thread Rod. The Designer must specify anchor type, length and embedment.
- 7. Standard cut washer is required with the %" All-Thread Rod.
- 8. THDRC listed for use with 8" concrete tie beam, 1%" edge, 8" end distance, uncracked concrete with no supplementary reinforcement and 2,500 psi concrete minimum. Designer shall specify

Double

HETA16

One #4 (min.) rebar in shear cone (48" long min.)

Installation

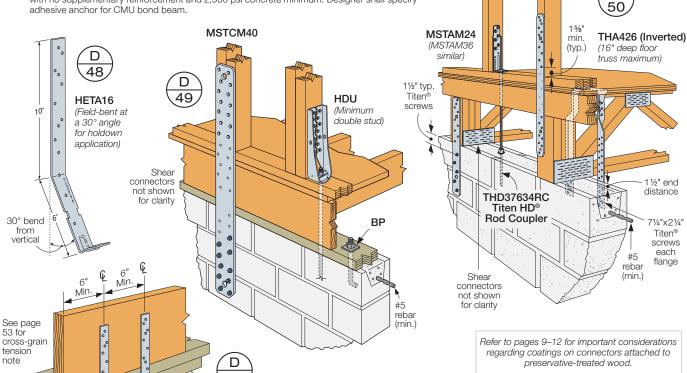


Stud to Sill Plate



			Fastener	rs (Total)	DF/SP Allowable Loads	SPF Allowable Loads
	Model No.	Qty. Reg.	To Stud	To Plate	Uplift	Uplift
			10 5100	10 Plate	(160)	(160)
SS	H2.5ASS	1	(4) SS8d	(4) SS8d	285	245
	SDWC15450	1	Narrow Face of	of Stud Only ^{7,10}	295	255
SS	Н8	1	(5) 10dx11/2"	(4) 10dx11/2"	310	310
	RSP4	1	(4) 8dx11/2"	(4) 8dx11/2"	315	285
SS	H4	1	(4) 8dx11/2"	(4) 8dx11/2"	360	235
	SDWC15450	1	Wide Face	of Stud ^{7,10}	360	310
	H2.5A	1	(4) 8dx11/2"	(4) 8dx11/2"	390	315
	SSP	1	(4) 10dx11/2"	(1) 10dx11/2"	420	325
	SDWC15600	1	Wide or Narrow	Face of Stud ^{7,10}	450	310
SS	H3	1	(4) 8d	(4) 8d	455	320
	SP1	1	(6) 10d4	(4) 10d	585	535
	TSP	1	(6) 10dx11/2"	(3) 10dx11/2"	585	425
	DSP	1	(8) 10dx11/2"	(2) 10dx11/2"	660	545
	SDWC15450	2	Wide Face of	Stud Only ^{7,10}	690	595
SS	H4	2	(8) 8dx11/2"	(8) 8dx11/2"	720	470
	SDWC15600	2	Wide Face of	Stud Only ^{7,10}	865	595
SS	SP4	1	(6) 10dx1½"	N/R	885	760
SS	SP6	1	(6) 10dx1½"	N/R	885	760
	SP8	1	(6) 10dx11/2"	N/R	885	760
SS	Н3	2	(8) 8d	(8) 8d	910	640
	SDWC15450	3	Wide Face of	Stud Only ^{7,10}	1,035	895
	SDWC15600	3	Wide Face of	Stud Only ^{7,10}	1,295	895
	SPH4 ⁶	1	(12) 10dx11/2"	N/R	1,490³	1,170
	SPH6 ⁶	1	(12) 10dx11/2"	N/R	1,490³	1,170
	SPH8	1	(12) 10dx11/2"	N/R	1,490³	1,170

- 1. N/R-Not required.
- 2. SPF loads reflect attachment to SPF stud and/or sill.
- 3. Maximum loads for SPH in Douglas Fir is 1,360 lb.
- 4. SP1 drive one stud nail at an angle through the stud into the plate to achieve table load.
- 5. SPH4 and SPH6 can be installed over nominal 1/2" wood structural panel sheathing with a maximum DF/SP load of 1,360 lb. Order SPH4R or SPH6R.
- 6. Douglas Fir allowable uplift load for TSP is 470 lb.
- 7. See pages 58-61 for required installation angles, spacing requirements and additional installation instructions.
- 8. The load capacities of stainlesssteel connections match those of carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, ring-shank nails.
- 9. Refer to technical bulletin T-C-STRAPS for retrofit options.
- 10. Strong-Drive® SDWC15600 should not be used to attach a stud to a treated sill plate. Instead use SDWC15450 with E-coat. SDWC15600 can be used at stud-to-raised-floor, bottom-plate connections.

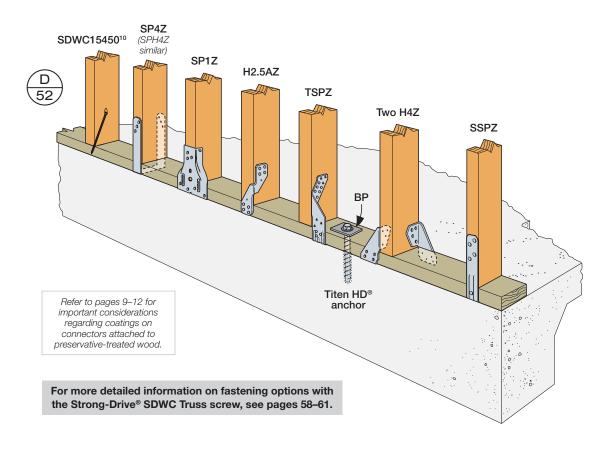



Sill Plate to Foundation




		DF/SP Allowable Loads					
Model No.	Fasteners (Total)	Uplift	Parallel to Plate (F ₁)	Perpendicular to Plate (F ₂)			
		(160)	(160)	(160)			
MAB15	(6) 10dx1½"	565	670	500			
MAB23	(6) 10dx11/2"	565	670	500			
MA4	(4) 10dx11/2"	830	575	430			
LMA4Z	(6) 10dx1½"	905	675	520			
MASA	(9) 10dx1½"	920	1,515	1,095			
THD50600H1	_	1,375³	1,005	500			


- 1. Titen HD® anchor 1/2"x6" is based on SP lumber, 1¾" edge, 8" end distance, uncracked concrete and no supplementary reinforcement.
- 2. MASA installed with one leg attached to stud has loads of 785 lb. (uplift), 1,005 lb. (parallel to plate) and 995 lb. (perpendicular to plate).
- 3. Uplift shown requires BP% with Titen HD anchor $\frac{1}{2}$ "x6".
- 4. Minimum concrete strength 2,500 psi.
- 5. Loads are based on single 2x sill plate applications.

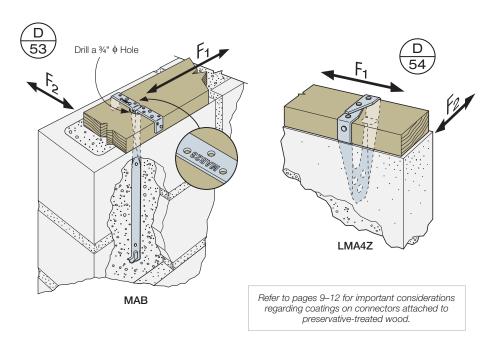



Titen HD® anchor (See page 67 for design loads)

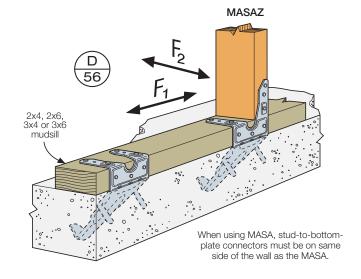



Alternate MASA Installation for Brick Ledges

Header to Wall Framing




Header to Studs

	Madal	Minimum	DF/SP Allows	able Loads	SPF Allowa	ble Loads
	Model No.	Header	Fasteners	Uplift	Fasteners	Uplift
	110.	Height	(Total)	(160)	(Total)	(160)
	HH4	3.50"	(11) 10dx1½"	575	(11) 10dx1½"	495
	HH4 ⁹	3.50"	(13) 16d	710	(13) 16d	610
SS	LSTA12	7.25"	(10) 10d	970	(10) 10d	830
	HH6	5.50"	(16) 10dx1½"	1,065	(16) 10dx1½"	915
	CS16	7.25"	(12) 10d	1,180	(12) 10d	1,020
SS	LSTA18	9.25"	(14) 10d	1,235	(14) 10d	1,165
SS	LSTA21	11.25"	(16) 10d	1,235	(16) 10d	1,235
	CC16	9.25"	(16) 10d	1,575	(16) 10d	1,360
	CS16	11.25"	(18) 10d	1,705	(20) 10d	1,700

Studs to Plate/Foundation

		Fastene	ers	DF/SP Allowable Loads	SPF Allowable Loads
	Model No.	Stud	Plate/	Uplift	Uplift
	NO.	Stuu	Foundation	(160)	(160)
	DSP ⁷	(8) 10dx1½"	(2) 10dx1½"	660	545
SS	SP4, SP6, SP8 ¹⁰	(6) 10dx1½"	_	885	760
	SPH4 ⁸ ,	(10) 10dx1½"	_	1,240	1,065
	SPH68, SPH8	(12) 10dx11/2"	_	1,490 ⁶	1,170
SS	DTT2Z ⁵	(8) 1/4"x11/2" SDS	1/2" ATR	1,825	1,800
	LSTHD8 ^{11,12} LSTHD8RJ	(20) 16d Sinkers	Embedded	2,700	2,700
	HDU2-SDS2.5	(6) 1/4"x21/2" SDS	%" ATR	3,075	2,215
	HTT4	(18) 10dx1½"	%" ATR	3,610	3,105
	П114	(18) 16dx2½"	%" ATR	4,235	3,640
		(26) 10dx11/2"	%" ATR	4,350	3,740
	HTT5	(26) 10d	%" ATR	4,670	4,015
		(26) 16dx2½"	%" ATR	5,090	4,375
	HTT5KT ¹³	(26) #10x21/2" SD	%" ATR	5,445	5,360
	HDU5-SDS2.5	(14) 1/4"x21/2" SDS	%" ATR	5,645	4,065

- 1. Straps must use half the total fasteners into each member being connected to achieve the listed loads.
- 2. Multiple straps may be used for increased uplift capacity.
- 3. For a continuous load path, truss/rafterto-top-plate/stud/header connections must be on the same side of wall as header-to-stud connections.
- 4. ATR-All-Thread Rod or Anchor Bolt. The Designer must specify anchor type, length, and embedment.
- 5. For stainless steel, order DTT2SS.
- 6. Maximum load for SPH in Douglas Fir is 1,360 lb.
- 7. DSP is for double-stud connections.
- 8. SPH4 and SPH6 can be installed over nominal 1/2" sheathing with a maximum DF/SP load of 1,360 lb. Order SPH4R
- 9. Where noted, minimum supporting post thickness is 21/2".
- 10. SP4 and SP6 available in stainless steel. SP8 is not.
- 11. Where noted in table, load listed is for 6" or 8" stemwall corner condition with 1/2" min. edge distance into non-cracked 2,500 psi concrete. For midwall condition, allowable load is 3,115 lb. for 6" or 8" stemwall. For end-of-wall condition, allowable load is 1,690 lb. for 6" stemwall (2,230 lb. for 8" stemwall).
- 12. For other STHD models, refer to page 45.
- 13. HTT5KT packaged with (26) Strong-Drive® SD Connector screws.

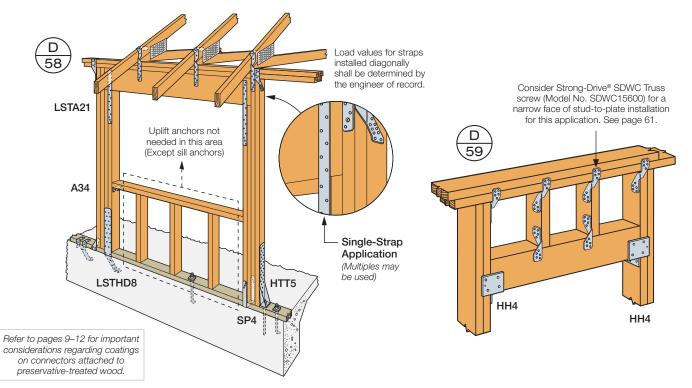


Stemwall/Crawlspace



SS	Model No.	Qty.	Fas	steners	DF/SP Allowable Loads	SPF Allowable Loads Uplift		
		Req.	Anchors	Fasteners	Uplift			
			Alichors	rastellers	(160)	(160)		
	FJA	1	(2) ½" ATR	(8) 10dx11/2"	1,205	1,035		
	DTT2Z3	1	(1) ½" ATR	(8) 1/4"x11/2" SDS	1,825	1,800		
	PA511,2	1	4" Embed	(9) 16d	2,220	1,925		
	PA68 ^{1,2}	1	4" Embed	(9) 16d	2,220	1,925		
	FJA ³	2	(4) ½" ATR	(16) 10dx11/2"	2,410	2,070		

- 1. Minimum embedment for PA into concrete footing is 4" with a minimum of 5" to nearest edge. 8" minimum spacing between straps. Optional nail holes provided.
- 2. Refer to Simpson Strong-Tie® technical bulletin T-PAUPLIFT for additional information on use of PA straps as foundation anchors, including strap extension.
- 3. For stainless steel, order DTT2SS.

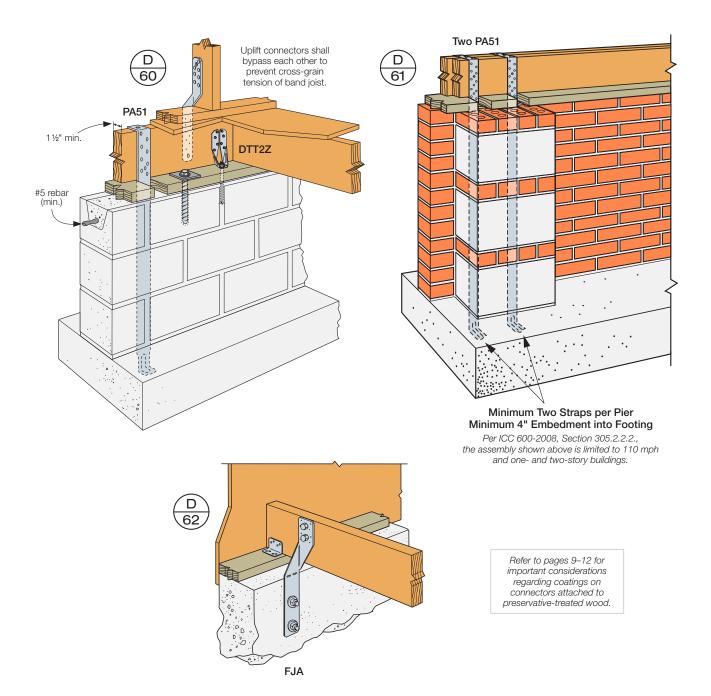

Beam to CMU or Concrete Pier





Min. (4) #7

vertical rebar


Model No.	No. of 1/4"x21/2" SDS		16" Square Grout-Filled CMU Pier ^{3,6}			16" Square CMU Shell Filled with 3,000 psi Concrete ^{3,7}				Deck Joist Connection			
	Screws			Uplift (160)		Lateral	Uplift (160)			Lateral	Download	Unlift	
	Main Beam	Side Beam	Deck Beam	Main Beam	Side Beam	Total	(160)	Main Beam	Side Beam	Total	(160)	(100)	Uplift (160)
CCQM-SDSHDG	12	_	_	6,750	_	6,750	2,460	6,855	_	6,855	2,770	_	_
CCTQM-SDSG	12	8	_	6,750	5,375	6,750	2,460	6,855	6,720	6,855	2,770	_	_
CCCQM-SDSG	12	8	_	6,750	5,375	6,750	2,460	6,855	6,720	6,855	2,770	_	_
ECCLQMG-KT ⁸	16	16	_	6,240	6,240	7,300	2,220	6,240	6,240	8,260	2,680	_	_
ECCLQMDG-KT	16	16	6	6,240	6,240	7,300	2,220	6,240	6,240	8,260	2,680	5,475	2,010

- 1. The allowable loads have been increased for wind or earthquake loading with no further increase allowed.
- 2. Total uplift load and lateral load is based on tested anchor failure in the pier.
- 3. Allowable loads are based on either a 16" square grout-filled CMU pier with f'm of 1,500 psi or a 16" square CMU shell filled with 3,000 psi concrete. A minimum of (4) #7 vertical rebars are required. The Designer shall design and detail the CMU/concrete pier to resist all forces including uplift, shear, and moment.
- 4. Pier height per Designer.
- 6. The allowable loads listed for grout-filled CMU apply to solid concrete piers of 2,500 psi
- 8. The ECCLQM-KT is a kit packaged with (2) MSTQM straps and (32) Strong-Drive® 1/4"x21/2" SDS Heavy-Duty Connector screws. One strap may be installed on each face of the ECCLQM (as shown), using the Strong-Drive SDS Heavy-Duty Connector screws into the beams and 26-16dx2½" nails (not provided) into the wall framing. The MSTQM strap's allowable tension load is 6,240 lbs.
- 9. Any side stirrup not fully supported by grout- or concrete-filled CMU has an allowable down load of 7,000 lb.

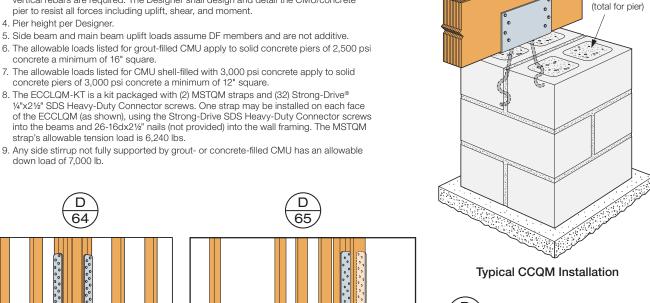


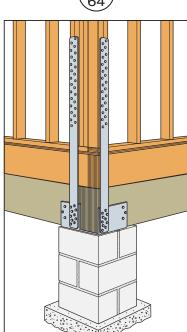

Typical ECCLQM Installation

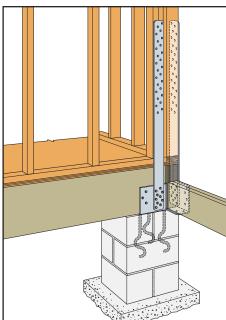


Typical ECCLRQMD-KT Installation

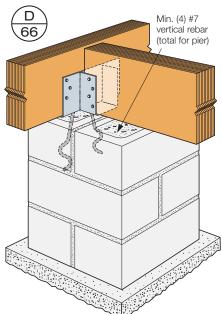

Typical CCTQM Installation

Beam to CMU or Concrete Pier (cont.)



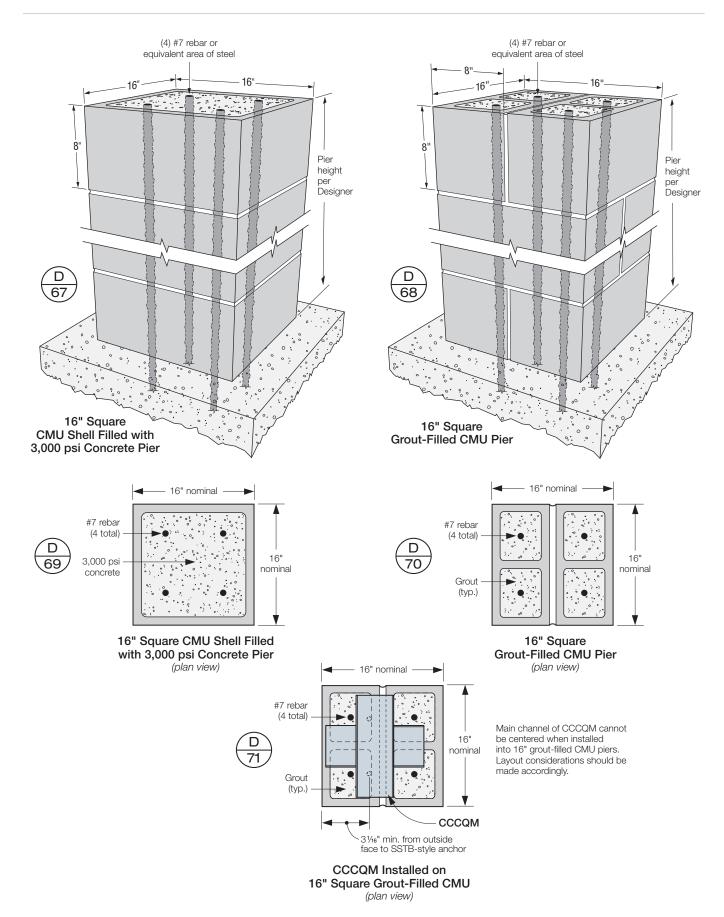


Wall to Pile/Girder



	Model Otv.		DF/SP Allowabl	e Loads	SPF Allowable	Loads
	Model No.	Qty. Reg.	Fasteners	Uplift	Fasteners	Uplift
	1101	noq.	(Total)	(160)	(Total)	(160)
SS	A35	1	(12) 8dx1 1/2"	450	(12) 8dx1 1/2"	450
SS	LTS12	1	(12) 10dx11/2"	720	(12) 10dx1 ½"	620
SS	LTS16	1	(12) 10dx11/2"	720	(12) 10dx11/2"	620
	DTT1Z	1	(8) 10dx11/2"	910	(8) 10dx11/2"	850
SS	MTS12	1	(14) 10dx11/2"	1,000	(14) 10dx11/2"	860
SS	MTS16	1	(14) 10dx11/2"	1,000	(14) 10dx1 1/2"	860
SS	HTSQ16ZKT	1	(8) 1/4x1 1/2" SDS	1,145	(8) 1/4x11/2" SDS	800
SS	HTS20	1	(16) 10dx11/2"	1,150	(16) 10dx11/2"	990
SS	LSTA21	1	(12) 10d	1,235	(14) 10d	1,160
SS	CS16	1	(20) 10d	1,705	(22) 10d	1,705
SS	DTT2Z	1	(8) 1/4x1 1/2" SDS	1,825	(8) 1/4x11/2" SDS	1,800
	HTT4	1	(18) 10dx11/2"	3,610	(18) 10dx11/2"	3,105
SS	PS218	2	(4) ¾" MB	4,290	(4) ¾" MB	3,340
SS	PS418	2	(4) ¾" MB	4,330	(4) ¾" MB	3,355
	HTT5	1	(26) 10dx11/2"	4,350	(26) 10dx11/2"	3,740
	MSTC66B3Z	1	(56) 10d	4,505	(56) 10d	3,875
SS	HST2	2	(6) 5/8" MB	5,220	(6) 5/8" MB	4,835
SS	PS720	2	(8) ½" MB	5,795	(8) ½" MB	5,155
SS	HST5	2	(12) %" MB	10,650	(12) %" MB	9,870

- 1. Loads are based on 111/4" girder depth. See the current Simpson Strong-Tie® Wood Construction Connectors catalog for other options.
- 2. PS and HST are for pile-to-girder applications only and installed in pairs. Published loads are governed by double shear perp-to-grain bolt calculations using a minimum member thickness of 31/2". Alternate values may be calculated per the NDS for other girder and pile widths. Straps must be centered about splice joint, and bolt edge and end distances must meet the NDS minimum requirements.
- 3. For straight straps, use half the total number of fasteners listed on each member in the connection.
- 4. Refer to pages 9-12 for corrosion considerations.


MSTC66B3Z

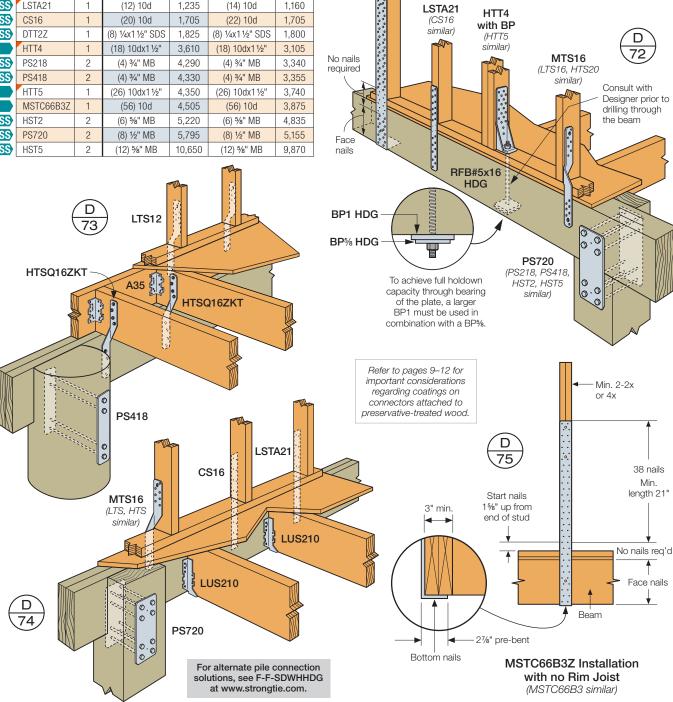



Post/Column to Beam





	Madal	04	Fasteners		DF/SP Allov	wable Loads	SPF Allowable Loads
	Model No.	Qty. Req.	Beam	Post	Uplift	Lateral F ₁	Uplift
		noq.	Deam	1031	(160)	(160)	(160)
ļ			4x4 P0	ST/COLUMN TO 4x	BEAM		
\	ECCU44	1	(2) %" MB	(2) %" MB	205	_	155
	LPC4 ²	2	(8) 10d	(8) 10d	760	325	655
SS	BC4	1	(6) 16d	(6) 16d	980	1,000	845
SS	AC4 (Min) ²	2	(12) 16d	(8) 16d	1,430	715	1,230
	CC44	1	(2) %" MB	(2) %" MB	1,465	_	_
	PC4Z	1	(10) 10d	(8) 10d	1,480	1,260	1,275
	EPC4Z	1	(10) 10d	(8) 10d	1,130	1,075	970
SS	LCE4 ²	2	(14) 16d	(10) 16d	1,800	1,425	1,545
<u>ss</u>	AC4 (Max) ²	2	(14) 16d	(14) 16d	2,500	1,070	2,150
SS	MSTA18	2	(28) 10d	(28) 10d	2,630	_	2,260
	ECCQ44-SDS2.5	1		(14) 1/4"x21/2" SDS	4,040	_	2,910
	CCQ44SDS2.5	1	. ,	(14) 1/4"x21/2" SDS	5,680	_	4,090
				ST/COLUMN TO 4x	BEAM		
	BC46	1	(12) 16d	(6) 16d	980	1,000	840
	PC4Z	1	(10) 10d	(8) 10d	1,480	1,260	1,275
	EPC4Z	1	(10) 10d	(8) 10d	1,130	1,075	970
	CC46	1	(4) %" MB	(2) %" MB	2,800	_	_
	ECCQ46-SDS2.5	1	(14) 1/4"x21/2" SDS	(14) 1/4"x21/2" SDS	4,040	_	2,910
	CCQ46SDS2.5	1	(16) 1/4"x21/2" SDS	(14) 1/4"x21/2" SDS	7,145	_	5,145
Į			6x6 P0	ST/COLUMN TO 6x	BEAM		
	LPC6 ²	2	(8) 10d	(8) 10d	915	490	785
	BC6	1	(12) 16d	(12) 16d	1,050	2,000	900
	ECCU66	1	(4) %" MB	(2) 5/8" MB	1,165	_	875
SS	AC6 (Min) ²	2	(12) 16d	(8) 16d	1,430	715	1,230
	PC6Z	1	(10) 10d	(8) 10d	1,480	1,295	1,275
	EPC6Z	1	(10) 10d	(8) 10d	1,435	1,230	1,235
SS	LCE4 ²	2	(14) 16d	(10) 16d	1,800	1,425	1,545
SS	AC6 (Max) ²	2	(14) 16d	(14) 16d	2,500	1,070	2,150
	CC66	1	(4) %" MB	(2) 5/8" MB	4,040	_	_
	ECCQ66-SDS2.5	1	(14) 1/4"x21/2" SDS	(14) 1/4"x21/2" SDS	4,040	_	2,910
	CCQ66SDS2.5	1	(16) 1/4"x21/2" SDS	(14) 1/4"x21/2" SDS	7,145	_	5,145
_ [T/COLUMN TO 2 (2x) BEAM		
	BCS2-2/4	1	(8) 10d	(6) 10d	780	1,025	670
	BCS2-2/4SS	1	(8) 10dSS	(6) 10dSS	575	850	_
	PC4Z	1	(10) 10d	(8) 10d	1,480	1,120	1,275
	EPC4Z	1	(10) 10d	(8) 10d	1,130	895	970
	BCS2-3/6	1	(12) 16d	(6) 16d	800	1,495	690
l	BCS2-3/6SS	1	(12) 16dSS	(6) 10dSS	525	1,055	_
	ECCQ4.62-3.62SDS2.5	1	(16) 1/4"x21/2" SDS	(14) 1/4"x21/2" SDS	4,040	_	2,910
	CCQ4.62-3.62SDS2.5	1	(16) 1/4"x21/2" SDS	(14) 1/4"x21/2" SDS	5,680	_	4,090
_ [T/COLUMN TO 31/8"	BEAM		
	CC31/4-4	1	(4) %" MB	(2) 5/8" MB	3,640	_	_
	ECCQ3-4SDS2.5	1	(14) 1/4"x21/2" SDS	(14) 1/4"x21/2" SDS	3,695	_	2,660
	CCQ3-4SDS2.5	1	(16) 1/4"x21/2" SDS	(14) 1/4"x21/2" SDS	5,680	_	4,090
			6x6 POS	T/COLUMN TO 51/8"	BEAM		
[ECCU51/4-6	1	(4) ¾" MB	(2) ¾" MB	2,735	_	1,995
	ECCQ5-6SDS2.5	1	(14) 1/4"x21/2" SDS	(14) 1/4"x21/2" SDS	5,530	_	3,980
	CCQ5-6SDS2.5	1	(16) 1/4"x21/2" SDS	(14) 1/4"x21/2" SDS	7,245	_	5,210
	CC51/4-6	1	(4) ¾" MB	(2) ¾" MB	7,530	_	_











- 1. "—" in the tables indicates that the product has not been tested in the particular load direction listed.
- 2. Where noted, connectors must be installed in pairs to achieve listed loads.
- 3. For end conditions, specify ECCQ or ECCU when heavy column cap required.
- 4. Straps must use half the total fasteners in each member being connected to achieve the listed loads.
- 5. For SPF F_1 loads, multiply DF/SP F_1 loads by 0.86.



9-12 for important considerations regarding coatings on connectors attached to preservativetreated wood.

Refer to pages


Beam to Corner Post/Column




		Al	lowable Loads		
Series		Uplift	Download		
Series		(160)		(100	0)
	Main Beam	Side Beam	Total ³	Side Beam	Total
ECCLQ-SDS2.5	2,835	1,840	3,795	6,780	Refer
CCCQ-SDS2.5	4,780	2,390 ²	4,780	7,000	to note
CCTQ-SDS2.5	4,910	2,350	5,315	7,000	#5

- 1. Uplift loads have been increased for wind or seismic; reduce where other loads govern. Downloads may not be increased.
- 2. Allowable load is per seat. Side beams must be loaded symmetrically for the CCCQ.
- 3. The combined uplift loads applied to all beams in the connector must not exceed the total allowable uplift load listed in the table.


- 4. The ECCLQ side beam may use a side beam uplift load up to 2,350 lb. The deflection of this load may exceed the standard 1/8" deflection by an additional 1/8".
- 5. The combined download for all of the carried beams shall not exceed the allowable download for the unmodified product in the current Simpson Strong-Tie® Wood Construction Connectors catalog (CCQ load for CCCQ and CCTQ, or ECCQ load for ECCLQ). The download for each side beam shall not exceed the lesser of 35% of the allowable download or 9,265 lb. for the unmodified product.
- 6. The download to each side beam shall not exceed the allowable load shown, nor 35% of the allowable load for the unmodified product,
- 7. Column width in the direction of the beam width must be the same as the main beam width (W1).
- 8. Refer to T-CCQLTC-WS for ordering instructions.








CCCQ-SDS2.5



CCTQ-SDS2.5


Model	Dimensions (in.)		Total No. of Fasteners		DF/SP Uplift Loads (lb.)	SPF Uplift Loads (lb.)
No.	w		Beam	Post	Total Uplift	Total Uplift
	VV		Deam	1031	(160)	(160)
LCE4Z (Mitered Corner)	5%	5%	(14) 16d	(10) 16d	985	845




2. Connectors must be installed in pairs to achieve listed loads.

Model	Dimensions (in.)		Total No. of Fasteners		DF/SP Uplift Loads (lb.)			SPF Uplift Loads (lb.)		
No.	W	L	Beam	Post	Side Beam	Main Beam	Total	Side Beam	Main Beam	Total
RTC44 ¹ (Mitered Corner)	3%6	43/4	(16) 16d	(10) 16d	900	900	1,800	775	775	1,550
RTC44 ² (Square Cut)	3%6	43/4	(16) 16d	(10) 16d	925	1,230	1,760	795	1,060	1,515


- 1. The allowable download for the mitered RTC44 connection is limited to bearing of the mitered beams on the post and shall be determined by the Designer.
- 2. The allowable download for the main beam in the square cut RTC44 connection is limited to bearing of the beam on the post
- and shall be determined by the Designer. The side beam allowable download is 1,170 lb.
- 3. The combined uplift loads applied to all beams in the connector must not exceed the total allowable uplift load listed in the table.



Typical LCE4Z Installation (Mitered Corner)



RTC44 Installation (Square Cut)





(Mitered Corner)

SS


Post/Column to Foundation



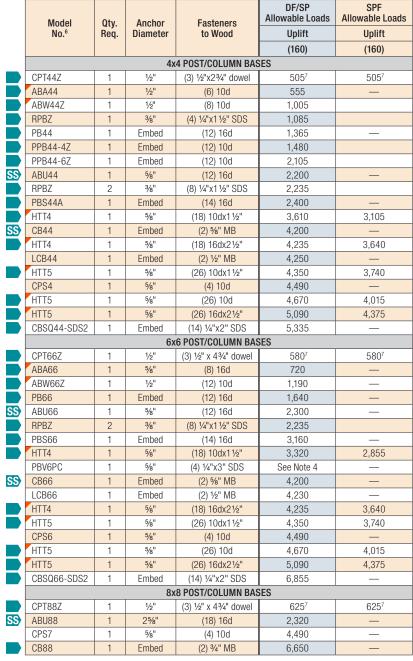




Typical PPB44-4Z Installation (PPB44-6Z similar)



Typical CPT44Z Corner-Flush Edge Installation7 (CPT66Z and CPT88Z similar)

- 1. ATR-All-Thread Rod or Anchor Bolt. The Designer must specify anchor type, length, and embedment. Refer to the Simpson Strong-Tie® Connector-Anchor Selector web app for guidance on selected products.
- 2. For multiple holdowns, verify the allowable tension capacity of the wood member.
- 3. Horizontal bolts and nails shall not be combined on connectors.
- 4. Allowable uplift for PBV6PC is 3,800 lb. based on a Ponderosa Pine round wood post.
- 5. For additional anchorage, placement conditions and installation instructions regarding these products, visit www.strongtie.com.
- 6. Additional nominal and rough post base sizes are available. Visit www.strongtie.com.
- 7. Uplift capacity shown is based on corner-flush edge condition using SET-XP® anchoring adhesive with (2) 1/2"-diameter ATR anchors. Increased capacity is possible with cast-in-place anchorage by Designer or increasing anchorage edge distances. See www.strongtie.com for more information.
- 8. Some of the bases/caps shown on this page and page 39 have been tested to work with hollow columns by Cox and Woodtone. See S-C-23COXHC and S-C-23WDTONE, respectively, for more information.


Post bases do not provide adequate resistance to prevent members from rotating about the base and therefore are not recommended for non-top-supported installations such as fences, unbraced carports or a trellis.



RPBZ Installation with CPS Away from Edge on Concrete

Post/Column to Foundation (cont.)



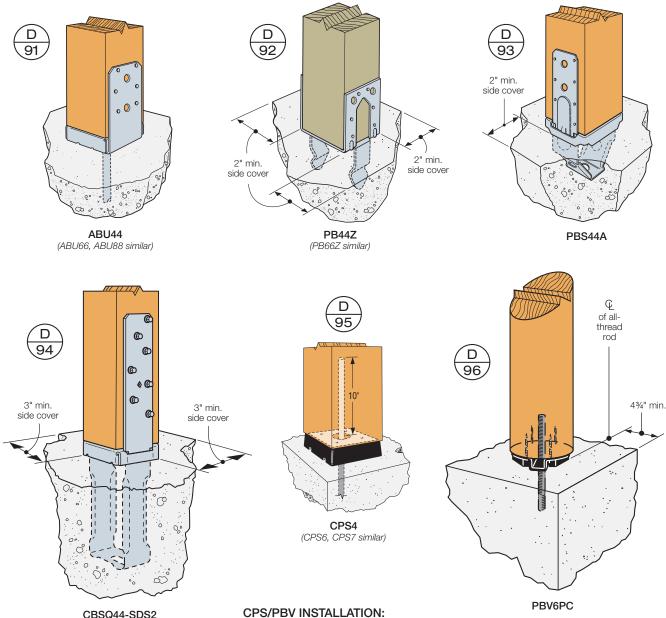

Refer to pages 9–12 for important considerations regarding coatings on connectors attached to preservative-treated wood.

(CBSQ66-SDS2 similar)

Post:

- Drill a 3/4" diameter hole, 10" into the center of the post.
- Clean out dust. Fill hole halfway with Simpson Strong-Tie® SET epoxy anchoring adhesive.
- · Insert all-thread rod and allow epoxy to set and cure.
- Secure standoff to post using (4) 10d nails except PBV, which uses (4) Simpson Strong-Tie Strong-Drive® SDS Heavy-Duty Connector screws.

Concrete:


- Drill a ¾" diameter hole per anchor design.
- Prepare anchor site per instructions on anchoring adhesive package, or refer to pages 124-127 of the Anchoring and Fastening Systems for Concrete and Masonry catalog (C-A-2016).
- Fill hole at least halfway with SET epoxy anchoring adhesive, insert post subassembly into hole and allow to cure per cure schedule on adhesive packaging.
- · Post bases do not provide adequate resistance to prevent members from rotating about the base and therefore are not recommended for non top-supported installations (such as fences or unbraced carports).


Roof Boundary Connection



Model	Type of	Bending	Fasteners		DF/SP Allowable Loads	SPF Allowable Loads
No.	Connection	Angle	To Wall	To Blocking	Lateral (F ₁) (160)	Lateral (F ₁) (160)
	1	45° to 90°	(6) 10dx11/2"	(6) 10dx11/2"	445	380
RBC	2	< 30°	(6) 10dx1½"	(6) 10dx11/2"	435	375
NDC	[2]	30° to 45°	(6) 10dx1½"	(6) 10dx1½"	480	415
	3	0° to 45°	(3) 1/4"x21/4" Titen4	(6) 10dx11/2"	350	350


- 1. Allowable loads are for one anchor attached to blocking minimum 11/2" thick.
- 2. RBC can be installed with up to %" gap and achieve 100% of the listed load.
- 3. Allowable loads have been increased for wind or earthquake loading with no further increase allowed. Reduce where other loads govern.
- 4. When attaching to concrete, use (3) 1/4"x13/4" Titen® screws.
- 5. RBC installed over 1" foamboard has a load of 395 lb. (160) in a parallel-to-wall (F₁) load direction for Douglas Fir. For SPF, the load is 340 lb.
- 6. RBC may be installed over $\frac{1}{2}$ " structural sheathing using $\frac{10dx1}{2}$ " nails with no load reduction.
- 7. Refer to flier F-C-RBC for additional information.

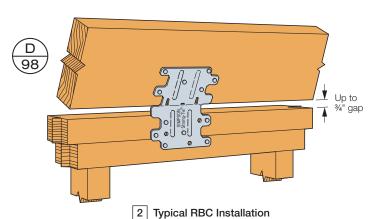



1 Typical RBC Installation

TITEN® SCREW WARNING: Industry studies show that hardened fasteners can experience performance problems in wet or corrosive environments. Accordingly, use this product in dry and noncorrosive environments only, provide moisture barrier, or use a stainless-steel fastener. Steps must be taken to prevent inadvertent sustained loads above the listed allowable loads. Overtightening and bending moments can initiate cracks detrimental to the hardened screw's performance. Use the Simpson Strong-Tie® Titen® installation tool kit (Part TTNT01); it has a bit that is designed to reduce the potential for overtightening the screw.

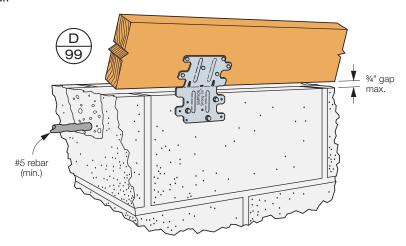


3 Typical RBC Installation to CMU Block


Lateral Load




				DF/SP Allowable Loads	SPF Allowable Loads
	Model No.	Qty. Req.	Fasteners (Total)	F ₁	F ₁
			(101)	(160)	(160)
SS	LS30	1	(6) 10dx1 ½"	325	280
	GA1	1	(4) 10dx 1½"	330	285
SS	LS30	1	(6) 10d	395	340
SS	A35	1	(6) SPAX #6x½ to sheathing (6) 8dx1½" to framing	425	365
SS	A34	1	(8) 8dx1 ½"	515	445
	GA2	1	(6) 10dx1 ½"	550	475
SS	A23	1	(8) 10dx11/2"	565	485
SS	LS50	1	(8) 10dx11/2"	565	485
	LTP5	1	(12) 8dx11/2"	620	535
SS	LS70	1	(10) 10dx11/2"	640	550
	LTP4	1	(12) 8dx1 1/2"	670	575
SS	A35	1	(12) 8dx1 1/2"	695	600
SS	LS50	1	(8) 10d	730	630
SS	LS90	1	(12) 10dx1 ½"	845	725
SS	LS70	1	(10) 10d	915	785
SS	LS90	1	(12) 10d	1,040	895




- 1. LTP4 can be installed over %" wood structural panel sheathing with 8dx11/2" nails and achieve 72% of the listed load, or over 1/2" and achieve 64% of the listed load. 8d commons will achieve 100% load.
- 2. The LTP5 may be installed over wood structural panel sheathing up to ½" thick using 8dx11/2" nails with no reduction in load.

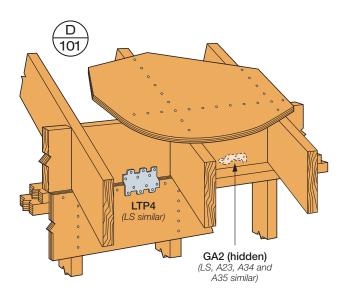

Simpson Strong-Tie has tested the performance of A35 framing angles installed with SPAX 0.138 pan-head, unidrive wood screws (approx. 0.138" diameter x $\frac{1}{2}$ " long, Simpson Strong-Tie® Model No. SPAX #6x½-R200) in lieu of 8dx1½" nails, as specified in the Wood Construction Connectors catalog. Each leg of the A35 was attached to 1/2" 24/0 APA-rated plywood sheathing with the SPAX 0.138 pan-head, unidrive wood screws.

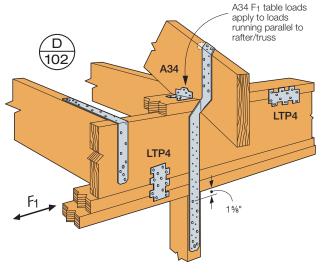


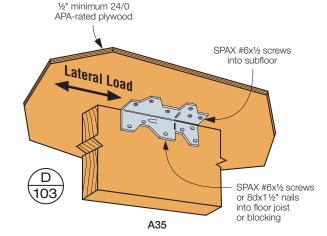

Holdowns



		٥.	Anchor	Min. Wood		DF/SP Allowable Loads	SPF Allowable Loads
	Model No.	Qty. Reg.	Diameter	Member Thickness ¹	Fasteners (Stud)	Uplift	Uplift
		neq.	(in.)	(in.)	(Stuu)	(160)	(160)
	DTT1Z	1	3/8	1 1/2	(8) 10dx1½"	910	850
SS	DTT2Z ⁸	1	1/2	3	(8) 1/4"x11/2" SDS	2,145	1,835
	LSTHD8/STHD8RJ	1	Embed	_	(20) 16d Sinkers	2,7002,10	2,7002,10
	HDU2-SDS2.5	1	5/8	3	(6) 1/4"x21/2" SDS	3,075	2,215
	HD3B	1	5/8	3	(2) 5/8" MB ⁶	3,130	3,050
	HTT4	1	5/8	3	(18) 10dx11/2"	3,610	3,105
SS	HD5SS ¹²	1	5/8	3	(2) 5/8" MB ⁶	3,850	3,275
	STHD10/STHD10RJ	1	Embed		(24) 16d Sinkers	4,1203,10	4,1203,10
	HTT4	1	5/8	3	(18) 16dx21/2"	4,235	3,640
	HTT5	1	5/8	3	(26) 10dx11/2"	4,350	3,740
	HD5B	1	5/8	3	(2) 3/4" MB ⁶	4,505	3,785
	HDU4-SDS2.5	1	5/8	3	(10) 1/4"x21/2" SDS	4,565	3,285
	HTT5	1	5/8	3	(26) 10d	4,670	4,015
	HTT5	1	5/8	3	(26) 16dx21/2"	5,090 ¹¹	4,37511
	STHD14/STHD14RJ	1	Embed	_	(30) 16d Sinkers	5,345 ^{4,10}	5,345 ^{4,10}
	HTT5KT	1	5/8	3	(26) #10x21/2" SD	5,445	5,360
	HDU5-SDS2.5	1	5/8	3	(14) 1/4"x21/2" SDS	5,645	4,065
SS	HD7SS ¹²	1	7/8, 1	3	(3) 7/8" MB ⁶	6,480	5,510
	HD7B	1	7/8	3	(3) 3/4" MB ⁶	6,645	5,650
	HDU8-SDS2.5	1	7/8	41/2	(20) 1/4"x21/2" SDS	7,870	5,665
	HDQ8-SDS3	1	7/8	41/2	(20) 1/4"x3" SDS	9,230	6,645
	HDC10/22-SDS2.5	1	7/8	3	(24) 1/4"x21/2" SDS	9,665	8,425
	HD9B	1	7/8	41/2	(3) 7/8" MB ⁶	9,920	8,435
SS	HHDQ11SS-SDS2.5SS ¹²	1	1	5½	(24) 1/4"x21/2" SDS	10,385	7,480
	HDU11-SDS2.5	1	1	71/4	(30) 1/4"x21/2" SDS	11,175	8,045
SS	HD9SS ¹²	1	7∕8, 1	41/2	(3) 1" MB ⁶	12,100	10,285
	HDU14-SDS2.59	1	1	71/4	(36) 1/4"x21/2" SDS	14,375 ⁹	10,435 ⁹
	HD19	1	11/4	71/4	(5) 1" MB ⁶	19,360	15,270



- See the current Simpson Strong-Tie® Wood Construction Connectors catalog for load values based on different wood thickness. Post design by Specifier.
 Where noted in table, load listed is for 6" or 8" stemwall corner condition with ½" min. edge distance into non-cracked 2,500 psi concrete. For midwall condition, allowable load is 3,115 lb. for 6" or 8" stemwall. For end-of-wall condition, allowable load is 1,690 lb. for 6" stemwall (2,230 lb. for 8" stemwall).
 Where noted in table load listed is for 8" stemwall corner.
- 3. Where noted in table, load listed is for 8" stemwall corner condition with ½" min. edge distance into non-cracked 2,500 psi concrete. For midwall condition, allowable load is 4,755 lb. For end-of-wall condition, allowable load is 3,145 lb. See the current Wood Construction Connectors catalog for 6" stemwall loads.
- 4. Where noted in table, load listed is for 8" stemwall corner or midwall condition with ½" min. edge distance into non-cracked 2,500 psi concrete. For end-of-wall condition, allowable load is 4,470 lb. See the current Wood Construction Connectors catalog for 6" stemwall loads.

5. ATR-All-Thread Rod or Anchor Bolt. The Designer must specify anchor type, length, and embedment.


- Refer to technical bulletin T-ANCHORSPEC for guidance on selected products.
- Lag bolts will not develop the listed loads.
- STHD straps may be installed over 1/2" maximum wood structural panel sheathing. Installing STHD with StrapMate® strap holder reduces the possibility of concrete spalling.
- 8. For stainless steel, order DTT2SS.
- HDU14 requires heavy hex anchor nut to achieve tabulated loads (supplied with holdown).


 For further clarification on midwall, end-of-wall and corner conditions, reference the current *Wood*
- Construction Connectors catalog

12. For more stainless-steel holdown load options as dictated by

plate washer installed in the seat of the holdown is 5,295 lb. for DF/SP and 4,555 lb. for SPF/HF.

on connectors attached to 11. Allowable load for HTT5 with a BP%-2 bearing preservative-treated wood.







Refer to pages 9-12 for important considerations regarding coatings

HDU5 (HDU2, HDU8, HDU11


and HDU14 similar)






HD5B

(HD7B, HD9B similar)



(HTT4 similar)

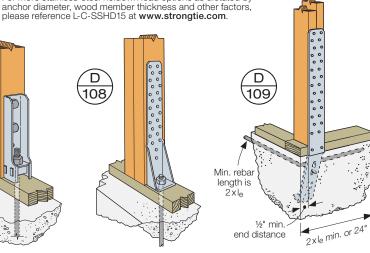


Typical STHD Corner Installation

with (2) 2x4 Studs

Strong-Wall® Shearwalls




Simpson Strong-Tie® Strong-Wall® shearwalls provide design flexibility while offering high lateral-load capacities that are required in some building designs. Strong-Wall shearwall solutions increase the amount of allowable window opening space by 48% when compared to wider, site-built shearwalls with the same capacity. The gray areas below represent window openings made possible by Strong-Wall shearwalls.

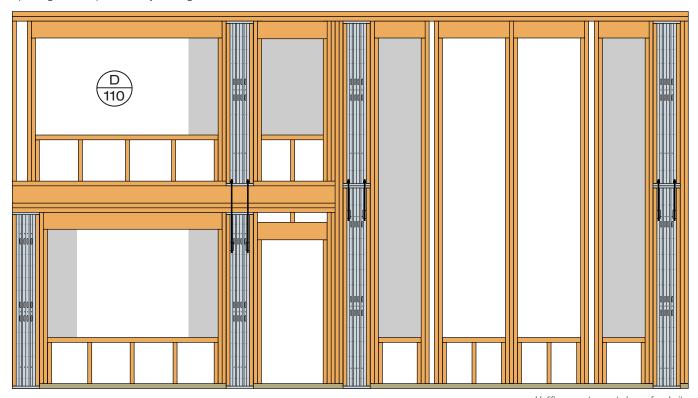


Broad Variety of Shearwall Solutions

Uplift connectors not shown for clarity


The Steel Strong-Wall and Strong-Wall SB shearwall solutions combine superior performance with ease of installation for maximum design flexibility. For in-depth information about Strong-Wall shearwalls, visit www.strongtie.com.

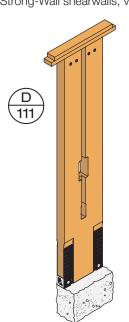


Strong-Wall SB for Standard and Balloon-Framing Applications

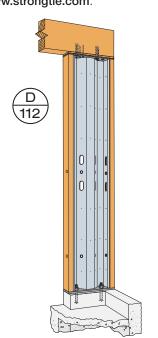

Garage Front Application (Full-height and portal-frame options available)

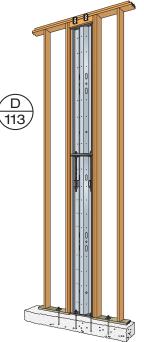

Balloon-Framing Applications up to 20'

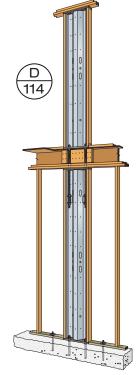


Two-Story Stacked-Wall **Applications**

Strong-Rod™ Uplift Restraint System



The Simpson Strong-Tie® Strong-Rod™ Uplift Restraint System for roofs (Strong-Rod URS) is a continuous rod tiedown solution designed to provide a complete load path to resist suction (uplift) pressure on the roof. After hurricane ties transfer roof uplift forces into the uppermost top plates in a wood-frame structure, a Strong-Rod URS continues to transmit that resistance down to the foundation or final termination point. Visit www.strongtie.com/srs for more information.

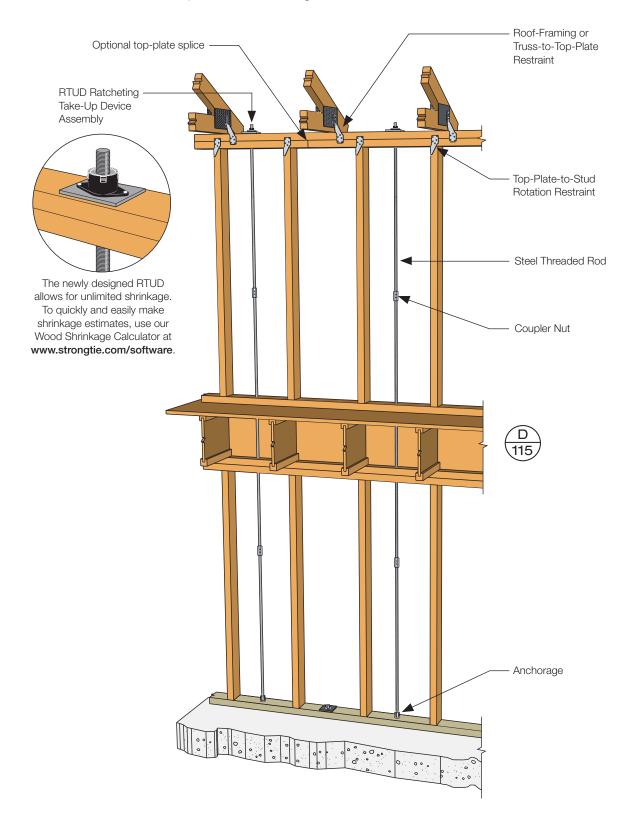


Gable End to Wall Framing



				DF/SP A	Allowable Load	ds		SPF A	llowable Loads	3	
	Model No.	Fasteners (Total)	Uplift	Parallel to End of Wall (F ₁)	Perp. to End of Wall Toward Anchor (F ₂)	Perp. to End of Wall Away from Anchor (F ₂)	Uplift	Parallel to End of Wall (F ₁)	Perp. to End of Wall Toward Anchor (F ₂)	Perp. to End of Wall Away from Anchor (F ₂)	
			(160)	(160)	(160)	(160)	(160)	(160)	(160)	(160)	1
				SI	HEAR CONNEC	TIONS					1
	LTP4	(12) 8dx1 1/2"	_	670	_	_	_	575	_	_	1
	LTP5	(12) 8dx1 1/2"	_	620	_	_	_	535	_	_	
SS	A34	(8) 8dx1 1/2"	_	515	455	_	_	340	390	_	1
SS	A34	(8) SD9x11/2"	240	640	495		170	550	425		
SS	A35	(12) 8dx1 1/2"	_	695	670	_	_	450	575	_	
			END-OF	-WALL CO	NNECTIONS (CONCRETE/MA	SONRY)				
	HGAM10KTA	(4) 1/4"x1 1/2" SDS (4) 1/4"x23/4" Titen ⁶	850	1,005	1,165	680	610	725	795	530	
	RBC	(3) 1/4"x21/4" Titen ⁶ (6) 10dx11/2"	_	350	_	_	_	350	_	_	
	LTA2	(10) 10dx1½"	1,390 ⁷	950	220	220	1,015	800	220	220	1
	HETA121	(7) 10dx1½"	1,515 ⁸	65	85	85	1,210	55	75	75	1
	HETA201	(12) 10dx11/2"	1,810	730	335	335	1,810	625	215	215	1
				END-OF-V	VALL CONNEC	TIONS (WOOD)					
	HGA10KT	(4) 1/4"x1 1/2" SDS	695	1,165	940	780	500	840	675	495	
	RBC	(4) 1/4"x3" SDS	_	445	_	_	_	380	_	_	
	LSTA15	(6) 10dx11/2"		_	_	485	_	_	_	415	
	LSTA18	(6) 10d	_	_	_	645	_	_	_	555	
	LSTA21	(8) 10d	_	_	_	965	_		_	830	
	LSTA24	(12) 10d	_	_	_	965	_		_	830	
	LSTA30	(12) 10d	_	_	_	1,305				1,125	

- 1. HETA will require a 30° bend and a 4" minimum embedment depth in a concrete tie beam only.
- 2. Refer to Prescriptive Standards for spacing and construction of assembly shown in detail D118.
- 3. Straps must use half the total fasteners into each member being connected to achieve the listed loads.
- 4. LTP4 can be installed over 3/4" wood structural panel sheathing with 8dx11/2" nails and achieve 72% of the listed load, or more than 1/2" and achieve 64% of the listed load. 8d commons will achieve 100% load.
- 5. The LTP5 may be installed over wood structural panel sheathing up to 1/2" thick using 8dx11/2" nails with no reduction in load.
- 6. For concrete applications use 1/4"x13/4" Titen® screws.
- 7. LTA2 allowable uplift listed in table is based on SP lumber. Uplift load on DF is 1,210 lb.
- 8. HETA12 allowable uplift listed in table is based on SP lumber. Uplift load on DF is 1,400 lb.

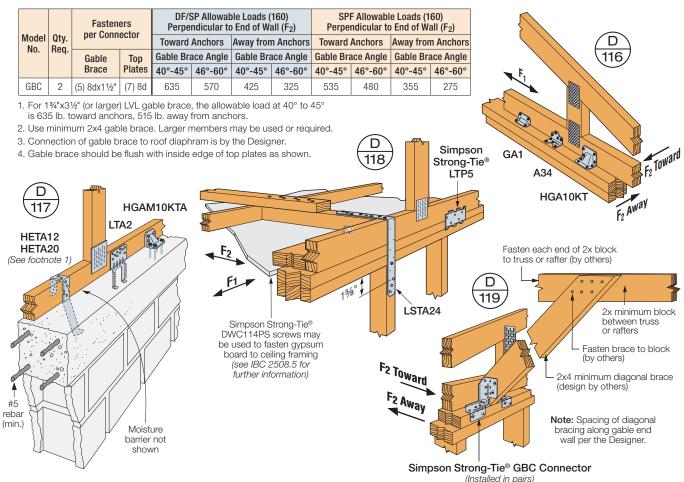


Valley Truss to Roof Framing



Typical VTCR

Model	Faste	eners	Supporting		F/SP ble Loads	SPF/HF Allowable Loads	
No.	Supporting Framing	Valley Truss	Roof Pitch	Uplift² (160)	Download ⁴ (100/115/ 125/160)	Uplift ² (160)	Download ⁵ (100/115/125/160)
	(4) 10d	(2) 10dv11/	< 4/12	370	790	320	655
VTCR	(4) TOU	(3) 10dx11/2"	4/12 to 12/12	370	790	320	655
VICE	(4) #9x2½" SD	(3) #9x1½" SD	< 4/12	390	790	335	655
	(4) #93272 30	(3) #9X172 3D	4/12 to 12/12	500	790	430	655

- 1. Loads are based on installation over 1/16" or 15/12" sheathing. For installation over 19/2" or 5/8" sheathing, allowable uplift loads are 285 lb. (DF/SP) and 245 lb. (SPF/HF) when installed with nails, or 370 lb. (DF/SP) and 320 lb. (SPF/HF) when installed with screws.
- 2. When attached directly to the supporting framing with either screws or nails, the allowable uplift for pitches less than 4:12 is 240 lb. (DF/SP) and 205 lb. (SPF/HF). For pitches 4:12 to 12:12, use the tabulated uplift loads.
- 3. Allowable uplift loads are based on the lower of the test loads at %6" deflection or the ultimate load divided by 3.
- 4. Southern Pine allowable download is 750 lb.
- 5. Hem Fir allowable download is 625 lb.
- 6. When the valley truss and supporting framing are of different species, use the lower tabulated values.

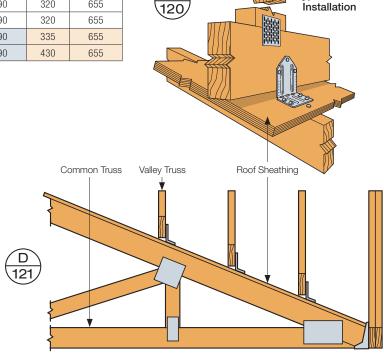


Typical VTCR Installation - Side View

Drag Strut Connection

Model			DF/SP Allov	vable Loads	SPF/HF Allowable Loads		
No.	(in.)	Fasteners	Compression (160)	Tension (160)	Compression (160)	Tension (160)	
DSC2R/L-SDS3	16	(20) 1/4"x3" SDS	2,590	3,720	1,865	2,680	
DSC5R/L-SDS3	21	(24) 1/4"x3" SDS	4,745	5,925	3,415	4,265	

- 1. Simpson Strong-Tie® Strong-Drive® SDS Heavy-Duty Connector screws' minimum penetration is 2¾", minimum end distance is 21/2" for DSC2 and 33/4" for DSC5 and minimum edge distance is %" for full load values.
- 2. Simpson Strong-Tie Strong-Drive SDS Heavy-Duty Connector screws are permitted to be installed through metal truss plates as approved by the Truss Designer, provided the requirements of ANSI/TPI 1-2007 Section 7.5.3.4 are met (pre-drilling required through the plate using a maximum of 3/2" bit). When installing fasteners through truss plates that will extend out past the back face of the member, care must be taken to ensure that the fastener does not push the truss plate out on the back face.

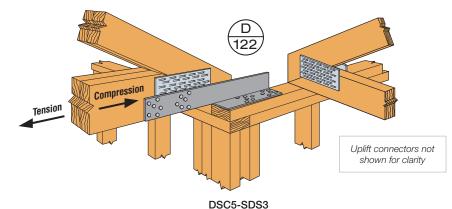

(DSC2-SDS3 similar) (Right-hand DSC shown; specify right or left hand when ordering)


Hanger Uplift Considerations



- Combine loads by inverting the proper size and type of Simpson Strong-Tie® connectors in a girder, truss or beam connection, as shown below, to obtain additional uplift loads.
- In a combined installation of an inverted connector with a standard connector, all the component uplift and downloads can be added together (as shown in the example below with HGUS26-2 hangers) to obtain higher load values.
- Allowable loads shown are based on the lesser of either National Design Specification (NDS) calculations or the results of static load tests.
- Other hanger and connector options than those shown can be used as specified by the Designer.

Model No.	Faste	eners	DF/SYP Allowable Uplift Loads
	Header	Joist	(160)
HUC26-21	(12) 16d	(6) 10d	2,700
HUC28-21	(14) 16d	(6) 10d	3,040
HUC210-21	(18) 16d	(10) 10d	4,100


- 1. Values based on an inverted hanger installation.
- 2. Loads include a 60% increase for wind loading with no further increases allowed.
- 3. Table values also apply to triple 2x and 4x HUC models with the same nailing pattern.
- 4. Download assumed to be carried by jack studs.



Combined-Connector Example

	Faste	eners	DF/SYP Allowable Loads						
Model No.	Header	Joist	Uplift Loads		Downloads				
	пеацеі	Juist	(160)	Snow (115)	Roof (125)	Roof (160)			
LRU26Z1	(4) 16d	(5) 16d	1,360	880	880	880			
LS70	(5) 10d	(5) 10d	915	675	730	915			
HUS26	(14) 16d	(6) 16d	1,550	3,095	3,335	3,335			
Combined	Total Load ³		3,825	4,650	4,945	5,130			


- 1. Values based on an inverted hanger installation.
- 2. Where (160) is noted, loads include a 60% increase for wind loading with no further increases allowed.
- 3. Combined Total Load is based on the combined results of individual connector allowable loads. The Designer shall determine if using the combined total load
- 4. Other connectors can be used for this application per the Designer.

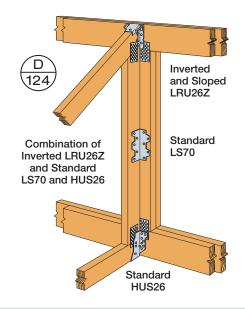

Combined-Hanger Example

		Faste	eners		DF/SYP Allov	vable Loads			
	Model No.	Header	Joist	Uplift Loads	Downloads				
		пеацеі	Juist	(160)	Snow (115)	Roof (125)	Roof (160)		
HGU	S26-2	(20) 16d	(8) 16d	2,155	4,875	5,230	5,575		
HGU	S26-21	(20) 16d	(8) 16d	5,575	2,155	2,155	2,155		
Combined Total Load			7,730	7,030	7,385	7,730			

- 1. Values based on an inverted hanger installation.
- 2. Where (160) is noted, loads include a 60% increase for wind loading with no further increases allowed.
- 3. Other hangers can be used for this application. Contact Simpson Strong-Tie for load information.




Combination of Inverted and Standard HGUS26-2

Load Path Installation Considerations




Hurricane Tie Installations to Achieve Twice the Load (Top View)

Both connectors shall be same model.

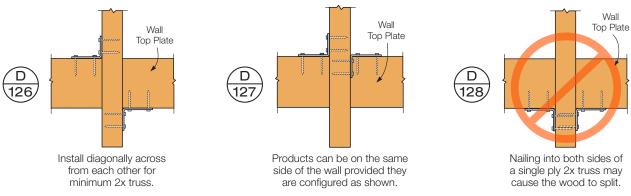


Installations using multiple connectors are limited to specific table references.

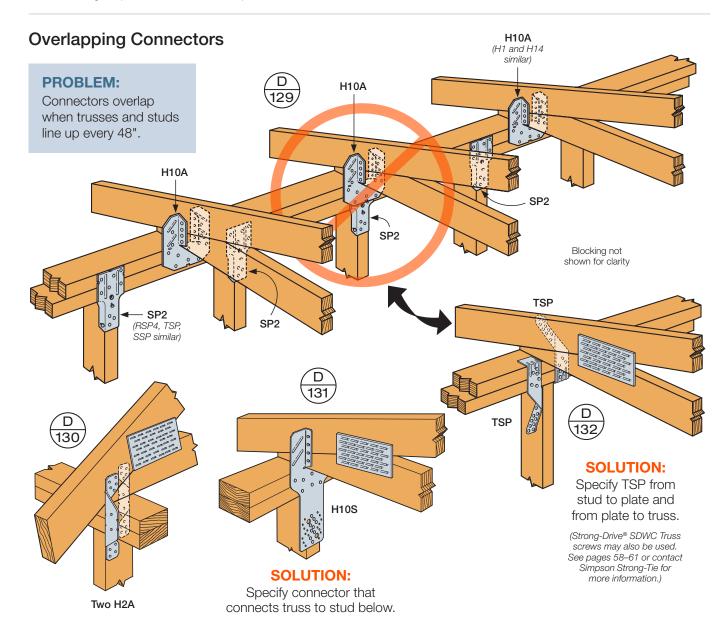


Load Path Installation Considerations (cont.)



Building Floor-to-Floor Straps

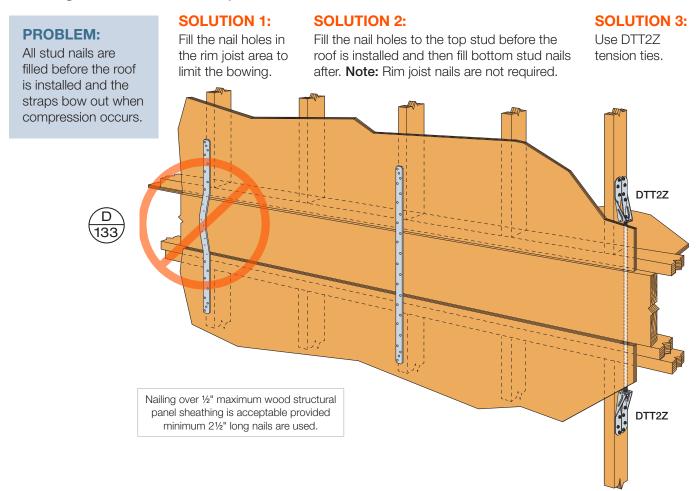


SOLUTION 4:

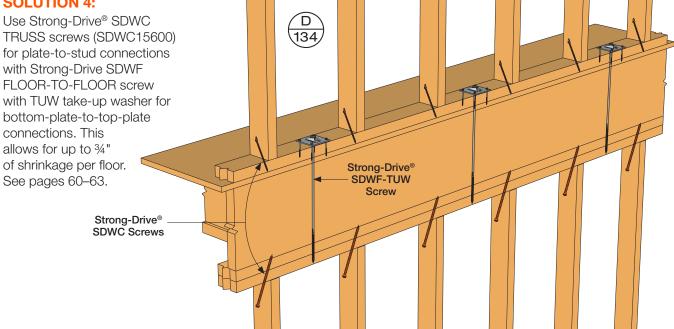

Load Path Installation Considerations (cont.)




Mislocated Truss Anchors

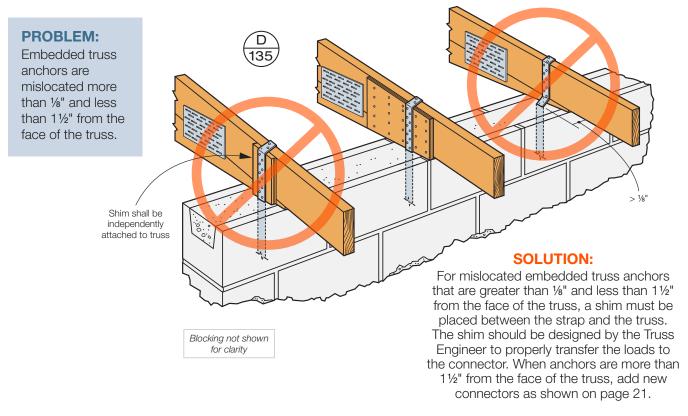



PROBLEM:

Wood has very low tension capacity perpendicular to grain.

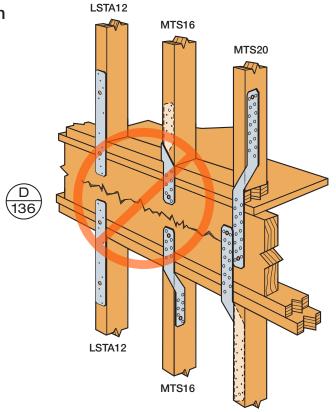

SOLUTION:


Avoid cross-grain tension by strapping stud to stud (see D133, page 52) or by mechanically reinforcing the lumber by overlapping MTS straps on rim board beyond centerline of rim board (as drawn).

Fastener Types



Many Simpson Strong-Tie connectors have been designed and tested for use with specific types and sizes of fasteners. The specified quantity, type and size of fastener must be installed in the correct holes on the connector to achieve published loads. Other factors, such as fastener material and finish, are also important. Incorrect fastener selection or installation can compromise connector performance and could lead to failure.

Simpson Strong-Tie does not offer all of these fasteners. For more information about fasteners, see our Fastening Systems catalog or access our Fastener Finder software at www.strongtie.com/software.

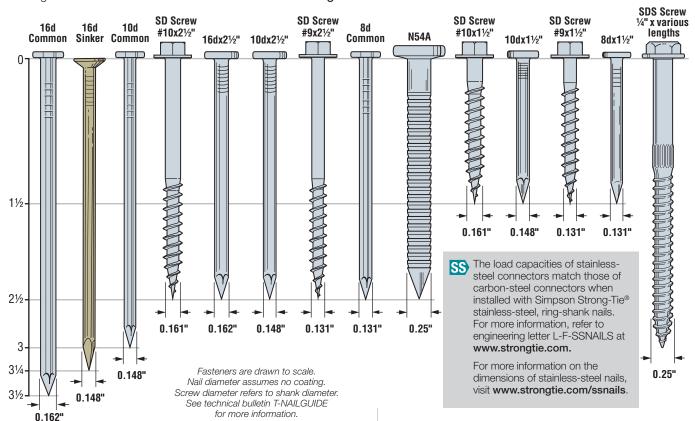

Load Adjustment Factors for Optional Nails Used with Straight Straps

Catalog Nail	Replacement	Adjustment Factor
	10dx1½ (0.148"x1½")	0.842
16d common (0.162"x31/2")	10d common (0.148"x3") 16d sinker (0.148"x31/4")	0.84
16d common (0.162"x31/2")	16dx2½ (N16) (0.162"x2½")	1.00
10d common (0.148"x3") 16d sinker (0.148"x31/4")	10dx1½ (0.148"x1½")	1.00³
10d common (0.148"x3")	16d sinker (0.148"x31/4")	1.00
8d common (0.131"x21/2")	8dx11/2 (0.131"x11/2")	1.00
10d common (0.148"x3")	8d common (0.131"x21/2")	0.83

- 1. For straps installed over sheathing, use a 21/2" long nail minimum.
- 2. Where noted, use 0.80 for 10 ga., 11 ga. and 12 ga. products when
- 3. Where noted, use 0.92 for 10 ga., 11 ga. and 12 ga. products when using SPF lumber.
- 4. For applications involving pneumatic nails, refer to Simpson Strong-Tie® bulletin T-PNEUMATIC.



ROUND HOLES

Purpose: to fasten a connector to wood. Fill Requirements: always fill, unless noted otherwise.



OBROUND HOLES

Purpose: to make fastening a connector in a tight location easier.

Fill Requirements: always fill.



HEXAGONAL HOLES

Purpose: to fasten a connector to concrete or masonry.

Fill Requirements: always fill when fastening a connector to concrete or masonry.



TRIANGULAR HOLES

Purpose: to increase a connector's strength or to achieve maximum strength.

Fill Requirements: when the Designer specifies maximum nailing.



DIAMOND HOLES

Purpose: to temporarily fasten a connector to make installing it easier.


Fill Requirements: none.

Strong-Drive® SDS HEAVY-DUTY CONNECTOR Screw



The Simpson Strong-Tie® Strong-Drive® SDS Heavy-Duty Connector screw is a 1/4" diameter structural wood screw ideal for various connector installations as well as wood-to-wood applications. It installs with no predrilling and has been extensively tested in various applications. The SDS Heavy-Duty Connector screw is improved with a patented easy-driving 4CUT™ point and a corrosionresistant double-barrier coating. It is available in a corrosion-resistant, double-barrier coating and in Type 316 stainless steel for use in severe corrosion environments.

WARNING: Industry studies show that hardened fasteners can experience performance problems in wet or corrosive environments.

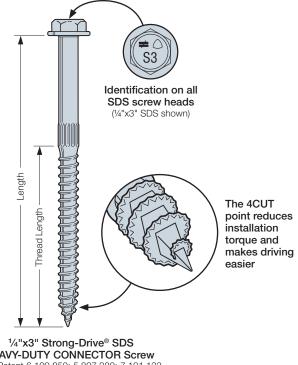

HEAVY-DUTY CONNECTOR Screw U.S. Patent 6,109,850; 5,897,280; 7,101,133

Strong-Drive® SDS **HEAVY-DUTY CONNECTOR** Screw

						DF	/SP Allow	able Load	ls³ (lb.)			SPI	HF Allow	able Load	is³ (lb.)	
			Thread	Fasteners		5	Shear (100))		Withdrawal ⁴		S	Shear (100)		Withdrawal ⁴
	Size (in.)	Model No. ⁷	Length	per	Wood Side Plate ² Steel Side Plate			(100)	Wood Side Plate ²		Steel Side Plate		(100)			
		NO.	(in.)	.) Carton ⁵	1½"	1¾" SCL	16 ga.	14 ga. and 12 ga.	10 ga. or Greater	Wood or Steel Side Plate	1½"	1¾" SPF LVL	16 ga.	14 ga. and 12 ga.	10 ga. or Greater	Wood or Steel Side Plate
SS	1/4 x 1 1/2	SDS25112	1	1,500	_	_	250	250	250	170	_	_	180	180	180	120
SS	1/4 x 2	SDS25200	11/4	1,300	_	_	250	290	290	215	_	_	180	210	210	150
SS	1/4 x 21/2	SDS25212	1 1/2	1,100	190	_	250	390	420	255	135	_	180	280	300	180
SS	1/4 x 3	SDS25300	2	950	280	_	250	420	420	345	200	_	180	300	300	240
SS	1/4 x 31/2	SDS25312	21/4	900	340	340	250	420	420	385	245	245	180	300	300	270
SS	1/4 x 4 1/2	SDS25412	23/4	800	350	340	250	420	420	475	250	245	180	300	300	330
	1⁄4 x 5	SDS25500	23/4	500	350	340	250	420	420	475	250	245	180	300	300	330
	1/4 x 6	SDS25600	31/4	600	350	340	250	420	420	560	250	245	180	300	300	395
	1/4 x 8	SDS25800	31/4	400	350	340	250	420	420	560	250	245	180	300	300	395

- 1. Strong-Drive® SDS Heavy-Duty Connector screws install best with a low-speed 1/2" drill with a 3/8" hex head driver.
- 2. All applications are based on full penetration into the main member.
- 3. Allowable loads are shown at the wood load duration factor of $C_D = 1.00$. Loads may be increased for load duration per the building code up to $a C_D = 1.60$.
- 4. Withdrawal loads shown are in pounds (lbs.) and are based on the entire threaded section installed into the main member. If thread penetration into the main member is less than the thread length as shown in the table,
- reduce allowable load by 172 lb. x inches of thread not in main member. Use 121 lb./inch for SPF
- 5. Fasteners per Carton represents the number of screws which are available in bulk packaging. Screws are also available in mini-bulk and retail packs. Refer to Simpson Strong-Tie® List Price book or contact Simpson Strong-Tie for more information.
- 6. LSL wood-to-wood applications that require 4½", 5", 6" or 8" Strong-Drive SDS Heavy-Duty Connector screws are limited to interior-dry use only.
- 7. Add "SS" to model no. for Type-316 stainless steel.

Strong-Drive® SD CONNECTOR Screw



Simpson Strong-Tie offers the Strong-Drive® SD Connector screw for use with our connectors. Designed to replace nails in certain products, the load-rated SD Connector screw has been tested and approved for use in many popular Simpson Strong-Tie® connectors. In certain applications, screws are easier and more convenient to install than nails, and the single-fastener load values achieved by the SD9 and SD10 exceed those of typical 10d common or 16d common nails, respectively. In addition, the galvanized coating makes the SD Connector screw ideal for interior and most exterior conditions.

The Strong-Drive® SD Connector screw features an optimized shank, specifically designed for capability with the fastener holes in Simpson Strong-Tie connectors. The hex head virtually eliminates cam-out and helps avoid stripping of the head during installation. The sharp point of the screw enables fast starts, and the patented serrated threads reduce torque for improved drivability.


For a current list of approved connectors, load values and applications, visit www.strongtie.com/strongdrive.

Product Information

Model No.	Shank Size	Length (in.)		
SD9112R100				
SD9112R500		1½		
SD9112MB	#9			
SD9212R100	(0.131")			
SD9212R500		2½		
SD9212MB				
SD10112R100				
SD10112R500		1½		
SD10112MB	#10			
SD10212R100	(0.161")			
SD10212R500		2½		
SD10212MB				



The Simpson Strong-Tie® Strong-Drive® SD Connector screw is the only screw approved for use with our connectors.

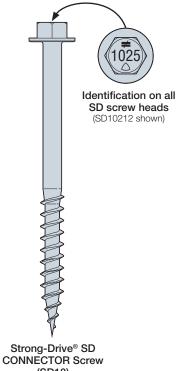

(SD10) (SD9 similar) U.S. Patent 7,101,133

Strong-Drive® SD CONNECTOR Screw

		Thread		ble Loads (lb.) 00)	SPF/HF Allowable Loads (lb.) (100)			
Size (in.)	Model No.	Thread Length (in.)	Shear Steel Side Plate	Withdrawal	Shear Steel Side Plate	Withdrawal		
		20 ga 12 ga.			20 ga 12 ga.			
#9x11/2	SD9112	1	171	173	112	122		
#9x2½	SD9212	1	200	173	112	122		
#10x1½	SD10112	1	173	173	138	122		
#10x2½	SD10212	1	215	1/3	165	122		

- 1. Withdrawal loads and steel-side-plate shear loads are based on testing per AC233.
- 2. Allowable loads are shown at the wood load duration factor of C_D = 1.00. Loads may be increased for load duration per the building code up to a $C_D = 1.60$.
- 3. Withdrawal loads are based on the entire threaded section installed into the main member.
- 4. Visit www.strongtie.com for wood-to-wood shear values and wood-side-plate details.


Sole Plate and Ledger Connections



Strong-Drive® SDWS **TIMBER** Screw Allowable Shear Values for Sole Plate-to-Rim Connections

				Allowable Loads (lb.)									
Size (in.)	Model No.	Sole Plate Nominal Size	Minimum Penetration into Rim Board (in.)	2x DF/SP Rim Board		2x SPF/HF Rim Board		1¼" Min. LVL Rim Board		1¼" Min. LSL Rim Board			
				DF/SP Sole Plate	SPF/HF Sole Plate	DF/SP Sole Plate	SPF/HF Sole Plate	DF/SP Sole Plate	SPF/HF Sole Plate	DF/SP Sole Plate	SPF/HF Sole Plate		
0.220 x 4	SDWS22400DB	2x	1.75	345	295	295	295	275	275	275	275		
0.220 x 5	SDWS22500DB	2x	2	345	295	295	295	275	275	275	275		
0.220 x 6	SDWS22600DB	2x or 3x	2	345	295	295	295	275	275	275	275		

- 1. Allowable loads are based on testing per ICC-ES AC233 and are limited to parallel-to-grain loading.
- 2. Allowable loads are shown at the wood load duration factor of C_D = 1.00. Loads may be increased for load duration by the building code up to a $C_D = 1.60$.
- 3. Minimum spacing of the SDWS is 6" o.c., minimum end distance is 6", and minimum edge distance is %".
- 4. Wood structural panel up to 11/8" thick is permitted between the sole plate and rim board provided it is fastened to the rim board per code and the minimum penetration of the screw into the rim board is met.
- 5. A double 2x sole plate is permitted provided it is independently fastened per the code and the minimum screw penetration per the table is met.



Strong-Drive® SDWS **TIMBER Screw** U.S. Patent 5,897,280; 7.101.133

Strong-Drive® SDWS TIMBER Screw Allowable Shear Loads - Douglas Fir-Larch and Southern Pine


Size Dia.x L (in.)	Model No.	Thread Length TL	DF/SP Allowable Loads Shear (100) Wood Side Member Thickness (in.)									
()		(in.)	1.5	2	2.5	3	3.5	4	4.5	6	8	
0.220 x 3	SDWS22300DB	11/2	255	_	_	_	_	_	_	_		
0.220 x 4	SDWS22400DB	2%	405	405	305	_	_	_	_	_	_	
0.220 x 5	SDWS22500DB	23/4	405	405	360	360	325	_	_	_		
0.220 x 6	SDWS22600DB	23/4	405	405	405	405	365	365	355	_	_	
0.220 x 8	SDWS22800DB	23/4	405	405	405	405	395	395	395	395		
0.220 x 10	SDWS221000DB	23/4	405	405	405	405	395	395	395	395	395	


See footnotes below.

Strong-Drive® SDWS TIMBER Screw Allowable Shear Loads - Spruce-Pine-Fir and Hem-Fir

Size Dia.x L	Model	Thread Length	SPF/HF Allowable Loads Shear (100)										
(in.)	No.	TĽ		Wood Side Member Thickness (in.)									
, ,		(in.)	1.5	2	2.5	3	3.5	4	4.5	6	8		
0.220 x 3	SDWS22300DB	1½	190	_	_	_	_	_	_	_	_		
0.220 x 4	SDWS22400DB	2%	385	285	215	_	_	_	_	_	_		
0.220 x 5	SDWS22500DB	23/4	405	290	290	290	195	_	_	_	_		
0.220 x 6	SDWS22600DB	23/4	405	365	365	365	310	310	210	_	_		
0.220 x 8	SDWS22800DB	23/4	405	365	365	365	310	310	280	280	_		
0.220 x 10	SDWS221000DB	23/4	405	365	365	365	310	310	280	280	280		

- 1. All applications are based on full penetration into the main member. Full penetration is the screw length minus the side member thickness.
- 2. Allowable loads are shown at the wood load duration factor of C_D = 1.0. Loads may be increased for load duration per the building code up to a $C_D = 1.6$. Tabulated values must be multiplied by all applicable adjustment factors per the NDS.
- 3. Minimum fastener spacing requirements to achieve table loads: 6" end distance, 17/16" edge distance, %" between staggered rows of fasteners, 4" between non-staggered rows of fasteners and 8" between fasteners in a row.
- 4. For in-service moisture content greater than 19%, use $C_M = 0.7$.



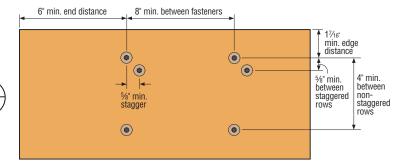

Strong-Drive® SDWS TIMBER Screw Spacing Requirements




Strong-Drive® SDWC TRUSS Screw Allowable Roof-to-Wall Connection Loads - DFL, SP, SPF, HF1-8


	Minor		Thread			Allowab	le Loads			
Model No.	Diameter	Length (in.)	Length		DF/SP		SPF/HF			
	(in.)		(in.)	Uplift	F ₁	F ₂	Uplift	F ₁	F ₂	
SDWC15600	0.152	6	53/4	615	130	225	485	115	192	

- 1. Loads have been increased for wind and earthquake (CD = 1.6); no further increases allowed. Reduce when other loads govern.
- 2. Allowable loads are for a Strong-Drive® SDWC Truss screw installed per the "Recommended" or "Optional" installation instructions. The Strong-Drive SDWC Truss screw is to be installed through a double 2x top plate into a minimum 2x4 truss or rafter.
- 3. A Strong-Drive SDWC Truss screw may be used in each ply of 2- or 3-ply rafters or trusses. The allowable uplift load for each screw shall be multiplied by 0.90, but may be limited by the capacity of the plate or the connection between the top plate to the framing below. Strong-Drive SDWC Truss screws in multi-ply assemblies must be spaced a minimum of 11/2" o.c.
- 4. Screws are shown installed on the interior side of the wall. Installations on the exterior side of the wall are acceptable when the rafter or truss overhangs the top plates a minimum of 31/2".
- 5. For Uplift Continuous Load Path, top-plate-to-stud connectors such as the H2.5A, TSP or MTS12 must be located on the same side of the wall as the screw.
- 6. When the screw is loaded simultaneously in more than one direction, the allowable load must be evaluated using the following unity equation: (Design Uplift ÷ Allowable Uplift) + (Design F1 ÷ Allowable F1) + (Design $F_2 \div Allowable F_2$) ≤ 1.0 .
- 7. Table loads do not apply to trusses with end-grain bearing.
- 8. Top plate, stud and top-plate splice fastened per applicable Building Code.

Typical Roof-to-Wall Connection

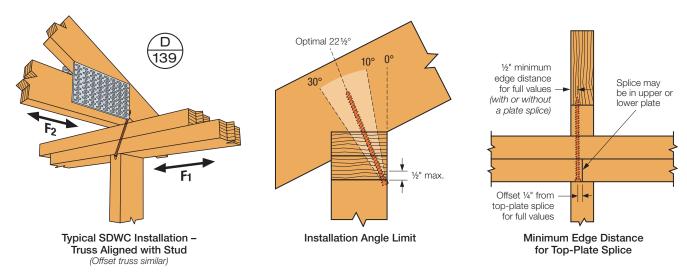

Optional Roof-to-Wall Connection

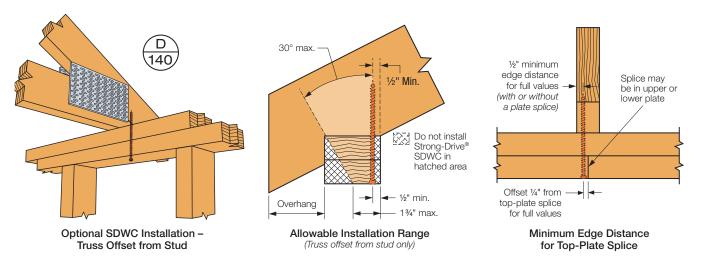

Roof to Wall (cont.)




Model	Minor Diameter	Length	Thread Length	Quantity	Allowable Up	lift Loads (lb.)	Configuration	
No.	(in.)	(in.)	(in.)	Required	DF/SP	SPF/HF	Configuration	
	0.152		5¾		1,200	1,045	А	
SDWC15600		6		2	1,195	1,195	В	
2DMC13000					905	850	С	
					1,115	960	D	

- 1. Loads have been increased for wind and earthquake loading (CD = 1.6) with no further increase allowed; reduce where other
- 2. For Uplift Connection Load Path, the Designer shall verify complete continuity of the uplift load path.
- 3. When cross-grain tension cannot be avoided, supplemental reinforcement shall be considered by the Designer.
 - Truss or rafter 1 31/2" SDWC15600 overhang 1 1/2 3/4"-11/4"-

CONFIGURATION A (Truss Aligned with Stud) Install through Top Plate into Truss/Rafter Both screws installed at a 4°-14° angle,


offset 3/4" to 11/4" from opposite edges of the top plate.

- 4. The SDWC screws shall not interfere with other fasteners or truss plates. Where truss plates must be penetrated for Configuration D, a truss Designer approval is required in accordance with ANSI/TPI 1-2007/2014, Section 7.5.3.4 and 8.9.2. To predrill through truss plate, use a 1/8" drill bit.
- 5. The metal installation guide provided with the screw is angled at 22.5° and can be used for Configurations C & D; proper installation angles for all configurations are the responsibility of the installer.
- 6. SDWC screws must be offset minimum 1/4" from top plate splices for full values
- 7. Loads assume minimum overhang of 31/2".




CONFIGURATION B (Truss Offset from Stud) Install through Top Plate into Truss/Rafter

Both screws installed vertically ±5° into the center of the truss/rafter from the underside of the top plate, ½" to 1" from opposite edges of the top plate.



CONFIGURATION C Install through Top Plate into Truss/Rafter

Both screws installed at a 16°-30° angle, offset 1/2" from the opposite edges of truss/rafter. Use metal installation guide included in screw kits for optimal 22.5° installation.

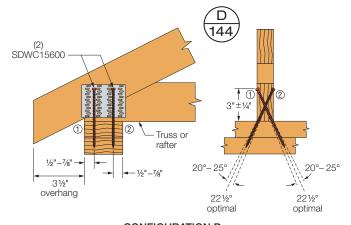

CONFIGURATION D Install through Truss/Rafter into Top Plate

Both screws installed at a 20°-25° angle with a 1/2" to 7/8" offset from the opposite edges of top plate and $3"\pm \frac{1}{4}"$ above top plate. Use metal installation guide included in screw kits for optimal 22.5° installation. To predrill through truss plates, use a 1/8" drill bit.


Stud to Plate (Wide Face)




	No. of	Minor		Thread	Plate		Allowable I	Loads (160)		
Model No.	Screws	Diameter	Length (in.)	Length	Plate Size	DF	/SP	SPF/HF		
110.	Installed	(in.)	(,	(in.)	0.20	Uplift	F ₂	Uplift	F ₂	
	1					360	215	310	153	
SDWC15450	2	0.152	41/2	41/4	2x	690	390	595	280	
	3					1,035	585	895	420	
	1		6	5¾	2x	450	189	310	153	
SDWC15600	2	0.152				865	345	595	280	
	3					1,295	515	895	420	
	1					590	177	510	152	
SDWC15600	2	0.152	6	5¾	(2) 2x	1,135	320	980	275	
	3					1,700	485	1,470	415	

- 1. Loads have been increased 60% for wind or earthquake loading ($C_D = 1.6$) with no further increases allowed; reduce where other loads govern.
- 2. Allowable loads are for Strong-Drive® SDWC installed per the installation
- 3. The Strong-Drive SDWC15450 is to be installed through the face of 2xstud into a single 2x bottom plate over a concrete/masonry foundation.
- 4. The Strong-Drive SDWC15600 is to be installed through the face of 2x stud into a single 2x bottom plate over a wood floor system.
- 5. The Strong-Drive SDWC15600 is to be installed through the face of 2x stud into a double 2x top or bottom plate.
- 6. Double-top plates shall be fastened together as required by
- 7. When the screw is loaded simultaneously in more than one direction, the allowable load must be evaluated using the following unity equation: (Design Uplift \div Allowable Uplift) + (Design $F_2 \div$ Allowable $F_2) \le 1.0$.


Stud-to-Plate Connections



Stud-to-Bottom-Plate Connection over Concrete/Masonry Foundation (This application requires SDWC15450.)



over Wood Floor (Strong-Drive SDWC15600 shown. See pages 62-63 for Strong-Drive® SDWF FLOOR-TO-FLOOR Connections)



Stud-to-Top Plate Connection (This application requires SDWC15600)



Strong-Drive® SDWC15450-KT and SDWC15600-KT contain:

- (50) Strong-Drive SDWC Truss screws
- (1) Matched-tolerance driver bit (Part no. BIT30T-2-RC3; also sold separately)
- (1) Metal installation guide tool
 - SDWC-GUIDE (for SDWC15600 only; also sold separately)
 - SDWC-GUIDE275 (for SDWC15450 only: also sold separately)

Strong-Drive® SDWC15450B-KT and SDWC15600B-KT contain:


- (500) Strong-Drive SDWC Truss screws
- (2) Matched-tolerance driver bit (Part no. BIT30T-2-RC3; also sold separately)
- (2) Metal installation guide tool
 - SDWC-GUIDE (for SDWC15600 only; also sold separately)
 - SDWC-GUIDE275 (for SDWC15450 only: also sold separately)

Stud to Plate (Narrow Face)




			_	Minor		Thread	Dista	Allowable Loads (lb.)				
	Type of Connection	Model No.	Qty. Required	Diameter	Length (in.)	Length	Plate Size	DF/SP		SPF	/HF	
	oomiootion no.			(in.)	(")	(in.)	0.20	Uplift	F ₂	Uplift	F ₂	
	1	SDWC15600 ¹	1	0.152	6	5 ¾	(2) 2x	590	170	510	145	
ĺ	2	SDWC15600 ²	1	0.152	6	5 ¾	2x	450	155	310	135	
Ì	3	SDWC15450 ³	1	0.152	4 ½	4 1/4	2x	295	150	255	130	


- 1. Loads have been increased for wind and earthquake (CD = 1.6); no further increase is allowed; reduce when other loads govern.
- 2. The SDWC15600 is to be installed through the narrow face of 2x stud into a single 2x bottom plate over a wood floor system.
- 3. The SDWC15450 is to be installed through the narrow face of 2x stud into a single 2x bottom plate over a concrete/masonry foundation.
- 4. Double-top plates shall be fastened together as required by applicable Code.
- 5. The F₂ direction is perpendicular to the wall. When the screw is loaded simultaneously in more than one direction, the allowable load must
- be evaluated using the following equation: (Design Uplift \div Allowable Uplift) + (Design $F_2 \div$ Allowable F_2) ≤ 1.0
- 6. One SDWC screw per stud maximum when installed in the narrow face of the stud. Where the SDWC screws are installed on multiple adjacent studs, the minimum spacing between screws must be 11/2"
- 7. For uplift Continuous Load Path, connections in the same area (i.e. truss to plate connector and plate to stud connector) must be on the same side of the wall.




1 Narrow Face of Stud-to-Top Plate Connection (This application requires SDWC15600)




Installation Angle Range




Minimum Edge Distance and Splice Offset Requirements




2 Narrow Face of Stud-to-Bottom Plate Connection over Wood Floor (SDWC15600 shown)



Installation Angle Range




Minimum Edge Distance and Splice Offset Requirements



3 Narrow Face of Stud-to-Bottom Plate Connection over Masonry/Concrete Foundation (This application requires SDWC15450)

20° 30° Optimal 22°

Installation Angle Range



Minimum Edge Distance and Splice Offset Requirements


Floor to Floor



Strong-Drive® SDWF **FLOOR-TO-FLOOR** Screw Product Information and Withdrawal Loads

	Ci Thread		Alle	owable Joist I	Depth Below (Allowable Withdrawal per Thread Penetration (lb./in.)			
Model No Size (in.)		Length (in.)	Single Bottom Plate		Double Bottom Plate		(100)		
		(111.)	Min.	Max.	Min.	Max.	SP	DF	SPF
SDWF2716-TUW	0.27 x 16	5	81/2	10½	67/8	9		250	180
SDWF2720-TUW	0.27 x 20	5	121/2	141/2	10%	13	205		
SDWF2724-TUW	0.27 x 24	5	161/2	181⁄2	14%	17	295		
SDWF2726-TUW	0.27 x 26	5	181⁄2	201/2	16%	19			

- 1. Allowable loads may be increased for load duration up to $C_D = 1.6$.
- 2. Joist depth listed based on the 3/4" subfloor and 3" of thread penetration into double top plates.
- 3. For joist depths of 111/4", 11% and 16", please refer to L-F-SDWFALTHT at www.strongtie.com.

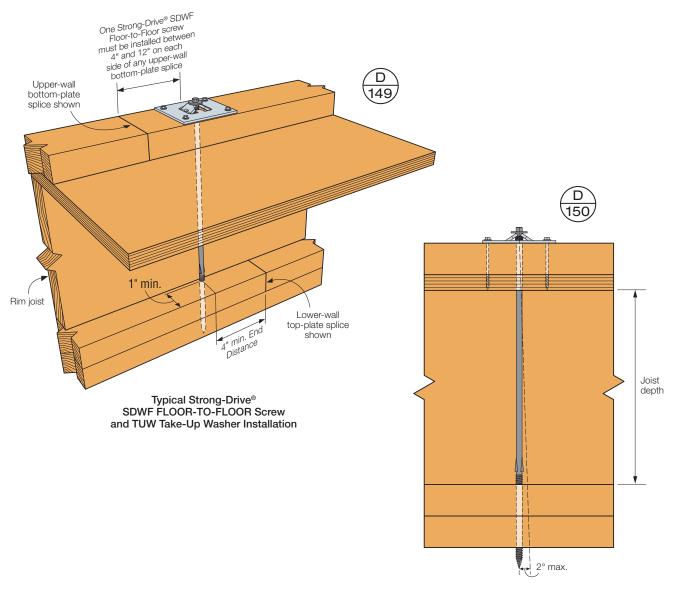

Typical Strong-Drive® SDWF FLOOR-TO-FLOOR Screw Angle Limit Installation

Floor to Floor (cont.)




Strong-Drive® SDWF FLOOR-TO-FLOOR Screw Uniform Uplift Loads

Maximum	Strong-D	Strong-Drive SDWF FLOOR-TO-FLOOR Screw Spacing (in.) Along Wall Bottom Plate for Wind Uplift									
Bottom Plate		Interstory Unit Wind Uplift Lbs. per Lineal Foot (plf)									
Single 2x4	4 100 plf 150 plf 200 plf 250 plf 300 plf 350 plf 400 plf 450 plf 500 plf 5										600 plf
SP	46	40	36	34	30	28	26	24	24	22	22
DF	48	42	38	34	32	30	30	26	24	22	20
SPF	46	40	36	34	32	30	26	22	20	18	16
Single 2x6	100 plf	150 plf	200 plf	250 plf	300 plf	350 plf	400 plf	450 plf	500 plf	550 plf	600 plf
SP	56	48	44	40	38	36	34	34	32	30	28
DF	56	48	44	40	38	34	30	26	24	22	20
SPF	52	46	42	38	34	30	26	22	20	18	16

Strong-Drive® SDWF FLOOR-TO-FLOOR Screw Concentrated Uplift Loads

	Sin	gle Strong-	Drive SDWI	-TUW	Double Strong-Drive SDWF-TUW				
Model No	Allowable Tension Load (160)			Deflection at Highest Allowable Load	Allowable Tension Load (160)			Deflection at Highest Allowable Load	
	SP	DF	SPF	(in.)	SP	DF	SPF	(in.)	
SDWF2716-TUW			005	0.005	0.070	0.105	1 700		
SDWF2720-TUW	1,410	1,200						0.142	
SDWF2724-TUW			865	0.095	2,270	2,125	1,730	0.142	
SDWF2726-TUW									

- 1. Spacing listed based on the smallest of the following: single bottom plate bending allowable load, single bottom plate deflection limited to spacing/240 and 1/4" max; screw allowable withdrawal load; and take-up washer allowable load.
- 2. Withdrawal load is based on a $C_D = 1.6$ and minimum 3" penetration into lowerwall double top plates.
- 3. Stud-to-plate connections are required to complete the load path. These connections shall not exceed the lesser of 48" o.c. or Strong-Drive® SDWF Floor-To-Floor screw spacing.
- 4. Spacing values listed for SP lumber consider new base values adopted by AWC on June 1, 2013.
- 5. Spacing does not apply for joist depths of 111/4", 117/8" and 16". Please refer to L-F-SDWFALTHT at www.strongtie.com.
- 1. Allowable loads listed include a wood load duration factor of CD = 1.6 for wind or earthquake loading with no further increase allowed.
- 2. Single and double Strong-Drive SDWF applications listed are for concentrated load uplift restraint conditions (i.e., end of header, at girders, or at the end of shearwalls).

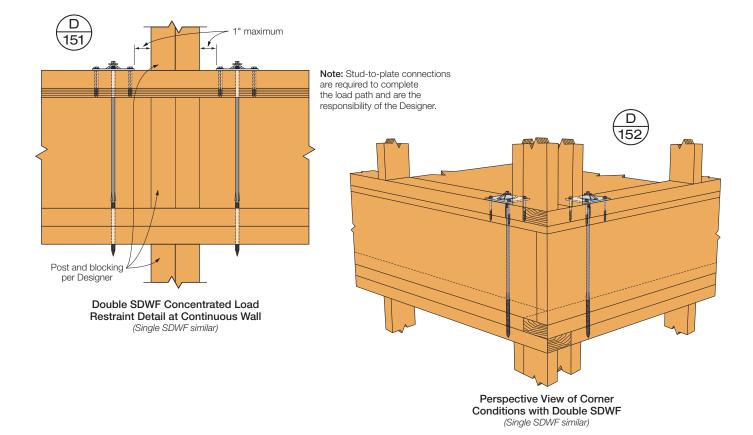


Subfloor Attachment



Strong-Drive® WSNTL SUBFLOOR Screw

Fasteners for the Simpson Strong-Tie® Quik Drive® auto-feed screw driving systems offer superior performance and reduced installation time in subfloor applications. The holding power of screws reduces the gaps that cause floor squeaks, and the tool extension enables stand-up-and-drive installation.


CODES: ICC-ES ESR-1472; City of L.A. RR25661; Florida FL 13731

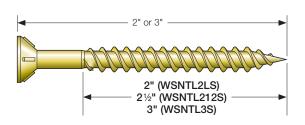

Allowable Shear (in Pounds per Foot) for Wood Structural Panel Diaphragms with Framing of Douglas Fir-Larch or Southern Pine for Wind or Seismic Loading

		Minimum		BLOCKED D	IAPHRAGMS		UNBLOCKED	DIAPHRAGMS
Panel Grade	Minimum Nominal Panel	Nominal Width of Framing Members at Adjoining Panel	(all cases),	acing (inches) a at continuous p and 4), and at a	anel edges par	allel to load		inches, maximum, rt edges ⁶
	Thickness (in.)	Edges and	6	4	2 ½ ⁷	27	Case 1 (no unblocked	
		Boundaries ^{4,5} (in.)	Screw	Spacing (inches	s) at Other Pane	el Edges	edges or continuous	All other configurations (Cases 2, 3, 4, 5 and 6)
		(111.)	6	6	4	3	joints parallel to load)	
	3/8	2	270	360	530	600	240	180
Structural 1/0SB		3	300	400	600	675	265	200
Structural 1/03B	15/32	2	320	425	640	730	285	215
		3	360	480	720	820	320	240
	3/8	2	240	320	480	545	215	160
	78	3	270	360	540	610	240	180
Sheathing single	7/16	2	255	340	505	575	230	170
floor, and other	716	3	285	380	570	645	255	190
grades covered in	15/32	2	290	385	575	655	255	190
DOC PS1 and PS2	732	3	325	430	650	735	290	215
	19/32	2	320	421	640	730	285	215
	732	3	360	480	720	820	320	240

- 1. Minimum fastener penetration of 11/4" into the framing member is required.
- 2. For wind design, shear capacities may be increased 40% per section 2306.2.1 of the 2009 IBC and section 2306.2 of the 2012 IBC.
- For shear loads of normal or permanent load duration as defined by the AF&PA NDS, the values in the table above must be multiplied by 0.63 or 0.56, respectively.
- The minimum nominal width of framing members not located at boundaries or adjoining panel edges must be 2 inches.
- 5. Framing at adjoining panel edges must be 3 inches nominal or wider, and screws must be staggered where both of the following conditions are met: (1) screws penetrate into framing more than 11/2 inches and (2) screws are spaced 3 inches o.c. or less.
- 6. Space screws maximum 12 inches o.c. along intermediate framing members (6 inches o.c. where supports are spaced 48 inches o.c.).
- 7. Framing at adjoining panel edges must be 3-inch nominal or wider, and screws must be staggered where screws are spaced 2 inches or 21/2 inches on center.
- 8. See ESR-1472, Table 1 for illustrations showing Cases 1 through 6.
- 9. See ESR-1472 for allowable shear loads for high-load diaphragms.
- 10. WSNTL withdrawal and pull-thru values exceed those for a 10d common nail
- 11. See ESR-1472 for high-load diaphragm design values.

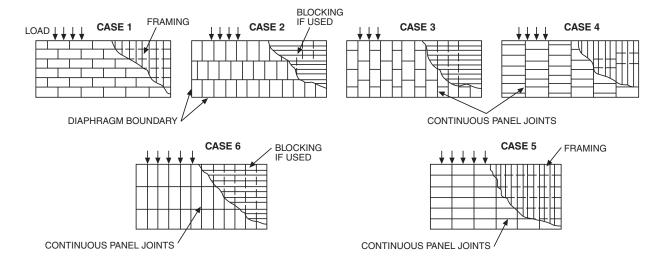

Titen® Concrete and Masonry Screws



Titen® screws are 3/16"- and 1/4"-diameter masonry screws for attaching various components to concrete and masonry. Available in hex and phillips head and both carbon and stainless steel (see the current Simpson Strong-Tie® Anchoring and Fastening Systems for Concrete and Masonry catalog for more information). Use with appropriately sized Titen® drill bits included with each box.

CAUTION: Industry studies show that hardened fasteners can experience performance problems in wet or corrosive environments. Steps must be taken to prevent inadvertent sustained loads. Overtightening and bending moments can initiate cracks detrimental to the hardened screw's performance. Use the Simpson Strong-Tie® Titen installation tool kit as it has a bit that is designed to reduce the potential for overtightening the screw.

Caution: Oversized holes in the base material will reduce or eliminate the mechanical interlock of the threads with the base material and will reduce the anchor's load capacity.

Titen® Allowable Tension and Shear Loads in Normal-Weight Concrete

				Critical		Tensio	n Load		Shear	Load
Dia. in.	Drill Bit Dia.	Embed. Depth in.	Critical Spacing in. (mm)	Edge Dist. in. (mm)		000 psi) Concrete		000 psi) Concrete	f' _C ≥ 2,000 psi (13.8 MPa) Concrete	
(mm)	in.	(mm)			Ultimate lb. (kN)	Allowable lb. (kN)	Ultimate lb. (kN)	Allowable lb. (kN)	Ultimate lb. (kN)	Allowable lb. (kN)
3/16 (4.8)	5/32	1 (25.4)	2 1/4 (57.2)	1 1/8 (28.6)	500 (2.2)	125 (0.6)	640 (2.8)	160 (0.7)	1,020 (4.5)	255 (1.1)
3/16 (4.8)	5/32	1 ½ (38.1)	2 1/4 (57.2)	1 1/8 (28.6)	1,220 (5.4)	305 (1.4)	1,850 (8.2)	460 (2.0)	1,670 (7.4)	400 (1.8)
1/4 (6.4)	3/16	1 (25.4)	3 (76.2)	1 ½ (38.1)	580 (2.6)	145 (0.6)	726 (3.2)	180 (0.8)	900 (4.0)	225 (1.0)
1/4 (6.4)	3/16	1 ½ (38.1)	3 (76.2)	1 ½ (38.1)	1,460 (6.5)	365 (1.6)	2,006 (8.9)	500 (2.2)	1,600 (7.1)	400 (1.8)



^{2.} Concrete must be minimum 1.5 x embedment.

Titen® Allowable Tension and Shear Loads in Face Shell of Hollow and Grout-Filled CMU

Dia.	Dia. Drill Embed. Critical Bit Depth Spacing		Critical Edge			8" Lightweigh Normal-Weight			
in.	Bit Dia.	Depth in. (mm)	Spacing in. (mm)	Dist. in. (mm)	Tensio	n Load	Shear Load		
(mm)	in.				Avg. Ult. lb. (kN)	Allowable lb. (kN)	Avg. Ult. lb. (kN)	Allowable lb. (kN)	
3/16 (4.8)	5/32	1 (25.4)	2 1/4 (57.2)	1 1/8 (28.6)	542 (2.4)	110 (0.5)	1,016 (4.5)	205 (0.9)	
1/4 (6.4)	3/16	1 (25.4)	3 (76.2)	1 ½ (38.1)	740 (3.3)	150 (0.7)	1,242 (5.5)	250 (1.1)	

^{1.} The tabulated allowable loads are based on a safety factor of 5.0.



Titen® **Hex-Head Screw** (Phillips flat-head screw available in white and standard blue)

^{2.} Maximum anchor embedment is 1 1/2" (38.1 mm).

Titen® Concrete and Masonry Screws (cont.)



Stainless-Steel Titen® Allowable Tension and Shear Loads in Normal-Weight Concrete

				Critical		Tensio	n Load		Shear	Shear Load		
Dia. in. (mm)	Drill Bit Dia.	Embed. Depth in.	Critical Spacing in.	Critical Edge Dist. in.	ge (13.8 MPa) st. Concrete		f' _c ≥ 4,000 psi (27.6 MPa) Concrete		$f'_c \ge 2,000 \text{ psi}$ (13.8 MPa) Concrete			
()	in.	(mm)	(mm)	(mm)	Ultimate lb. (kN)	Allowable lb. (kN)	Ultimate lb. (kN)	Allowable lb. (kN)	Ultimate lb. (kN)	Allowable lb. (kN)		
1/4 (6.4)	3/16	1 (25.4)	3 (76.2)	1 ½ (38.1)	600 (2.7)	150 (0.7)	935 (4.2)	235 (1.0)	760 (3.4)	190 (0.8)		
1/4 (6.4)	3/16	1 ½ (38.1)	3 (76.2)	1 ½ (38.1)	1,040 (4.6)	260 (1.2)	1,760 (7.8)	440 (2.0)	810 (3.6)	200 (0.9)		

^{1.} Maximum anchor embedment is 1 1/2" (38.1 mm).

Stainless-Steel Titen® Allowable Tension and Shear Loads in Face Shell of Hollow and Grout-Filled CMU

Dia.	Drill	Embed.	Critical	Critical Edge		lues for 6" or m-Weight or I		
in.	Bit Dia.	Depth in. (mm)	Spacing in. (mm)	Dist.	Tension Load		Shear Load	
(mm)	(mm) in.			in. (mm)	Ultimate lb. (kN)	Allowable lb. (kN)	Ultimate lb. (kN)	Allowable lb. (kN)
1/4 (6.4)	3/16	1 (25.4)	4 (101.6)	1 ½ (38.1)	550 (2.4)	110 (0.5)	495 (2.2)	100 (0.4)

^{1.} The tabulated allowable loads are based on a safety factor of 5.0.



Stainless-Steel **Hex-Head Screw** (Phillips flat-head screw also available)

^{2.} Minimum concrete thickness is 1.5 x embedment.

^{2.} Maximum anchor embedment is 1 1/2" (38.1 mm).


Titen HD® Heavy-Duty Screw Anchors



Titen HD® Tension and Shear Loads in Face Shell of 8-inch Lightweight, Medium-Weight and Normal-Weight Grout-Filled CMU

Size	Bit Embed. E				Values for 8-inch Lightweight, Medium-Weight or Normal-Weight Grout-Filled CMU		
(in.)	Dia. (in.)	Depth (in.)	Dist. (in.)	Dist. (in.)	Allowable Tension Load (100)	Allowable Shear Load (100)	
3/8	3/8	23/4	12	6	480	870	
1/2	1/2	3½	12	8	690	1,385	
5/8	5/8	41/2	12	10	1,060	2,085	
3/4	3/4	5½	12	12	1,600	3,000	

- 1. The tabulated allowable loads are based on a safety factor of 5.0 for installations under the IBC and IRC.
- 2. Values for 8-inch wide, lightweight, medium-weight and normal-weight concrete masonry units.
- 3. The masonry units must be fully grouted.
- 4. The minimum specified compressive strength of masonry, f'm, at 28 days is 1,500 psi.
- 5. Embedment depth is measured from the outside face of the concrete masonry unit (CMU).
- 6. Allowable loads may be increased 331/3% for short-term loading due to wind or seismic forces where permitted by code.
- 7. Grout-filled CMU wall design must satisfy applicable design standards and be capable of withstanding applied loads.
- 8. Refer to the Simpson Strong-Tie® Anchoring and Fastening Systems for Concrete and Masonry catalog (C-A-2016) for allowable loadadjustment factors for spacing edge and end distance.

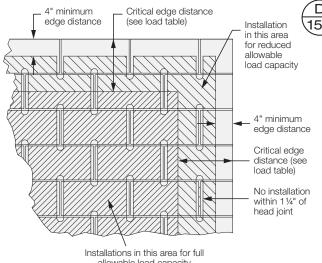

Shaded Area = Placement for Full and Reduced


and 6,623,228 Bearing Plate as required 154 0000 00 allowable load capacity 0 = 0 , . . . O o 00 0 Allowable Load Capacity in Grout-Filled CMU 300 90, D

Titen HD® Shear Loads in Normal-Weight Concrete, Load Applied Parallel to Concrete Edge

Size	Drill Bit	Embed.	Minimum Edge	Minimum End	Minimum Spacing	Shear Load Based on Concrete Edge Distance				
in.	Dia.	Depth in.	Dist.	Dist.	Dist.	$f'c \ge 2,500 \text{ psi (17.2 MPa) Concrete}$				
(mm)	in.	(mm)	in. (mm)	in. (mm)	in. (mm)	Ultimate lb. (kN)	Std. Dev. lb. (kN)	Allowable lb. (kN)		
		2¾ (70)	13/4 (45)		8	4,660 (20.7)	575 (2.6)	1,165 (5.2)		
1/2	1/2	31/4 (83)		8		_	_	1,530 (6.8)		
(12.7)		3½ (89)		(203)	(203)	6,840 (30.4)	860 (3.8)	1,710 (7.6)		
		4½ (114)				7,800 (34.7)	300 (1.3)	1,950 (8.7)		
		2 ³ / ₄ (70)				4,820 (21.4)	585 (2.6)	1,205 (5.3)		
5/8 (15.9)	5/8	31/4 (83)	1¾ (45)	10 (254)	10 (254)	_	_	1,580 (7.0)		
		3½ (89)				7,060 (31.4)	1,284 (5.7)	1,765 (7.9)		




^{2.} The minimum concrete thickness is 11/2 times the embedment depth.



Titen HD® anchor

U.S. Patent 5,674,035



Note: Rebar not shown for clarity.

High-Strength Anchoring Adhesives



Simpson Strong-Tie provides high-strength anchoring adhesives formulated for anchoring and doweling in concrete and masonry applications. Two of our most applicable solutions for high winds, epoxy-based SET-XP® and acrylic-based AT-XP®, are suitable for use under static and seismic loading conditions in cracked and uncracked concrete. Both offer easy hole cleaning without power-brushing required. When properly mixed, these low-odor adhesives will be a uniform, dark-teal color for easy post-installation identification.

Additional SET-XP Features:

- 1:1 two-component, high-solids, epoxy-based anchoring adhesive formula
- Cure times: 24 hours at 70°F, 72 hours at 50°F

Additional AT-XP Features:

- 10:1 two-component, high-strength, acrylic-based anchoring adhesive formula
- Dispenses easily in cold or warm environments and in below-freezing temperatures with no need to warm the cartridge
- Passed the demanding ICC-ES AC308 adverse-condition tests pertaining to reduced and elevated temperatures and long-term sustained loads

For more information about Simpson Strong-Tie anchoring solutions, visit www.strongtie.com.





SET-XP®

AT-XP®



Simpson Strong-Tie offers several software solutions and mobile apps designed to significantly enhance the specification and installation processes of its anchoring solutions.

Anchor Designer™ Software for ACI 318, ETAG and CSA - Anchorage design tool for structural engineers to satisfy the strength design provisions of ACI 318 Appendix D, CAN/CSA A23.3 Annex D, ETAG 001 Annex C or EOTA TR029 design methodologies.

Anchor Designer Software for Allowable Stress Design - This software enables you to analyze and design anchorages using the traditional allowable stress design method.

Adhesive Cartridge Estimator - This app quickly calculates the number of cartridges of Simpson Strong-Tie Anchoring Adhesive necessary to complete your specific installation.

Anchor Reference Tool – An app that easily identifies the Simpson Strong-Tie alternative to specified mechanical or adhesive anchor product(s), either by specified product name or code listing.

Resources and Links



Guidelines referred to here can be found in documents published by the Federal Emergency Management Administration (FEMA) and other organizations.

DHS-FEMA

National Flood Insurance Program www.floodsmart.gov

FEMA

www.fema.gov/library

- Home Builder's Guide to Coastal Construction (FEMA 499)
- Fact Sheet No. 10: Load Paths
- Fact Sheet No. 17: Use of Connectors
- Fact Sheet No. 28: Decks, Pools, and Accessory Structures
- Fact Sheet No. 30: Repairs, Remodeling, Additions, and Retrofitting
- Coastal Construction Manual (FEMA P-55)
- Local Officials Guide for Coastal Construction (FEMA P-762)
- Wind Retrofit Guide for Residential Buildings (FEMA P-804)
- Recommended Residential (foundation) Construction for Coastal Areas (FEMA P-550)

AMERICAN SOCIETY OF CIVIL ENGINEERS

www.asce.org

- Flood Resistant Design and Construction (ASCE 24)
- Minimum Design Loads for Buildings and Other Structures (ASCE 7)

INSTITUTE FOR BUSINESS AND HOME SAFETY

www.disastersafety.org

• Fortified for Safer Living guide

SIMPSON STRONG-TIE

www.strongtie.com

- Flood-Resistant Construction Guide (F-C-FLOODCON)
- High Wind-Resistant Construction Application Guide (F-C-HWRCAG16)
- Companion to the 2001 AF&PA Wood Frame Construction Manual for Wind Design (T-01WFCM)
- Connector-Anchor Selector software available at www.strongtie.com/software



PRODUCT	DETAIL DRAWING NO.	APPLICATION	PAGE
A23	D101	Lateral Load	44
	D58	Header to Wall Framing	34
404	D79	Post/Column to Beam	39
A34	D101, D102	Lateral Load	44
	D116	Gable End to Wall Framing	48
٨٥٢	D73	Wall to Pile/Girder	38
A35	D101, D103	Lateral Load	44
ABU44	D91	Post/Column to Foundation	42
ABU66	D91	Post/Column to Foundation	42
ABU88	D91	Post/Column to Foundation	42
AC4	D77	Post/Column to Beam	39
All-Thread Rod Configuration	D38	Hollow Column	26
BCS2-2/4	D80	Post/Column to Beam	39
BCS2-3/6	D80	Post/Column to Beam	39
CBSQ44-SDS2	D94	Post/Column to Foundation	42
CBSQ66-SDS2	D94	Post/Column to Foundation	42
CCCQM	D71	Beam to CMU or Concrete Pier	37
CCCQ-SDS2.5	D83	Beam to Corner Post/Column	40
CCQ	D81	Post/Column to Beam	39
CCQM	D63	Beam to CMU or Concrete Pier	36
CCTQM	D66	Beam to CMU or Concrete Pier	36
CCTQ-SDS2.5	D84	Beam to Corner Post/Column	40
CMST	D36	Hollow Column	26
CMST12	_	Stud to Band Joist	29
OIVIOT 12	D46	Stud to Stud	30
CMST14		Stud to Band Joist	29
CIVIST 14	D46	Stud to Stud	30
CNW	D38	Hollow Column	26
CPS4	_	Post/Column to Foundation	41
OF 34	D95	Post/Column to Foundation	42
CPS6	_	Post/Column to Foundation	41
	D95	Post/Column to Foundation	42
CPS7	_	Post/Column to Foundation	41
UP31	D95	Post/Column to Foundation	42
CPT44Z	D89	Post/Column to Foundation	41
CPT66Z	D89	Post/Column to Foundation	41
CPT88Z	D89	Post/Column to Foundation	41
	D6	Girder/Truss to Wood Wall Framing	17
	D45	Stud to Band Joist	29
CS16	D46	Stud to Stud	30
		Header to Wall Framing	34
	D72, D74	Wall to Pile/Girder	38



CS18 D46 Stud to Stud 3 CS20 D45 Stud to Band Joist 25 DETAL20 D18 Embedded Truss/Rafter to Masonry/Concrete 25 DSC2-SDS3 D122 Valley Truss to Roof Framing 45 DSC5-SDS3 D122 Valley Truss to Roof Framing 46 DSP D41 Top Plates to Stud 26 — Stud to Band Joist 26 — Stud to Sill Plate 35 — Header to Wall Framing 36 DTT1Z Holdowns 44 — Girder/Truss to Wood Wall Framing 17 D22 Girder/Truss to Masonry/Concrete 26 D46 Stud to Stud 36 DTT2Z — Header to Wall Framing 37 D60 Stemwall/Crawlspace 38 D60 Stemwall/Crawlspace 39 Holdowns 44	29 30 29 30 20 49
D46 Stud to Stud Stud to Band Joist 22	29 80 20 49
CS20 D46 Stud to Stud 3 DETAL20 D18 Embedded Truss/Rafter to Masonry/Concrete 2 DSC2-SDS3 D122 Valley Truss to Roof Framing 4 DSC5-SDS3 D122 Valley Truss to Roof Framing 4 DSP D41 Top Plates to Stud 2 D45 Stud to Band Joist 2 — Stud to Sill Plate 3 — Header to Wall Framing 3 DTT1Z Holdowns 4 — Girder/Truss to Wood Wall Framing 1 D22 Girder/Truss to Masonry/Concrete 2 D46 Stud to Stud 3 DTT2Z Header to Wall Framing 3 DFT2Z Header to Wall Framing 3 DF	80 20 19
DETAL20 D18 Embedded Truss/Rafter to Masonry/Concrete DSC2-SDS3 D122 Valley Truss to Roof Framing 4 DSC5-SDS3 D122 Valley Truss to Roof Framing 4 DSC5-SDS3 D122 Valley Truss to Roof Framing 4 DSC5-SDS3 D122 Valley Truss to Roof Framing 4 D41 Top Plates to Stud 2 DSP	20 19 19
DSC2-SDS3 D122 Valley Truss to Roof Framing 44 DSC5-SDS3 D122 Valley Truss to Roof Framing 44 DSP D41 Top Plates to Stud 22 D45 Stud to Band Joist 22 — Stud to Sill Plate 33 — Header to Wall Framing 3 DTT1Z Holdowns 4 — Girder/Truss to Wood Wall Framing 17 D22 Girder/Truss to Masonry/Concrete 22 D46 Stud to Stud 36 DTT2Z — Header to Wall Framing 3 D60 Stemwall/Crawlspace 3 — Holdowns 4	19 19
DSC5-SDS3 D122 Valley Truss to Roof Framing 44 DSP D41 Top Plates to Stud 28 D45 Stud to Band Joist 28 — Stud to Sill Plate 33 — Header to Wall Framing 3 DTT1Z Holdowns 4 — Girder/Truss to Wood Wall Framing 1 D22 Girder/Truss to Masonry/Concrete 25 D46 Stud to Stud 3 DTT2Z — Header to Wall Framing 3 D60 Stemwall/Crawlspace 3 — Holdowns 4	19
DSP D41 Top Plates to Stud 28 D45 Stud to Band Joist 29 — Stud to Sill Plate 33 — Header to Wall Framing 3 DTT1Z — Holdowns 4 — Holdowns 4 — Girder/Truss to Wood Wall Framing 17 D22 Girder/Truss to Masonry/Concrete 25 D46 Stud to Stud 3 DTT2Z — Header to Wall Framing 3 D60 Stemwall/Crawlspace 3 — Holdowns 4	
DSP D45 Stud to Band Joist 28 — Stud to Sill Plate 33 — Header to Wall Framing 3 DTT1Z D50 Floor to Masonry/Concrete 3 — Holdowns 4 — Girder/Truss to Wood Wall Framing 17 D22 Girder/Truss to Masonry/Concrete 22 D46 Stud to Stud 3 DTT2Z — Header to Wall Framing 3 D60 Stemwall/Crawlspace 3 — Holdowns 4	18
DSP — Stud to Sill Plate 33 — Header to Wall Framing 3 DTT1Z D50 Floor to Masonry/Concrete 3 — Holdowns 4 — Girder/Truss to Wood Wall Framing 1 D22 Girder/Truss to Masonry/Concrete 2 D46 Stud to Stud 3 DTT2Z — Header to Wall Framing 3 D60 Stemwall/Crawlspace 3 — Holdowns 4	
— Stud to Sill Plate 33 — Header to Wall Framing 3 DTT1Z D50 Floor to Masonry/Concrete 3 — Holdowns 4 — Girder/Truss to Wood Wall Framing 1 D22 Girder/Truss to Masonry/Concrete 2 D46 Stud to Stud 3 DTT2Z — Header to Wall Framing 3 D60 Stemwall/Crawlspace 3 — Holdowns 4	29
DTT1Z D50 Floor to Masonry/Concrete 3 — Holdowns 4 — Girder/Truss to Wood Wall Framing 17 D22 Girder/Truss to Masonry/Concrete 2 D46 Stud to Stud 3 DTT2Z — Header to Wall Framing 3 D60 Stemwall/Crawlspace 3 — Holdowns 4	32
DTT12 Holdowns 4. — Girder/Truss to Wood Wall Framing 17. D22 Girder/Truss to Masonry/Concrete 27. D46 Stud to Stud 38. — Header to Wall Framing 38. D60 Stemwall/Crawlspace 38. — Holdowns 48.	34
— Holdowns 4. — Girder/Truss to Wood Wall Framing 11 D22 Girder/Truss to Masonry/Concrete 2: D46 Stud to Stud 3: — Header to Wall Framing 3: D60 Stemwall/Crawlspace 3: — Holdowns 4:	;1
D22 Girder/Truss to Masonry/Concrete 22 D46 Stud to Stud 33 DTT2Z — Header to Wall Framing 34 D60 Stemwall/Crawlspace 35 — Holdowns 44	15
D46 Stud to Stud 3 DTT2Z — Header to Wall Framing 3 D60 Stemwall/Crawlspace 3 — Holdowns 4	7
DTT2Z — Header to Wall Framing 3 D60 Stemwall/Crawlspace 3 — Holdowns 4	22
D60 Stemwall/Crawlspace 3: — Holdowns 4:	30
— Holdowns 4.	34
	35
D100 Dividing Floor to Floor Strong	15
D133 Building Floor-to-Floor Straps 5	52
DWC114PS D118 Gable End to Wall Framing 4	18
ECCLQM D64 Beam to CMU or Concrete Pier 3	36
ECCLQ-SDS2.5 D82 Beam to Corner Post/Column 44	10
ECCLRQMD-KT D65 Beam to CMU or Concrete Pier 3	36
FCB43.5 D35 Truss/Rafter to Single Top Plate 2:	<u>.</u> 5
D19 Post-Installed Truss/Rafter to Masonry/Concrete 2	<u>?</u> 1
FGTR D21 Girder/Truss to Masonry/Concrete 2:	22
D32, D33 Truss/Rafter Hip to End Wall 24	24
FGTRHL D25, D28 Truss/Rafter Hip to Wall 29	23
FJA D62 Stemwall/Crawlspace 3:	35
GA1 D116 Gable End to Wall Framing 44	18
GA2 D101 Lateral Load 4-	14
GBC D119 Gable End to Wall Framing 44	18
D4 Truss/Rafter to Wood Double Top Plates 16	6
H1 D129 Overlapping Connectors 5	51
D40 Truss/Rafter Directly to Stud 2	27
H2A D130 Overlapping Connectors 5	51
D4 Truss/Rafter to Wood Double Top Plates 16	0
D5 Girder/Truss to Wood Wall Framing 17	Ь
H2.5A D34, D35 Truss/Rafter to Single Top Plate 29	7
D43 Top Plates to Stud 26	
— Stud to Sill Plate 3:	7



H2.5AZ	PRODUCT	DETAIL DRAWING NO.	APPLICATION	PAGE
H2.5T D3 Truss/Rafter to Wood Double Top Plates 16 H3	H2.5ASS	_	Stud to Sill Plate	32
H3 D34, D35 Truss/Rafter to Single Top Plate 25 H4 D34, D35 Truss/Rafter to Single Top Plate 25 H4 D34, D35 Truss/Rafter to Single Top Plate 25 H42 D52 Stud to Sill Plate 32 H5 D4 Truss/Rafter to Wood Double Top Plates 16 H6 − Stud to Band Joist 29 H7Z D40 Truss/Rafter Directly to Stud 27 H6 − Stud to Band Joist 29 H7Z D40 Truss/Rafter Directly to Stud 27 H7Z D40 Truss/Rafter to Wood Double Top Plates 16 H1 J-Joists to Sill Framing 18 16 H2 D11 I-Joists to Wall Framing 18 16 H10A D4 Truss/Rafter to Wood Double Top Plates 16 16 16 16 14 14 14 14 14 14 14 14 14 14 14 14 14 14 14 14	H2.5AZ	D52	Stud to Sill Plate	32
Horal	H2.5T	D3	Truss/Rafter to Wood Double Top Plates	16
Harmonia Harmonia	1.10	D34, D35	Truss/Rafter to Single Top Plate	25
Stud to Sill Plate 32 HaZ	H3	_	Stud to Sill Plate	32
Stud to Sill Plate 32	1.14	D34, D35	Truss/Rafter to Single Top Plate	25
H5	H4	_	Stud to Sill Plate	32
H6 — Stud to Band Joist 29 H7Z D40 Truss/Rafter Directly to Stud 27 AMARE D4 Truss/Rafter to Wood Double Top Plates 16 BALL D11 I-Joists to Wall Framing 18 BALL D43 Top Plates to Stud 28 C Stud to Sill Plate 32 H10A D4 Truss/Rafter to Wood Double Top Plates 16 H10A-2 D2 Truss/Rafter to Wood Double Top Plates 16 H10A-2 D2 Truss/Rafter to Wood Double Top Plates 16 H10A-2 D2 Post-Installed Truss/Rafter to Masonny/Concrete 21 H10A-2 D2 Post-Installed Truss/Rafter to Masonny/Concrete 21 H10A-2 D39 Truss/Rafter to Wood Double Top Plates 16 H10A-1 D129 Overlapping Connectors 51 H14-1 D129 Overlapping Connectors 51 H16-2 D129 Post-Installed Truss/Rafter to Masonny/Concrete 21 H16-2 D- Girder/Truss t	H4Z	D52	Stud to Sill Plate	32
H7Z D40 Truss/Rafter Directly to Stud 27 ARABA D4 Truss/Rafter to Wood Double Top Plates 16 B11 I-Joists to Wall Framing 18 D43 Top Plates to Stud 28 B14 Truss/Rafter to Wood Double Top Plates 32 H10A D4 Truss/Rafter to Wood Double Top Plates 16 H10A2 D2 Truss/Rafter to Wood Double Top Plates 16 H10A2 D2 Truss/Rafter to Wood Double Top Plates 16 H10A2 D2 Post-Installed Truss/Rafter to Masonry/Concrete 21 H10A2 D39 Truss/Rafter Directly to Stud 27 D39 Truss/Rafter Directly to Stud 27 D131 Overlapping Connectors 51 H14 D129 Overlapping Connectors 51 H16 D29 Post-Installed Truss/Rafter to Masonry/Concrete 21 H16-2 — Girder/Truss to Wood Wall Framing 17 H16-2 — Girder/Truss to Wood Wall Framing 17 HCP2	H5	D4	Truss/Rafter to Wood Double Top Plates	16
D4 Truss/Rafter to Wood Double Top Plates 16 D11 I-Joists to Wall Framing 18 D43 Top Plates to Stud 28 — Stud to Sill Plate 32 — Stud to Sill Plate 32 — H10A D4 — Truss/Rafter to Wood Double Top Plates 16 — D129 — Overlapping Connectors 51 — H10A — D20 — Post-Installed Truss/Rafter to Masonry/Concrete 21 — D39 — Truss/Rafter Directly to Stud 27 — D131 — Overlapping Connectors 51 — H14 — D4 — Truss/Rafter to Wood Double Top Plates 16 — H14 — D29 — Post-Installed Truss/Rafter to Masonry/Concrete 21 — D129 — Post-Installed Truss/Rafter to Masonry/Concrete 21 — H16-2 — Girder/Truss to Wood Wall Framing 17 — H16-2 — Girder/Truss to Wood Wall Framing <	H6	_	Stud to Band Joist	29
H8 D11 I-Joists to Wall Framing 18 D43 Top Plates to Stud 28 − Stud to Sill Plate 32 H10A D4 Truss/Rafter to Wood Double Top Plates 16 H10A-2 D2 Truss/Rafter to Wood Double Top Plates 16 H10A-2 D2 Truss/Rafter Directly to Stud 27 D39 Truss/Rafter Directly to Stud 27 D131 Overlapping Connectors 51 H14 D129 Overlapping Connectors 51 H16 D129 Overlapping Connectors 51 H16 D20 Post-Installed Truss/Rafter to Wood Double Top Plates 16 H16 D129 Overlapping Connectors 51 H16 D129 Post-Installed Truss/Rafter to Wood Wall Framing 17 H16-2 D2 D34	H7Z	D40	Truss/Rafter Directly to Stud	27
HB		D4	Truss/Rafter to Wood Double Top Plates	16
D43 Top Plates to Stud 28	1.10	D11	I-Joists to Wall Framing	18
H10A D4 D4 D129 Truss/Rafter to Wood Double Top Plates 16 D129 H10A-2 D2 Truss/Rafter to Wood Double Top Plates 16 D20 H10A-2 D2 Post-Installed Truss/Rafter to Masonry/Concrete 21 D20 H10S D39 Truss/Rafter to Wood Double Top Plates 27 D131 D131 Overlapping Connectors 51 D131 H14 D4 Truss/Rafter to Wood Double Top Plates 16 D129 D129 Overlapping Connectors 51 D14 H16 D20 Post-Installed Truss/Rafter to Masonry/Concrete 21 D14 H16-2 D20 Post-Installed Truss/Rafter to Masonry/Concrete 21 D15 H16-2 D20 Post-Installed Truss to Wood Wall Framing 17 D17 H16-2 D27 Truss/Rafter to Single Top Plate 23 D17 H16-2 D27 Truss/Rafter to Wood Wall Framing 17 D17 HCP2 D29 Truss/Rafter to Wood Wall Framing 17 D17 HD5B <td< td=""><td>Нδ</td><td>D43</td><td>Top Plates to Stud</td><td>28</td></td<>	Нδ	D43	Top Plates to Stud	28
HIOA D129		_	Stud to Sill Plate	32
D129 Overlapping Connectors 51	LHOA	D4	Truss/Rafter to Wood Double Top Plates	16
D20 Post-Installed Truss/Rafter to Masonry/Concrete 21	HIUA	D129	Overlapping Connectors	51
H10S D39 Truss/Rafter Directly to Stud 27 D131 Overlapping Connectors 51 H144 D4 Truss/Rafter to Wood Double Top Plates 16 H144 D129 Overlapping Connectors 51 H16 D20 Post-Installed Truss/Rafter to Masonry/Concrete 21 H16 D34 Truss/Rafter to Single Top Plate 25 H16-2 — Girder/Truss to Wood Wall Framing 17 H16-2S — Girder/Truss to Wood Wall Framing 17 HCP D27 Truss/Rafter Hip to Wall 23 HCP2 D29 Truss/Rafter Hip to Wall 23 HD5B D107 Holdowns 45 HD7B D107 Holdowns 45 HDD D106 Holdowns 45 HDU D49 Floor to Masonry/Concrete 31 HDU2 D46 Stud to Stud 30 HDU2-SDS2.5 — Stud to Stud 30 HD04 Holdowns 45	H10A-2	D2	Truss/Rafter to Wood Double Top Plates	16
D131 Overlapping Connectors 51 H14 D4 Truss/Rafter to Wood Double Top Plates 16 D129 Overlapping Connectors 51 H16 D20 Post-Installed Truss/Rafter to Masonry/Concrete 21 H16 D34 Truss/Rafter to Single Top Plate 25 H16-2 — Girder/Truss to Wood Wall Framing 17 H16-28 — Girder/Truss to Wood Wall Framing 17 HCP D27 Truss/Rafter Hip to Wall 23 HCP D29 Truss/Rafter Hip to Wall 23 HD5B D107 Holdowns 45 HD7B D107 Holdowns 45 HDB D107 Holdowns 45 HDC D106 Holdowns 45 HDU D49 Floor to Masonry/Concrete 31 HDU2 D46 Stud to Stud 30 HDU2-SDS2.5 — Floor to		D20	Post-Installed Truss/Rafter to Masonry/Concrete	21
H144 D4 Truss/Rafter to Wood Double Top Plates 16 D129 Overlapping Connectors 51 H16 D20 Post-Installed Truss/Rafter to Masonry/Concrete 21 D34 Truss/Rafter to Single Top Plate 25 H16-2 — Girder/Truss to Wood Wall Framing 17 H16-2S — Girder/Truss to Wood Wall Framing 17 HCP D27 Truss/Rafter Hip to Wall 23 HCP2 D29 Truss/Rafter Hip to Wall 23 HD5B D107 Holdowns 45 HD7B D107 Holdowns 45 HDD D106 Holdowns 45 HDD D106 Holdowns 45 HDU D49 Floor to Masonry/Concrete 31 HDU2 D46 Stud to Stud 30 HDU2-SDS2.5 — Floor to Masonry/Concrete 31 HDU4 — Floor to Masonry/Concrete 31 HDU4 — Floor to Masonry/Concrete <t< td=""><td>H10S</td><td>D39</td><td>Truss/Rafter Directly to Stud</td><td>27</td></t<>	H10S	D39	Truss/Rafter Directly to Stud	27
H14 D129 Overlapping Connectors 51 H16 D20 Post-Installed Truss/Rafter to Masonry/Concrete 21 D34 Truss/Rafter to Single Top Plate 25 H16-2 — Girder/Truss to Wood Wall Framing 17 H16-2S — Girder/Truss to Wood Wall Framing 17 HCP D27 Truss/Rafter Hip to Wall 23 HCP2 D29 Truss/Rafter Hip to Wall 23 HD5B D107 Holdowns 45 HD7B D107 Holdowns 45 HD9B D107 Holdowns 45 HDC D106 Holdowns 45 HDU D49 Floor to Masonry/Concrete 31 HDU2 D46 Stud to Stud 30 HDU2-SDS2.5 — Stud to Stud 30 HDU4-SDS2.5 — Floor to Masonry/Concrete 31 HDU4-SDS2.5 — Floor to Masonry/Concrete 31 HDU4-SDS2.5 — F		D131	Overlapping Connectors	51
D129 Overlapping Connectors 51 D20 Post-Installed Truss/Rafter to Masonry/Concrete 21 D34 Truss/Rafter to Single Top Plate 25 H16-2 — Girder/Truss to Wood Wall Framing 17 H16-2S — Girder/Truss to Wood Wall Framing 17 HCP D27 Truss/Rafter Hip to Wall 23 HCP2 D29 Truss/Rafter Hip to Wall 23 HD5B D107 Holdowns 45 HD7B D107 Holdowns 45 HDDB D107 Holdowns 45 HDDC D106 Holdowns 45 HDU D49 Floor to Masonry/Concrete 31 HDU2 D46 Stud to Stud 30 HDU2-SDS2.5 — Stud to Stud 30 HDU2-SDS2.5 — Floor to Masonry/Concrete 31 HDU4 Header to Wall Framing 34 HDU4 Header to Wall Framing 34 HDU4 Header to Wall Framing 34 HDU4 Header to Wall Framing 37 HDU4 D46 Stud to Stud 30 HDU4 Header to Wall Framing 34 HDU4 Header to Wall Framing 34 HDU4 D46 Stud to Stud 30 HDU4 Header to Wall Framing 34 HDU4 D46 Stud to Stud Stud to Stud 30 HDU4 Header to Wall Framing 34 HDU4 D46 Stud to Stud 30 HDU4 D46 Stud to Stud 30 HDU4 Header to Wall Framing 34 HDU4 D46 Stud to Stud 30 D46 Stud to Stud 30 HDU4 Header to Wall Framing 34 HDU4 D46 Stud to Stud 30 HDU4 D46 Stud to Stud 30 HDU4 Header to Wall Framing 34 HDU4 D46 Stud to Stud 30 HDU4 D46 Stud to Stud 30 HDU5 D46 Stud to Stud 30 HD4 HEADER HIP TAMING 17 HD5 HEADER	1.14.4	D4	Truss/Rafter to Wood Double Top Plates	16
H16 D34 Truss/Rafter to Single Top Plate 25 H16-2 — Girder/Truss to Wood Wall Framing 17 H16-2S — Girder/Truss to Wood Wall Framing 17 HCP D27 Truss/Rafter Hip to Wall 23 HCP2 D29 Truss/Rafter Hip to Wall 23 HD5B D107 Holdowns 45 HD7B D107 Holdowns 45 HD9B D107 Holdowns 45 HDC D106 Holdowns 45 HDU D49 Floor to Masonry/Concrete 31 HDU2 D46 Stud to Stud 30 HDU2-SDS2.5 — Stud to Stud 30 HDU2-SDS2.5 — Floor to Masonry/Concrete 31 HDU4 D6 Girder/Truss to Wood Wall Framing 34 HDU4 D6 Girder/Truss to Wood Wall Framing 30 HDU4 D6 Girder/Truss to Wood Wall Framing 30	H14	D129	Overlapping Connectors	51
D34 Truss/Rafter to Single Top Plate 25 H16-2	140	D20	Post-Installed Truss/Rafter to Masonry/Concrete	21
H16-2S — Girder/Truss to Wood Wall Framing 17 HCP D27 Truss/Rafter Hip to Wall 23 HCP2 D29 Truss/Rafter Hip to Wall 23 HD5B D107 Holdowns 45 HD7B D107 Holdowns 45 HD9B D107 Holdowns 45 HDC D106 Holdowns 45 HDU D49 Floor to Masonry/Concrete 31 HDU2 D46 Stud to Stud 30 D105 Holdowns 45 HDU2-SDS2.5 — Stud to Stud 30 HDU4-SDS2.5 — Floor to Masonry/Concrete 31 HDU4 D6 Girder/Truss to Wood Wall Framing 34 HDU4 D6 Girder/Truss to Wood Wall Framing 17 HDU4 D6 Girder/Truss to Wood Wall Framing 17 HDU4 D6 Girder/Truss to Wood Wall Framing 17	ПЮ	D34	Truss/Rafter to Single Top Plate	25
HCP D27 Truss/Rafter Hip to Wall 23 HCP2 D29 Truss/Rafter Hip to Wall 23 HD5B D107 Holdowns 45 HD7B D107 Holdowns 45 HD9B D107 Holdowns 45 HDC D106 Holdowns 45 HDU D49 Floor to Masonry/Concrete 31 HDU2 D9 Girder/Truss to Wood Wall Framing 17 HDU2 D46 Stud to Stud 30 HDU2-SDS2.5 — Floor to Masonry/Concrete 31 HDU2-SDS2.5 — Floor to Masonry/Concrete 31 HDU4 D6 Girder/Truss to Wood Wall Framing 34 HDU4 D6 Girder/Truss to Wood Wall Framing 17 D46 Stud to Stud 30	H16-2	_	Girder/Truss to Wood Wall Framing	17
HCP2 D29 Truss/Rafter Hip to Wall 23 HD5B D107 Holdowns 45 HD7B D107 Holdowns 45 HD9B D107 Holdowns 45 HDC D106 Holdowns 45 HDU D49 Floor to Masonry/Concrete 31 HDU2 D9 Girder/Truss to Wood Wall Framing 17 HDU2 D46 Stud to Stud 30 HDU2-SDS2.5 — Stud to Stud 30 HDU2-SDS2.5 — Floor to Masonry/Concrete 31 HDU4 D6 Girder/Truss to Wood Wall Framing 34 HDU4 D6 Girder/Truss to Wood Wall Framing 17 BD04 D16 Stud to Stud 30	H16-2S	_	Girder/Truss to Wood Wall Framing	17
HD5B D107 Holdowns 45 HD7B D107 Holdowns 45 HD9B D107 Holdowns 45 HDC D106 Holdowns 45 HDU D49 Floor to Masonry/Concrete 31 D9 Girder/Truss to Wood Wall Framing 17 HDU2 D46 Stud to Stud 30 D105 Holdowns 45 HDU2-SDS2.5 — Stud to Stud 30 HDU2-SDS2.5 — Floor to Masonry/Concrete 31 HDU4 — Header to Wall Framing 34 HDU4 D6 Girder/Truss to Wood Wall Framing 17 HDU4 D6 Stud to Stud 30	HCP	D27	Truss/Rafter Hip to Wall	23
HD7B D107 Holdowns 45 HD9B D107 Holdowns 45 HDC D106 Holdowns 45 HDU D49 Floor to Masonry/Concrete 31 MD4 D9 Girder/Truss to Wood Wall Framing 17 HDU2 D46 Stud to Stud 30 D105 Holdowns 45 HDU2-SDS2.5 — Stud to Stud 30 HDU4 Header to Wall Framing 34 HDU4 D6 Girder/Truss to Wood Wall Framing 17 HDU4 D6 Stud to Stud 30	HCP2	D29	Truss/Rafter Hip to Wall	23
HD9B D107 Holdowns 45 HDC D106 Holdowns 45 HDU D49 Floor to Masonry/Concrete 31 AD4 D9 Girder/Truss to Wood Wall Framing 17 BD46 Stud to Stud 30 BD46 Stud to Stud 30 BD45 Holdowns 45 BD46 Stud to Stud 30 BD46 Floor to Masonry/Concrete 31 BD46 Header to Wall Framing 34 BD46 Girder/Truss to Wood Wall Framing 17 BD46 Stud to Stud 30	HD5B	D107	Holdowns	45
HDC D106 Holdowns 45 HDU D49 Floor to Masonry/Concrete 31 ADEAD D9 Girder/Truss to Wood Wall Framing 17 HDU2 D46 Stud to Stud 30 D105 Holdowns 45 ADEAD Stud to Stud 30 HDU2-SDS2.5 — Floor to Masonry/Concrete 31 HDU4 D6 Girder/Truss to Wood Wall Framing 17 HDU4 D6 Girder/Truss to Wood Wall Framing 17 HDU4 D6 Stud to Stud 30	HD7B	D107	Holdowns	45
HDU D49 Floor to Masonry/Concrete 31 ALDU2 D9 Girder/Truss to Wood Wall Framing 17 D46 Stud to Stud 30 D105 Holdowns 45 ALDU2-SDS2.5 — Floor to Masonry/Concrete 31 HDU4 — Header to Wall Framing 34 HDU4 D6 Girder/Truss to Wood Wall Framing 17 HDU4 D6 Stud to Stud 30	HD9B	D107	Holdowns	45
D9 Girder/Truss to Wood Wall Framing 17	HDC	D106	Holdowns	45
HDU2 D46 Stud to Stud 30 D105 Holdowns 45 ABOUTY STATE OF THE PROPERTY OF	HDU	D49	Floor to Masonry/Concrete	31
D105 Holdowns 45 HDU2-SDS2.5 — Stud to Stud 30 — Floor to Masonry/Concrete 31 — Header to Wall Framing 34 HDU4 D6 Girder/Truss to Wood Wall Framing 17 D46 Stud to Stud 30		D9	Girder/Truss to Wood Wall Framing	17
HDU2-SDS2.5 — Stud to Stud 30 — Floor to Masonry/Concrete 31 — Header to Wall Framing 34 HDU4 D6 Girder/Truss to Wood Wall Framing 17 D46 Stud to Stud 30	HDU2	D46	Stud to Stud	30
HDU2-SDS2.5 — Floor to Masonry/Concrete 31 — Header to Wall Framing 34 HDU4 D6 Girder/Truss to Wood Wall Framing 17 D46 Stud to Stud 30		D105	Holdowns	45
— Header to Wall Framing 34 HDU4 D6 Girder/Truss to Wood Wall Framing 17 D46 Stud to Stud 30			Stud to Stud	30
HDU4 D6 Girder/Truss to Wood Wall Framing 17 D46 Stud to Stud 30	HDU2-SDS2.5	_	Floor to Masonry/Concrete	31
HDU4 D46 Stud to Stud 30		_	Header to Wall Framing	34
D46 Stud to Stud 30	HDIM	D6	Girder/Truss to Wood Wall Framing	17
HDU4-SDS2.5 — Stud to Stud 30	П) (14	D46	Stud to Stud	30
	HDU4-SDS2.5	_	Stud to Stud	30



PRODUCT	DETAIL DRAWING NO.	APPLICATION	PAGE
LIDUE	D46	Stud to Stud	30
HDU5	D105	Holdowns	45
	D22	Girder/Truss to Masonry/Concrete	22
HDU5-SDS2.5	_	Stud to Stud	30
	_	Floor to Masonry/Concrete	31
	<u>—</u>	Header to Wall Framing	34
HDU8	D105	Holdowns	45
HDU11	D105	Holdowns	45
HDU14	D105	Holdowns	45
HETA12	D117	Gable End to Wall Framing	48
HETA16	D48, D51	Floor to Masonry/Concrete	31
	D15	I-Joists to Masonry/Concrete	19
HETA20	D16	Embedded Truss/Rafter to Masonry/Concrete	20
	D117	Gable End to Wall Framing	48
LIETA 40	D15	I-Joists to Masonry/Concrete	19
HETA40	D47	Floor to Masonry/Concrete	31
HGA10	D35	Truss/Rafter to Single Top Plate	25
LICATOLET	_	Truss/Rafter to Wood Double Top Plates	16
HGA10KT	D116	Gable End to Wall Framing	48
LICANACIZTA	_	Post-Installed Truss/Rafter to Masonry/Concrete	21
HGAM10KTA	D117	Gable End to Wall Framing	48
HGT-2	D23	Girder/Truss to Masonry/Concrete	22
HGT-3	D6	Girder/Truss to Wood Wall Framing	17
HGT-4	_	Girder/Truss to Wood Wall Framing	17
HGUS26-2	D125	Combined Hanger	50
HH4	D59	Header to Wall Framing	34
HM9	D20	Post-Installed Truss/Rafter to Masonry/Concrete	21
HST2	D72	Wall to Pile/Girder	38
HST5	D72	Wall to Pile/Girder	38
	D4	Truss/Rafter to Wood Double Top Plates	16
	_	I-Joists to Wall Framing	18
LITOOO	D40	Truss/Rafter Directly to Stud	27
HTS20	D43	Top Plates to Stud	28
		Stud to Band Joist	29
	D72, D74	Wall to Pile/Girder	38
HTS30	_	I-Joists to Wall Framing	18
HTSM	D20	Post-Installed Truss/Rafter to Masonry/Concrete	21
LITOMAC	_	I-Joists to Masonry/Concrete	19
HTSM16	D31	Truss/Rafter Hip to End Wall	24
HTSM20	_	I-Joists to Masonry/Concrete	19
HTSQ16ZKT	D73	Wall to Pile/Girder	38



PRODUCT	DETAIL DRAWING NO.	APPLICATION	PAGE
	D8	Girder/Truss to Wood Wall Framing	17
LITTA	D22	Girder/Truss to Masonry/Concrete	22
HTT4	D72	Wall to Pile/Girder	38
	D108	Holdowns	45
	D8, D9	Girder/Truss to Wood Wall Framing	17
	D22	Girder/Truss to Masonry/Concrete	22
HTT5	D58	Header to Wall Framing	34
	D72	Wall to Pile/Girder	38
	D108	Holdowns	45
HUC210-2	D123	Increased Uplift Capacity	50
Hurricane Tie	D126, D127, D128	Achieve Twice the Load	51
HUS26	D124	Combined Connector	50
LCE4	D76	Post/Column to Beam	39
LCE4Z	D85	Beam to Corner Post/Column	40
	D20	Post-Installed Truss/Rafter to Masonry/Concrete	21
LGT2	D23	Girder/Truss to Masonry/Concrete	22
	D40	Truss/Rafter Directly to Stud	27
LGT3	D23	Girder/Truss to Masonry/Concrete	22
LGT4	D23	Girder/Truss to Masonry/Concrete	22
LMA4Z	D54	Sill Plate to Foundation	33
LRU26Z	D124	Combined Connector	50
LS50	D101	Lateral Load	44
LS70	D101	Lateral Load	44
L070	D124	Combined Connector	50
LS90	D101	Lateral Load	44
LSTA12	D136	Cross-Grain Tension	53
LSTA18	D45	Stud to Band Joist	29
LSTA21	D58	Header to Wall Framing	34
LOTAZT	D72, D74	Wall to Pile/Girder	38
LSTA24	D118	Gable End to Wall Framing	48
LSTA36	D50	Floor to Masonry/Concrete	31
LSTHD8	D58	Header to Wall Framing	34
LTA2	D23	Girder/Truss to Masonry/Concrete	22
LIAZ	D117	Gable End to Wall Framing	48
LTP4	D101, D102	Lateral Load	44
LTDS	D100	Lateral Load	44
LTP5	D118	Gable End to Wall Framing	48
	D4	Truss/Rafter to Wood Double Top Plates	16
LTS12	D40	Truss/Rafter Directly to Stud	27
LIGIZ	D43	Top Plates to Stud	28
	D73	Wall to Pile/Girder	38
LT016	D45	Stud to Band Joist	29
LTS16	D72, D74	Wall to Pile/Girder	38



PRODUCT	DETAIL DRAWING NO.	APPLICATION	PAGE
LTT20B	D6	Girder/Truss to Wood Wall Framing	17
LUS210	D74	Wall to Pile/Girder	38
MA4	_	Sill Plate to Foundation	33
MAB15	D53	Sill Plate to Foundation	33
MAB23	D53	Sill Plate to Foundation	33
MASA	D56, D57	Sill Plate to Foundation	33
MASAZ	D56	Sill Plate to Foundation	33
META	D34	Truss/Rafter to Single Top Plate	25
META12	D17	Embedded Truss/Rafter to Masonry/Concrete	20
META16	D17	Embedded Truss/Rafter to Masonry/Concrete	20
META18	D17	Embedded Truss/Rafter to Masonry/Concrete	20
NAFTAGO	D15	I-Joists to Masonry/Concrete	19
META20	D16, D17	Embedded Truss/Rafter to Masonry/Concrete	20
META22	D17	Embedded Truss/Rafter to Masonry/Concrete	20
META24	D17	Embedded Truss/Rafter to Masonry/Concrete	20
META40	D17	Embedded Truss/Rafter to Masonry/Concrete	20
NACT	D6	Girder/Truss to Wood Wall Framing	17
MGT	D23	Girder/Truss to Masonry/Concrete	22
MST37	_	Stud to Band Joist	29
MSTA	D79	Post/Column to Beam	39
MSTA36	D46	Stud to Stud	30
MSTA49	D46	Stud to Stud	30
MSTAM24	D30	Truss/Rafter Hip to End Wall	24
	D50	Floor to Masonry/Concrete	31
NOTALIO	D30	Truss/Rafter Hip to End Wall	24
MSTAM36	D50	Floor to Masonry/Concrete	31
MSTC28	<u> </u>	Stud to Band Joist	29
MSTC66B3	D75	Wall to Pile/Girder	38
MSTC66B3Z	D72, D75	Wall to Pile/Girder	38
MOTOMAO	D30	Truss/Rafter Hip to End Wall	24
MSTCM40	D49	Floor to Masonry/Concrete	31
	D4	Truss/Rafter to Wood Double Top Plates	16
MTO40	D24	Truss/Rafter Hip to Wall	23
MTS12	D40	Truss/Rafter Directly to Stud	27
	D43	Top Plates to Stud	28
	D45	Stud to Band Joist	29
MTS16	D72, D74	Wall to Pile/Girder	38
	D136	Cross-Grain Tension	53
MATOOO	D10	I-Joists to Wall Framing	18
MTS20	D136	Cross-Grain Tension	53
MTS30	D10, D12, D13	I-Joists to Wall Framing	18



MTSM16 — I-Joils to Masonry/Concrete 19 MTSM16 D26 Truss/Rather Hip to Wall 24 MTSM20 D14 I-Joilsts to Masonry/Concrete 19 PA28 D22 D23 Post-Installed Truss/Rather to Masonry/Concrete 21 PA28 D22 D23 Girder/Truss to Masonry/Concrete 22 PA51 D60, D61 Stormwall/Crawlspace 35 PB442 D92 Post/Column to Foundation 42 PB442 D92 Post/Column to Foundation 42 PB5444 D93 Post/Column to Foundation 42 PB544A D93 Post/Column to Foundation 42 PB544A D93 Post/Column to Foundation 42 PB444B D78 Post/Column to Foundation 41 PB444B D78 Post/Column to Foundation 41 PB444B D72, D73 Wall to Pile/Girder 38 PS218 D72, D74 Wall to Pile/Girder 38 RB6 D87, D98, D99 Ro	PRODUCT	DETAIL DRAWING NO.	APPLICATION	PAGE
D31		_	I-Joists to Masonry/Concrete	19
MTSM20 D14 I-Joists to Masonry/Concrete 19 PA28 D20 Post-Installed Truss/Rafter to Masonry/Concrete 21 PA28 D22, D23 Girder/Truss to Masonry/Concrete 22 PA61 D60, D61 Sternwall/Crawispace 35 PB44Z D92 Post/Column to Foundation 42 PB66Z D92 Post/Column to Foundation 42 PB544A D93 Post/Column to Foundation 42 PB544A D96 Post/Column to Foundation 42 PC4Z D78 Post/Column to Foundation 41 PC4Z D78 Post/Column to Foundation 41 PP5444Z D88 Post/Column to Foundation 41 PP544B D72 Wall to Pile/Girder 38 P521B D72 Wall to Pile/Girder 38 P521B D72 Wall to Pile/Girder 38 RBC D97, D98, D99 Poof Boundary Connection 43 RBC D97, D98, D99 Poof Boundary Connection 41	MTSM16	D26	Truss/Rafter Hip to Wall	23
MTSM20 D20 Post-Installed Truss/Rather to Masonry/Concrete 21 PA28 D22, D23 Girder/Truss to Masonry/Concrete 22 PA51 D60, D61 Stemwall/Crawlspace 35 PB44Z D92 Post/Column to Foundation 42 PB544A D93 Post/Column to Foundation 42 PB5WPC D96 Post/Column to Foundation 42 PC4Z D78 Post/Column to Foundation 41 PC4Z D78 Post/Column to Foundation 41 PPE44+4Z D88 Post/Column to Foundation 41 PPB44-6Z D88 Post/Column to Foundation 41 PS218 D72, D73 Wall to Pile/Girder 38 PS218 D72, D73 Wall to Pile/Girder 38 RFB D109, D99, D99 Roof Boundary Connection		D31	Truss/Rafter Hip to End Wall	24
Post-Installed Truss/Hatter to Masonny/Concrete 21 PA28 D22, D23 Girder/Truss to Masonny/Concrete 22 PA51 D80, D61 Sternwall/Crawlispace 35 PB44Z D92 Post/Column to Foundation 42 PB66Z D92 Post/Column to Foundation 42 PB66Z D93 Post/Column to Foundation 42 PB66Z D96 Post/Column to Foundation 42 PB66Z D96 Post/Column to Foundation 42 PB66Z D96 Post/Column to Foundation 42 PB64Z D78 Post/Column to Foundation 42 PEV6PC D96 Post/Column to Foundation 42 PC4Z D78 Post/Column to Foundation 41 PS24 D88 Post/Column to Foundation 41 PS218 D72 Wall to Pile/Girder 38 PS418 D72 Wall to Pile/Girder 38 PS418 D72, D73 Wall to Pile/Girder 38 PS418 D72, D74 Wall to Pile/Girder 38 PS62O D72, D74 Wall to Pile/Girder 38 PS62O D70, D74 Wall to Pile/Girder 38 PS62 D90 Post/Column to Foundation 41 PS218 D106 Holdowns 45 PS22 D90 Post/Column to Foundation 41 PS24 D90 Post/Column to Foundation 41 PS25 D90 Post/Column to Foundation 41 PS64 D16S Post/Column to Foundation 41 PS65 D43 Top Piates to Stud 28 PS67 Beam to Corner Post/Column 40 PS67 Beam to Corner Post/Column 40 PS68 D47 Beam to Corner Post/Column 40 PS69 Header to Vall Transing 34 PS69 Header to Wall Transing 34	MTCMOO	D14	I-Joists to Masonry/Concrete	19
PA51 D60, D61 Sternwall/Craw/space 35 PB44Z D92 Post/Column to Foundation 42 PB66Z D92 Post/Column to Foundation 42 PB64AA D93 Post/Column to Foundation 42 PBV6PC D96 Post/Column to Foundation 42 PC4Z D78 Post/Column to Foundation 41 PPB44-8Z D88 Post/Column to Foundation 41 PS218 D72 Wall to Pile/Girder 38 PS418 D72, D73 Wall to Pile/Girder 38 PS418 D72, D73 Wall to Pile/Girder 38 PS720 D72, D74 Wall to Pile/Girder 38 RBC D97, D98, D99 Rod Boundary Connection 43 RFB D106 Holdowns 45 RPBZ D90 Post/Column to Foundation 41 RFB D106 Holdowns 45 RPBZ D90 Post/Column to Foundation 41 RCB D13 Top	IVI I 3IVIZU	D20	Post-Installed Truss/Rafter to Masonry/Concrete	21
PB44Z D92 Post/Column to Foundation 42 PB66Z D92 Post/Column to Foundation 42 PB544A D93 Post/Column to Foundation 42 PB54FC D96 Post/Column to Foundation 42 PC4Z D78 Post/Column to Foundation 41 PC4Z D88 Post/Column to Foundation 41 PPB44-6Z D88 Post/Column to Foundation 41 PS218 D72 Wall to Pile/Girder 38 PS218 D72, D73 Wall to Pile/Girder 38 PS720 D72, D74 Wall to Pile/Girder 38 BBC D97, D98, D99 Roof Boundary Connection 43 BFB D106 Holdowns 45 BFB D106 Holdowns 45 BFB D108	PA28	D22, D23	Girder/Truss to Masonry/Concrete	22
PB66Z D92 Post/Column to Foundation 42 PBS4AA D93 Post/Column to Foundation 42 PBV6PC D96 Post/Column to Foundation 42 PC4Z D78 Post/Column to Foundation 41 PPB44-4Z D88 Post/Column to Foundation 41 PPB44-6Z D88 Post/Column to Foundation 41 PS218 D72 Wall to Pile/Girder 38 PS418 D72, D73 Wall to Pile/Girder 38 PS720 D72, D74 Wall to Pile/Girder 38 RBC D97, D98, D99 Roof Boundary Connection 43 RBC D97, D98, D99 Roof Boundary Connection 43 RFB D106 Holdowns 45 RBPZ D90 Post/Column to Foundation 41 RBPA — Stud to Sill Plate 32 RSP4 — Stud to Sill Plate 32 RBPA — Stud to Sill Plate to Stud 28 RSP4 —	PA51	D60, D61	Stemwall/Crawlspace	35
PBS44A D93 Post/Column to Foundation 42 PBW6PC D96 Post/Column to Foundation 42 PC4Z D76 Post/Column to Foundation 41 PPB44-4Z D88 Post/Column to Foundation 41 PPB44-6Z D88 Post/Column to Foundation 41 PS218 D72 Wall to Pile/Girder 38 PS418 D72, D73 Wall to Pile/Girder 38 PS720 D72, D74 Wall to Pile/Girder 38 PS6720 D72, D74 Wall to Pile/Girder 38 RBC D97, D98, D99 Roof Boundary Connection 43 RBC D97, D98, D99 Roof Boundary Connection 43 RFB D106 Holdowns 45 RPBZ D90 Post/Column to Foundation 41 11 T94 T94 28 RPS4 — Stud to Sill Plate 32 RPS4 — Stud to Stud to Sill Plate 32 RPS4 — Stud to S	PB44Z	D92	Post/Column to Foundation	42
PBV6PC D96 Post/Column to Foundation 42 PC4Z D78 Post/Column to Beam 39 PPB44-4Z D88 Post/Column to Foundation 41 PPB44-6Z D88 Post/Column to Foundation 41 PS218 D72 Wall to Pile/Girder 38 PS418 D72, D73 Wall to Pile/Girder 38 PS720 D72, D74 Wall to Pile/Girder 38 RBC D97, D98, D99 Rof Boundary Connection 43 RBB D106 Holdowns 45 RPB D106 Holdowns 45 RPBZ D90 Post/Column to Foundation 41 LEAR D43 Top Plates to Stud 28 RSP4 — Stud to Sill Plate 32 D129 Overlapping Connectors 51 RTC44 D86, D87 Beam to Corner Post/Column 40 RTUD D115 Strong-Rod" Uplft Restraint System 47 SD10 D37 Hollow Column	PB66Z	D92	Post/Column to Foundation	42
PC4Z D78 Post/Column to Beam 39 PPB44-4Z D88 Post/Column to Foundation 41 PPB44-6Z D88 Post/Column to Foundation 41 PS218 D72 Wall to Plie/Girder 38 PS418 D72, D73 Wall to Plie/Girder 38 PS520 D72, D74 Wall to Plie/Girder 38 RBC D97, D98, D99 Roof Boundary Connection 43 RBC D97, D98, D99 Roof Boundary Connection 43 RFB D106 Holdowns 45 RPBZ D90 Post/Column to Foundation 41 41 D43 Top Plates to Stud 28 RSP4 — Stud to Sill Plate 32 D129 Overlapping Connectors 51 RTC44 D86, D87 Beam to Corner Post/Column 40 RTUD D115 Strong-Rod" Uplift Restraint System 47 SD10 D37 Hollow Column 26 D43 Top Plates to Stud 28 <td>PBS44A</td> <td>D93</td> <td>Post/Column to Foundation</td> <td>42</td>	PBS44A	D93	Post/Column to Foundation	42
PPB44-4Z D88 Post/Column to Foundation 41 PPB44-6Z D88 Post/Column to Foundation 41 PS218 D72 Wall to Pile/Girder 38 PS418 D72, D73 Wall to Pile/Girder 38 PS720 D72, D74 Wall to Pile/Girder 38 RBC D97, D98, D99 Roof Boundary Connection 43 RFB D106 Holdowns 45 RPBZ D90 Post/Column to Foundation 41 RBC D90 Post/Column to Foundation 42 RBC D129	PBV6PC	D96	Post/Column to Foundation	42
PPB44-6Z D88 Post/Column to Foundation 41 PS218 D72 Wall to Pile/Girder 38 PS418 D72, D73 Wall to Pile/Girder 38 PS720 D72, D74 Wall to Pile/Girder 38 RBC D97, D98, D99 Roof Boundary Connection 43 RFB D106 Holdowns 45 RFBZ D90 Post/Column to Foundation 41 RPBZ D90 Post/Column to Foundation 46 RPBZ D80 Post/Column to Foundation 42 RPBZ D80	PC4Z	D78	Post/Column to Beam	39
PS218 D72 Wall to Pile/Girder 38 PS418 D72, D73 Wall to Pile/Girder 38 PS720 D72, D74 Wall to Pile/Girder 38 RBC D97, D98, D99 Roof Boundary Connection 43 RBB D106 Holdowns 45 RPBZ D90 Post/Column to Foundation 41 PBBZ D143 Stud to Sill Plate 32 STOP D149 D149 Post/Column to Foundation 40 RTC44 D86, D87 Beam to Corner Post/Column 40 RTUD D115 Strong-Rod** Uplift Restraint System 47 S	PPB44-4Z	D88	Post/Column to Foundation	41
PS418 D72, D73 Wall to Pile/Girder 38 PS720 D72, D74 Wall to Pile/Girder 38 RBC D97, D98, D99 Roof Boundary Connection 43 RFB D106 Holdowns 45 RPBZ D90 Post/Column to Foundation 41 RPBZ D90 Post/Column to Foundation 41 RSP4 D43 Top Plates to Stud 28 RSP4 — Stud to Sill Plate 32 D129 Overlapping Connectors 51 RTC44 D86, D87 Beam to Corner Post/Column 40 RTUD D115 Strong-Rod™ Uplift Restraint System 47 SD10 D37 Hollow Column 26 P4 D43 Top Plates to Stud 28 D46 Stud to Stud 30 D52 Stud to Stud 30 D52 Stud to Stud 32 D134 Building Floor-to-Floor Straps 52 D139, D140 Roof to Wall 58	PPB44-6Z	D88	Post/Column to Foundation	41
PS720 D72, D74 Wall to Pile/Girder 38 RBC D97, D98, D99 Roof Boundary Connection 43 RFB D106 Holdowns 45 RPBZ D90 Post/Column to Foundation 41 RSP4 D43 Top Plates to Stud 28 RSP4 — Stud to Sill Plate 32 D129 Overlapping Connectors 51 RTC44 D86, D87 Beam to Corner Post/Column 40 RTUD D115 Strong-Rod™ Uplift Restraint System 47 SD10 D37 Hollow Column 26 P1 Truss/Rafter to Wood Double Top Plates 16 D43 Top Plates to Stud 28 D46 Stud to Stud 30 D52 Stud to Stud 30 D52 Stud to Stud 31 D46 Stud to Sill Plate 32 D139, D140 Roof to Wall 58 D141, D142, D143, D144 Roof to Wall 59 D146, D147, D148 <td>PS218</td> <td>D72</td> <td>Wall to Pile/Girder</td> <td>38</td>	PS218	D72	Wall to Pile/Girder	38
RBC D97, D98, D99 Roof Boundary Connection 43 RFB D106 Holdowns 45 RPBZ D90 Post/Column to Foundation 41 RSP4 D43 Top Plates to Stud 28 RSP4 — Stud to Sill Plate 32 D129 Overlapping Connectors 51 RTC44 D86, D87 Beam to Corner Post/Column 40 RTUD D115 Strong-Rod™ Uplift Restraint System 47 SD10 D37 Hollow Column 26 PA Truss/Rafter to Wood Double Top Plates 16 D43 Top Plates to Stud 28 D46 Stud to Stud 30 D52 Stud to Stud 32 D46 Stud to Stud 32 D134 Building Floor-to-Floor Straps 52 D139, D140 Roof to Wall 59 D141, D142, D143, D144 Roof to Wall 59 D146, D147, D148 Stud to Plate (Wide Face) 60 D146, D147, D148 <td< td=""><td>PS418</td><td>D72, D73</td><td>Wall to Pile/Girder</td><td>38</td></td<>	PS418	D72, D73	Wall to Pile/Girder	38
RFB D106 Holdowns 45 RPBZ D90 Post/Column to Foundation 41 Lang D43 Top Plates to Stud 28 RSP4 — Stud to Sill Plate 32 D129 Overlapping Connectors 51 RTC44 D86, D87 Beam to Corner Post/Column 40 RTUD D115 Strong-Rod™ Uplift Restraint System 47 SD10 D37 Hollow Column 26 D43 Top Plates to Stud 28 D43 Top Plates to Stud 28 D46 Stud to Stud 30 D52 Stud to Stud 30 D52 Stud to Wall Framing 34 D59 Header to Wall Framing 34 D134 Building Floor-to-Floor Straps 52 D139, D140 Roof to Wall 58 D141, D142, D143, D144 Roof to Wall 59 D145 Stud to Plate (Wide Face) 60 D146 Stud to Stud 30 SDWF D149,	PS720	D72, D74	Wall to Pile/Girder	38
RPBZ D90 Post/Column to Foundation 41 BA3 Top Plates to Stud 28 RSP4 — Stud to Sill Plate 32 D129 Overlapping Connectors 51 RTC44 D86, D87 Beam to Corner Post/Column 40 RTUD D115 Strong-Rod™ Uplift Restraint System 47 SD10 D37 Hollow Column 26 D43 Top Plates to Stud 28 D43 Top Plates to Stud 28 D46 Stud to Still Plate 32 D52 Stud to Sill Plate 32 SDWC D59 Header to Wall Framing 34 Building Floor-to-Floor Straps 52 D134 Building Floor-to-Floor Straps 52 D139, D140 Roof to Wall 58 D141, D142, D143, D144 Roof to Wall 59 D145 Stud to Plate (Wide Face) 60 D146, D147, D148 Stud to Stud 30 SDWF D149, D150 Floor to Floor 62	RBC	D97, D98, D99	Roof Boundary Connection	43
RSP4 D43 Top Plates to Stud 28 RSP4 — Stud to Sill Plate 32 D129 Overlapping Connectors 51 RTC44 D86, D87 Beam to Corner Post/Column 40 RTUD D115 Strong-Rod** Uplift Restraint System 47 SD10 D37 Hollow Column 26 D43 Top Plates to Stud 28 D43 Top Plates to Stud 28 D46 Stud to Stud 30 D52 Stud to Stud 32 D59 Header to Wall Framing 34 D134 Building Floor-to-Floor Straps 52 D139, D140 Roof to Wall 58 D141, D142, D143, D144 Roof to Wall 59 D145 Stud to Plate (Wide Face) 60 D145 Stud to Stud 30 SDWF D149, D150 Floor to Floor 62 D151, D152 Floor to Floor 63 SDWF-TUW D134 Building Floor-to-Floor Straps	RFB	D106	Holdowns	45
RSP4 — Stud to Sill Plate 32 D129 Overlapping Connectors 51 RTC44 D86, D87 Beam to Corner Post/Column 40 RTUD D115 Strong-Rod™ Uplift Restraint System 47 SD10 D37 Hollow Column 26 SPWC D1 Truss/Rafter to Wood Double Top Plates 16 D43 Top Plates to Stud 28 D46 Stud to Stud 30 D52 Stud to Sill Plate 32 D59 Header to Wall Framing 34 D134 Building Floor-to-Floor Straps 52 D139, D140 Roof to Wall 58 D141, D142, D143, D144 Roof to Wall 59 D145 Stud to Plate (Wide Face) 60 D146, D147, D148 Stud to Plate (Narrow Face) 61 SDWF D149, D150 Floor to Floor 62 D151, D152 Floor to Floor 63 SDWF-TUW D134 Building Floor-to-Floor Straps 52 S	RPBZ	D90	Post/Column to Foundation	41
D129 Overlapping Connectors 51 RTC44 D86, D87 Beam to Corner Post/Column 40 RTUD D115 Strong-Rod™ Uplift Restraint System 47 SD10 D37 Hollow Column 26 SDWC D1 Truss/Rafter to Wood Double Top Plates 16 D43 Top Plates to Stud 28 D46 Stud to Stud 30 D52 Stud to Sill Plate 32 SDWC D59 Header to Wall Framing 34 D134 Building Floor-to-Floor Straps 52 D139, D140 Roof to Wall 58 D141, D142, D143, D144 Roof to Wall 59 D145 Stud to Plate (Wide Face) 60 D146, D147, D148 Stud to Plate (Narrow Face) 61 SDWF D149, D150 Floor to Floor 62 D151, D152 Floor to Floor 63 SDWS D137, D138 Sole Plate and Ledger Connections 57		D43	Top Plates to Stud	28
RTC44 D86, D87 Beam to Corner Post/Column 40 RTUD D115 Strong-Rod™ Uplift Restraint System 47 SD10 D37 Hollow Column 26 SDWC D1 Truss/Rafter to Wood Double Top Plates 16 D43 Top Plates to Stud 28 D46 Stud to Stud 30 D52 Stud to Sill Plate 32 D59 Header to Wall Framing 34 D134 Building Floor-to-Floor Straps 52 D139, D140 Roof to Wall 58 D141, D142, D143, D144 Roof to Wall 59 D145 Stud to Plate (Wide Face) 60 D146, D147, D148 Stud to Plate (Narrow Face) 61 D46 Stud to Stud 30 SDWF D149, D150 Floor to Floor 62 D151, D152 Floor to Floor 63 SDWS D137, D138 Sole Plate and Ledger Connections 57	RSP4	_	Stud to Sill Plate	32
RTUD D115 Strong-Rod™ Uplift Restraint System 47 SD10 D37 Hollow Column 26 SDWC D1 Truss/Rafter to Wood Double Top Plates 16 D43 Top Plates to Stud 28 D46 Stud to Stud 30 D52 Stud to Sill Plate 32 D59 Header to Wall Framing 34 D134 Building Floor-to-Floor Straps 52 D139, D140 Roof to Wall 58 D141, D142, D143, D144 Roof to Wall 59 D145 Stud to Plate (Wide Face) 60 D146, D147, D148 Stud to Plate (Narrow Face) 61 D46 Stud to Stud 30 SDWF D149, D150 Floor to Floor 62 D151, D152 Floor to Floor 63 SDWF-TUW D134 Building Floor-to-Floor Straps 52 SDWS D137, D138 Sole Plate and Ledger Connections 57		D129	Overlapping Connectors	51
SD10 D37 Hollow Column 26 SDWC D1 Truss/Rafter to Wood Double Top Plates 16 D43 Top Plates to Stud 28 D46 Stud to Stud 30 D52 Stud to Sill Plate 32 D59 Header to Wall Framing 34 D134 Building Floor-to-Floor Straps 52 D139, D140 Roof to Wall 58 D141, D142, D143, D144 Roof to Wall 59 D145 Stud to Plate (Wide Face) 60 D146, D147, D148 Stud to Plate (Narrow Face) 61 D46 Stud to Stud 30 SDWF D149, D150 Floor to Floor 62 D151, D152 Floor to Floor 63 SDWF-TUW D134 Building Floor-to-Floor Straps 52 SDWS D137, D138 Sole Plate and Ledger Connections 57	RTC44	D86, D87	Beam to Corner Post/Column	40
D1 Truss/Rafter to Wood Double Top Plates 16 D43 Top Plates to Stud 28 D46 Stud to Stud 30 D52 Stud to Sill Plate 32 D59 Header to Wall Framing 34 D134 Building Floor-to-Floor Straps 52 D139, D140 Roof to Wall 58 D141, D142, D143, D144 Roof to Wall 59 D145 Stud to Plate (Wide Face) 60 D146, D147, D148 Stud to Plate (Narrow Face) 61 SDWF D46 Stud to Stud 30 SDWF D149, D150 Floor to Floor 62 D151, D152 Floor to Floor 63 SDWF-TUW D134 Building Floor-to-Floor Straps 52 SDWS D137, D138 Sole Plate and Ledger Connections 57	RTUD	D115	Strong-Rod™ Uplift Restraint System	47
D43 Top Plates to Stud 28 D46 Stud to Stud 30 D52 Stud to Sill Plate 32 D59 Header to Wall Framing 34 D134 Building Floor-to-Floor Straps 52 D139, D140 Roof to Wall 58 D141, D142, D143, D144 Roof to Wall 59 D145 Stud to Plate (Wide Face) 60 D146, D147, D148 Stud to Plate (Narrow Face) 61 SDWF D149, D150 Floor to Floor 62 D151, D152 Floor to Floor 63 SDWF-TUW D134 Building Floor-to-Floor Straps 52 SDWS D137, D138 Sole Plate and Ledger Connections 57	SD10	D37	Hollow Column	26
D46 Stud to Stud 30 D52 Stud to Sill Plate 32 D59 Header to Wall Framing 34 D134 Building Floor-to-Floor Straps 52 D139, D140 Roof to Wall 58 D141, D142, D143, D144 Roof to Wall 59 D145 Stud to Plate (Wide Face) 60 D146, D147, D148 Stud to Plate (Narrow Face) 61 SDWF D46 Stud to Stud 30 SDWF D149, D150 Floor to Floor 62 D151, D152 Floor to Floor 63 SDWF-TUW D134 Building Floor-to-Floor Straps 52 SDWS D137, D138 Sole Plate and Ledger Connections 57		D1	Truss/Rafter to Wood Double Top Plates	16
Stud to Sill Plate 32 SDWC D59 Header to Wall Framing 34 D134 Building Floor-to-Floor Straps 52 D139, D140 Roof to Wall 58 D141, D142, D143, D144 Roof to Wall 59 D145 Stud to Plate (Wide Face) 60 D146, D147, D148 Stud to Plate (Narrow Face) 61 SDWF D149, D150 Floor to Floor 62 D151, D152 Floor to Floor 63 SDWF-TUW D134 Building Floor-to-Floor Straps 52 SDWS D137, D138 Sole Plate and Ledger Connections 57		D43	Top Plates to Stud	28
SDWC D59 Header to Wall Framing 34 D134 Building Floor-to-Floor Straps 52 D139, D140 Roof to Wall 58 D141, D142, D143, D144 Roof to Wall 59 D145 Stud to Plate (Wide Face) 60 D146, D147, D148 Stud to Plate (Narrow Face) 61 SDWF D46 Stud to Stud 30 SDWF Floor to Floor 62 D151, D152 Floor to Floor 63 SDWF-TUW D134 Building Floor-to-Floor Straps 52 SDWS D137, D138 Sole Plate and Ledger Connections 57		D46	Stud to Stud	30
D134 Building Floor-to-Floor Straps 52 D139, D140 Roof to Wall 58 D141, D142, D143, D144 Roof to Wall 59 D145 Stud to Plate (Wide Face) 60 D146, D147, D148 Stud to Plate (Narrow Face) 61 D46 Stud to Stud 30 SDWF D149, D150 Floor to Floor 62 D151, D152 Floor to Floor 63 SDWF-TUW D134 Building Floor-to-Floor Straps 52 SDWS D137, D138 Sole Plate and Ledger Connections 57		D52	Stud to Sill Plate	32
D134 Building Floor-to-Floor Straps 52	CDIMO	D59	Header to Wall Framing	34
D141, D142, D143, D144 Roof to Wall 59 D145 Stud to Plate (Wide Face) 60 D146, D147, D148 Stud to Plate (Narrow Face) 61 D46 Stud to Stud 30 SDWF D149, D150 Floor to Floor 62 D151, D152 Floor to Floor 63 SDWF-TUW D134 Building Floor-to-Floor Straps 52 SDWS D137, D138 Sole Plate and Ledger Connections 57	SDWC	D134	Building Floor-to-Floor Straps	52
D145 Stud to Plate (Wide Face) 60 D146, D147, D148 Stud to Plate (Narrow Face) 61 SDWF D46 Stud to Stud 30 SDWF D149, D150 Floor to Floor 62 D151, D152 Floor to Floor 63 SDWF-TUW D134 Building Floor-to-Floor Straps 52 SDWS D137, D138 Sole Plate and Ledger Connections 57		D139, D140	Roof to Wall	58
D146, D147, D148 Stud to Plate (Narrow Face) 61 D46 Stud to Stud 30 SDWF D149, D150 Floor to Floor 62 D151, D152 Floor to Floor 63 SDWF-TUW D134 Building Floor-to-Floor Straps 52 SDWS D137, D138 Sole Plate and Ledger Connections 57		D141, D142, D143, D144	Roof to Wall	59
SDWF D46 Stud to Stud 30 SDWF D149, D150 Floor to Floor 62 D151, D152 Floor to Floor 63 SDWF-TUW D134 Building Floor-to-Floor Straps 52 SDWS D137, D138 Sole Plate and Ledger Connections 57		D145	Stud to Plate (Wide Face)	60
SDWF D149, D150 Floor to Floor 62 D151, D152 Floor to Floor 63 SDWF-TUW D134 Building Floor-to-Floor Straps 52 SDWS D137, D138 Sole Plate and Ledger Connections 57		D146, D147, D148	Stud to Plate (Narrow Face)	61
D151, D152 Floor to Floor 63 SDWF-TUW D134 Building Floor-to-Floor Straps 52 SDWS D137, D138 Sole Plate and Ledger Connections 57		D46	Stud to Stud	30
SDWF-TUWD134Building Floor-to-Floor Straps52SDWSD137, D138Sole Plate and Ledger Connections57	SDWF	D149, D150	Floor to Floor	62
SDWS D137, D138 Sole Plate and Ledger Connections 57		D151, D152	Floor to Floor	63
	SDWF-TUW	D134	Building Floor-to-Floor Straps	52
SET® Epoxy Anchoring Adhesive D38 Hollow Column 26	SDWS	D137, D138	Sole Plate and Ledger Connections	57
	SET® Epoxy Anchoring Adhesive	D38	Hollow Column	26



PRODUCT	DETAIL DRAWING NO.	APPLICATION	PAGE
SP1Z	D52	Stud to Sill Plate	32
0.00	D42	Top Plates to Stud	28
SP2	D129	Overlapping Connectors	51
004	D44	Top Plates to Stud	28
SP4	D58	Header to Wall Framing	34
SP4Z	D52	Stud to Sill Plate	32
SPH4	D44	Top Plates to Stud	28
SPH4Z	D52	Stud to Sill Plate	32
000	D41	Top Plates to Stud	28
SSP	D129	Overlapping Connectors	51
0007	D45	Stud to Band Joist	29
SSPZ	D52	Stud to Sill Plate	32
	D110	Strong-Wall® Shearwalls	46
00147	D112	Garage Front	46
SSW	D113	Balloon Framing	46
	D114	Two-Story Stacked Wall	46
STHD	D109	Holdowns	45
STHD14RJ	D104	Holdowns	45
SWSB	D111	Standard and Balloon Framing	46
THA222-2	D8	Girder/Truss to Wood Wall Framing	17
THA426	D50	Floor to Masonry/Concrete	31
	D19	Post-Installed Truss/Rafter to Masonry/Concrete	21
	D34	Truss/Rafter to Single Top Plate	25
Titen HD® Heavy-Duty Screw Anchor	D55	Sill Plate to Foundation	33
OCIEW AIICIIOI	D106	Holdowns	45
	D153, D154, D155	Titen HD® Heavy-Duty Screw Anchors	67
T' LID® D L O	D38	Hollow Column	26
Titen HD® Rod Coupler	D50	Floor to Masonry/Concrete	31
TJC37	D24	Truss/Rafter Hip to Wall	23
TJC57	D24	Truss/Rafter Hip to Wall	23
Truss Anchor	D135	Mislocated Truss Anchors	53
	D4	Truss/Rafter to Wood Double Top Plates	16
TSP	D41	Top Plates to Stud	28
	D129, D132	Overlapping Connectors	51
TSPZ	D52	Stud to Sill Plate	32
TSS	D16	Embedded Truss/Rafter to Masonry/Concrete	20
VOT	D7	Girder/Truss to Wood Wall Framing	17
VGT	D23	Girder/Truss to Masonry/Concrete	22
VTCR	D120, D121	Valley Truss to Roof Framing	49

Note	Strong-Tie

SIMPSON



Every day we work hard to earn your business, blending the talents of our people with the quality of our products and services to exceed your expectations. This is our pledge to you.

Home Office

5956 W. Las Positas Boulevard Pleasanton, CA 94588 Tel: (925) 560-9000 • Fax: (925) 847-1603

Northwest USA

5151 S. Airport Way Stockton, CA 95206 Tel: (209) 234-7775 • Fax: (209) 234-3868

Southwest USA

12246 Holly Street Riverside, CA 92509 Tel: (714) 871-8373 • Fax: (951) 369-2889

Northeast USA

2600 International Street Columbus, OH 43228 Tel: (614) 876-8060 • Fax: (614) 876-0636

Southeast USA

2221 Country Lane McKinney, TX 75069 Tel: (972) 542-0326 • Fax: (972) 542-5379

INTERNATIONAL FACILITIES

Please visit our website for address and contact information for our European facilities.

Kent Specials Factory

22023 68th Avenue S. Kent, WA 98032 Toll Free: (877) 564-2041

Eagan Warehouse & Specials Factory

3711 Kennebec Drive, Suite 700 Eagan, Minnesota 55122 Tel: (651) 681-2061 • Fax: (651) 681-2046

Eastern Canada

5 Kenview Boulevard Brampton, ON L6T 5G5 Tel: (905) 458-5538 • Fax: (905) 458-7274

Western Canada

11476 Kingston Street Maple Ridge, B.C. V2X 0Y5 Tel: (604) 465-0296 • Fax: (604) 465-0297

Distribution Centers

Chandler, AZ; Enfield, CT; High Point, NC; Houston, TX; Jacksonville, FL; Kansas City, KS; Jessup, MD;

The Power to Build Homes

Buildings Roadways









Our founder Barclay Simpson started our company with a simple belief—help customers solve problems. Barc did just that when he created our first joist hanger in 1956 for a customer who needed to make a roof connection. Today, we have many more solutions to meet customers' construction needs with our full product offering of structural connectors, fasteners, fastening systems, anchors, lateral systems, software, and concrete repair, protection and strengthening systems.

Simpson Strong-Tie creates product solutions to give you **the power to build**. Let us help with your next project, call your local rep at (800) 999-5099 and connect with us on **strongtie.com**.

